Standard Bidding Document

Procurement of "132KV & 220KV Isolators alongwith essential spare parts for Allai Khwar Power Station" through Internnational Competitive Bidding (ICB) on FOB Basis
(Goods)

International

Single Stage-One Envelope

October 21, 2026

Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA),Resident Engineer Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).
Phone: +92-347-409-7358, Email: reakph@gmail.com

Table of Contents

REQUEST FOR BIDS 1

Instructions to Bidders 3

Bid Data Sheet 24

Bids Data Sheet (BDS) 25

Eligibility Criteria 30

Evaluation Criteria 31

Items/Lots 32

Related Services of Goods: 38

Items/Lot Specification 39

Price Schedule 45

General Conditions of Contract 48

Special Conditions of Contract 59

Bid Securing Declaration 67

Contract Form 69

Integrity Pact 72

Performance Guarantee Form 74

Annexure 77

220 kV Disconnector & Earthing switch Technical Data 1

Outline Drawings of 220 kV Disconnector, Nameplate, Motor Operating Mechanism Type Nameplate. (With ar 78

220 kV Disconnector Motor Circuit Diagram (With and without earthing switch). 78

Foundation Details and Loads of 220KV disconnector (With and without earthing switch) 78

220 kV Disconnector Steel Structure Drawing 78

132 kV Disconnector & Earthing Switch Technical Data 1

Outline Drawings of 132 kV Disconnector, Nameplate, Motor Operating Mechanism Type Nameplate. (With ar 79

132 kV Disconnector Motor Circuit Diagram (With and without earthing switch). 79

Foundation Details and Loads of 132KV disconnector (With and without earthing switch). 79

132 kV Disconnector Steel Structure Drawing 79

Procurement Forms 81

Past Experience and Completed Contracts 1

Historical Contract Non-Performance, and Pending Litigation and Litigation History 1

Current Contracts and Their Progress 1

Financial Capacity and Net Worth Evaluation Form 1

Average Annual Turnover 1

Additional Forms and Documents 84

REQUEST FOR BIDS

PROCUREMENT OF GOODS

1. The **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA)** has reserved Funds for the procurement planned for FY **2026-27**. The **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA)** intends to apply part of the proceeds of this Fund to cover eligible payments under the contract for the "**Procurement of "132KV & 220KV Isolators alongwith essential spare parts for Allai Khwar Power Station" through Internnational Competitive Bidding (ICB) on FOB Basis**" with the reference of **"P69836"**

2. The **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA)** invites sealed Bids from eligible Bidders for procurement of goods described in the bidding documents on **EPADS v2.0**.

3. **Single Stage-One Envelope** will be used by adopting **Least Cost Based Selection (LCBS)** Technique for the subject procurement, in line with the Public Procurement Rules, 2026 and any Regulations, Regulatory Guides, Procurement Guidelines or Instructions issued by the Authority from time to time.

4. All Bids must be accompanied by a Bid Security amount described in Bid Security Section in Bidding Document in the form of **Pay Order, Call at Deposit, Bank Guarantee** or all bids must be accompanied by bid securing declaration in the format specified in the Bidding documents

5. E-Bidding documents, containing detailed terms & conditions, specifications and requirements etc. are available on **e-Pak Acquisition and Disposal System (EPADS)** at **https://epads.gov.pk/opportunities/federal/procurements/69836** for all the interested bidders registered on **EPADS v2.0**. Bidders are required to get themselves registered on **EPADS v2.0** to participate in Bidding process.

6. The e-bids, prepared in accordance with the instructions in the e-Bidding Documents, must be submitted through **EPADS v2.0** on or before **Tuesday, February 16, 2027 11:00 AM**. E-bids will be opened using **EPADS v2.0** on

the same day at **Tuesday, February 16, 2027 11:30 AM**. Manual submission of Bids shall not be entertained. Those vendors who have not yet registered on the new version of **EPADS v2.0,** may register themselves on **https://vendors.epads.gov.pk/**. A tutorial to explain the registration process is available at **https://www.youtube.com/watch?v=MNW6T38v7tc**

In terms of Rule 65 of Public Procurement Rules, 2026 Grievance Redressal Committee (GRC) is notified for the subject procurement and notification copy is available on the procuring agency's website and on Authority's website at (**www.ppra.gov.pk**).

Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer
Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).
+92-347-409-7358
reakph@gmail.com

Instructions to Bidders

A. Introduction

1.Scope of Bids

1.1 The Procuring Agency (PA), as indicated in the **Bids Data Sheet (BDS)** invites Bids **through EPADS v2.0** for the provision of Goods as specified in the BDS and **in Section V – Evaluation Criteria, Specifications & Schedule of Requirements**. The name, identification, and number of items/deliverables are provided in the **BDS**. The successful Bidders will be expected to provide the goods within the specified period and timeline(s) as stated in the **BDS**.

2. Source of Funds

2.1 Source of funds is referred in Clause-2 I of Invitation for Bids.

3. Eligible Bidders

3.1 A Bidder may be natural person, company or firm or public or semi-public agency of Pakistan or any foreign country**,** or any combination of them with a formal existing agreement (on Judicial Papers) in the form of a joint venture, consortium, or association. In the case of a joint venture, consortium, or association, all members shall be jointly and severally liable for the execution of the Contract in accordance with the terms and conditions of the Contract. The joint venture, consortium, or association shall nominate a Lead Member as nominated in the BDS, who shall have the authority to conduct all business for and on behalf of any and all the members of the joint venture, consortium, or association during the Bidding process, and in case of award of contract, during the execution of the contract.

Verifiable copy of the agreement that forms a joint venture, consortium or association shall be required to be submitted as part of the Bid.

The appointment of Lead Member in the joint venture, consortium, or association shall be confirmed by submission of a valid Power of Attorney to the Procuring Agency.

Any bid submitted by the joint venture, consortium or association shall indicate the part of proposed contract to be performed by each party and each party shall be evaluated (or post qualified if required) with respect to its contribution only, and the responsibilities of each party shall not be substantially altered without prior written approval of the Procuring Agency and in line with any

instructions issued by the Authority.

(The limit on the number of members of JV or Consortium or Association may be prescribed in BDS, in accordance with the guidelines issued by the PPRA).

3.2 The invitation for Bids is open to all prospective suppliers, manufacturers, or authorized agents / dealers subject to any provisions of incorporation or licensing by the respective national incorporating agency or statutory body established for that particular trade or business. Procuring agencies shall specify the registration/licensing requirements for the foreign bidders keeping in view the requirement of that business.

3.3 A Bidder shall not have a conflict of interest. All Bidders found to have a conflict of interest shall be disqualified. A Bidder may be considered to have a conflict of interest with one or more parties in this Bidding process, if they:

1. are associated or have been associated in the past, directly or indirectly with a firm or any of its affiliates which have been engaged by the Procuring Agency to provide consulting services for the preparation of the design, specifications and other documents to be used for the procurement of the Goods to be purchased under this Invitation for Bids.

2. have controlling shareholders in common; or

3. receive or have received any direct or indirect subsidy from any of them; or

4. have the same legal representative for purposes of this Bid; or

5. have a relationship with each other, directly or through common third parties, that puts them in a position to have access to information about or influence on the Bids of another Bidder, or influence the decisions of the Procuring Agency regarding this Bidding process; or

6. Submit more than one Bid in this Bidding process.

3.4 A Bidder may be ineligible if –

1. he is declared bankrupt or, in the case of company or firm, insolvent;

2. payments in favor of the Bidder is suspended in accordance with the judgment of a court of law other than a judgment declaring bankruptcy and resulting (in accordance with the national laws) in the total or partial loss of the right to administer and dispose of its property;

3. the Bidder is convicted, by a final judgment, of any offence involving professional conduct;

4. the Bidder is blacklisted locally or by international organizations and hence debarred due to involvement in corrupt and fraudulent practices, or submission of false or misleading information or performance failure or involved in disrupting procurement process or due to breach of bid Securing Declaration.

3.5 As and when required, bidders shall provide to the Procuring Agency evidence of their eligibility, proof of compliance with the necessary legal requirements to carry out the contract effectively.

3.6 Bidders shall submit Bids relating to the nature, conditions and modalities of sub-contracting wherever the sub-contracting of any elements of the contract amounting to more than ten (10) percent of the Bid price is envisaged.

4. Eligible Goods and Related Services

4.1 All goods and related services to be supplied under the contract shall have their origin in eligible source countries, and all expenditures made under the contract will be limited to such goods and services. For purpose of this Bid, ineligible countries are the countries declared ineligible by the Federal Government.

5. One Bid per Bidder

5.1 A bidder shall submit only one Bid, in the same bidding process, either individually as a Bidder or as a member in a joint venture or any similar arrangement.

5.2 **The Bidder shall not engage a subcontractor for any portion of the contract if the value of such subcontracting exceeds thirty percent (30%) of the total contract amount.**

6. Cost of Bidding

6.1 Any cost incurred by the bidder relating to the preparation and submission of its Bid shall be borne by the bidder, and the Procuring Agency shall in no case be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.

B. Bidding Documents

7. Contents of Bidding Document

7.1 The Goods required, Bidding procedures, and terms and conditions of the contract are prescribed in the Bidding Documents. In addition to the Invitation for Bids, the Bidding documents which should be read in conjunction with any addenda issued in accordance with **ITB 10.1** include:

Section I -Invitation to Bids

Section II Instructions to Bidders (ITB)

Section III Bid Data Sheet (BDS)

Section IV Evaluation Criteria, Specifications, Schedule of Requirements

Section V Bid Forms

Section VI General Conditions of Contract (GCC)

Section VII Special Conditions of Contract (SCC)

Section VIII Contract Forms

Section IX Integrity Pact

Section X Declaration of Beneficial Ownership Information.

7.2 The Bidder is expected to examine all instructions, forms, terms and specifications in the Bidding documents. Failure to furnish all the information required in the Bidding documents through EPADS v2.0 will be at the Bidder’s risk and may result in the rejection of its Bids.

8. Clarification of Bidding documents

8.1 A prospective Bidder requiring any clarification of the Bidding documents may notify the Procuring Agency through EPADS v2.0**.**

8.2 The Procuring Agency will within two (02) working days after receiving the request for clarification, respond to any request for clarification through EPADS v2.0 provided that such request is received not later than three (03) days, prior to the deadline for the submission of Bids as prescribed in **ITB 22**

8.3 The Procuring Agency's response will be forwarded to all identified Prospective Bidders through EPADS v2.0, including a description of the inquiry,

but without identifying its source.

8.4 Should the Procuring Agency deem it necessary to amend the Bidding document as a result of a clarification, it shall do so following the procedure under **ITB 9.**

8.5 If indicated **in the BDS**, the Bidder's designated representative is invited at the Bidder's cost to attend a pre-Bid meeting at the place, date and time mentioned **in the BDS**. During this pre-Bid meeting, prospective Bidders may request clarification of the schedule of requirement, the Evaluation Criteria or any other aspects of the Bidding document.

8.6 Minutes of the pre-Bid meeting, if applicable, including the text of the questions asked by Bidders, including those during the meeting (without identifying the source) and the responses given, together with any responses prepared after the meeting will be uploaded on EPADS v2.0. Any modification to the Bidding documents that may become necessary as a result of the pre-Bid meeting shall be made by the Procuring Agency exclusively through the use of an Addendum pursuant to ITB 9. Non-attendance at the pre-Bid meeting will not be a cause for disqualification of a Bidder.

9. Amendment of Bidding documents

9.1 Before the deadline for submission of Bids, the Procuring Agency for any reason, whether at its own initiative or in response to a clarification requested by a prospective Bidder or Pre-Bid meeting may modify the Bidding documents by issuing addenda through EPADS v2.0.

9.2 The Procuring Agency shall promptly publish the addendum through EPADS v2.0.

Any addendum issued including the notice of any extension of the deadline shall also be communicated through EPADS v2.0 to all the bidders who have already submitted their bids. Such bidders shall have the right to withdraw their already submitted bid and re-submit the revised bid prior to the original or extended bid submission deadline.

9.3 To give prospective Bidders reasonable time in which to take an addendum/corrigendum into account in preparing their Bids, the Procuring Agency may, at its discretion, extend the deadline for the submission of Bids through EPADS v2.0:

Provided that the Procuring Agency shall extend the deadline for submission of Bids, if such an addendum is issued within last three (03) days of the Bids submission deadline.

C. Preparation of Bids

10. Language of Bid

10.1 The Bid prepared by the bidder, as well as all correspondence and documents relating to the Bids exchanged by the Bidder and the Procuring Agency shall be written in the English language unless otherwise specified in the BDS**.** Supporting documents and printed literature furnished by the Bidder may be in another language provided they are accompanied by an accurate translation of the relevant pages in the English language unless otherwise specified in the **BDS**, in which case, for purposes of interpretation of the Bidder, the translation shall govern.

11. Documents and samples Constituting the Bid

11.1 The Bid prepared by the Bidder shall constitute the documents required in the **BDS**.

Details of sample(s) where applicable and requested in the BDS.

Documentary evidence established in accordance with ITB 13 that the Bidder is eligible and/or qualified for the subject bidding process;

Documentary evidence established in accordance with **ITB 03** that the Bidder has been authorized by the manufacturer to deliver the goods into Pakistan, where required and where the supplier is not the manufacturer of those goods;

Documentary evidence established in accordance with ITB 12 that the goods and related services to be supplied by the Bidder are eligible goods and services, and conform to the Bidding Documents;

Bid security or Bid Securing Declaration furnished in accordance with **ITB ---.**

12. Documents Establishing Eligibility of the Goods and Conformity to Bidding documents

12.1 To establish the conformity of the bidder to the Bidding document, the Bidder shall furnish as part of its Bids the documentary evidence that Goods

provided conform to the technical specifications and standards.

13. Documents Establishing Eligibility and Qualification of the Bidder

13.1 Pursuant to **ITB 10,** the Bidder shall furnish, as part of its Bid, all those documents establishing the Bidder's eligibility to participate in the Bidding process and/or its qualification to perform the contract if its Bid is accepted.

14. Form of Bid

14.1 The Bidder shall fill the Form of Bid furnished in the Bidding document. The Bid Form must be completed without any alterations to its format and no substitute shall be accepted.

15. Bid Prices

15.1 The Bid Prices quoted by the Bidder in the Form of Bid and in the Price Schedules shall conform to the requirements specified below or exclusively mentioned hereafter in the Bidding documents.

15.2 **All items in the Schedule of Requirement must be listed and priced separately in the Price Schedule(s). If a Price Schedule shows items listed but not priced and neither explicitly denied, their prices shall be construed to be included in the prices of other items.**

15.3 In the event that any item(s) in the Price Schedule are not quoted, and such omission is determined by the Procuring Agency not to materially affect the responsiveness of the Bid, the Procuring Agency may, for the sole purpose of bid evaluation and comparison, assign a price to the unquoted item(s) in accordance with the following methodology:

(a) The assigned price shall be the average of the prices quoted for the same item(s) by all substantially responsive bidders; or

(b) In cases where no comparable quotations are available, the Procuring Agency shall apply the corresponding item price from its duly approved cost estimate for evaluation purposes.

The prices so assigned shall be utilized exclusively for bid evaluation and comparison, and shall not, under any circumstances, be incorporated into or form part of the Contract Price.

15.4 The Bid price to be quoted in the Form of Bid in accordance with **ITB 13.1** shall be the total price of the Bid.

15.5 The Bidder shall indicate on the appropriate Price Schedule, the unit prices (where applicable) and total Bid price of the Goods it proposes to provide under the contract.

15.6 Prices quoted by the Bidder shall be fixed during the Bidder's performance of the contract and not subject to variation on any account. A Bid submitted with an adjustable price will be treated as non-responsive and shall be rejected.

16. Bids Currencies

16.1 Prices shall be quoted in Pakistani Rupees unless otherwise specified in the BDS in accordance with Rule 42 (2) of the Public Procurement Rules, 2026.

17. Bids Validity Period

17.1 Such extensions may be more than one time but the total period of such extension shall not exceed the original bid validity period.

17.2 Bids shall remain valid for the period specified in the **BDS** after the Bid submission deadline prescribed by the Procuring Agency. A Bid valid for a shorter period shall be rejected by the Procuring Agency as non-responsive**.** The period of Bid validity will be determined from the complementary Bid securing instrument, i.e. the expiry period of Bid Security or Bids Securing Declaration as the case may be.

The procuring agency shall ordinarily be under an obligation to process and evaluate the bid and to issue letter of award within the stipulated bid validity period.

17.3 Under exceptional circumstances, prior to the expiration of the initial Bid validity period, the Procuring Agency may request the Bidders' consent to an extension of the period of validity of their Bids through EPADS v2.0,. The Bid Security provided under **ITB 17** shall also be suitably extended. A Bidder may refuse the request without forfeiting its Bid security or causing to be executed its Bid Securing Declaration. A Bidder agreeing to the request will not be required nor permitted to modify its Bid, but will be required to extend the validity of its Bid Security or Bid Securing Declaration for the period of the extension.

18. Bid Security or Bid Securing Declaration

18.1 The Bidder shall furnish as part of its Bid, a Bid Security in accordance with Rule 36 of the Public Procurement Rules, 2026.

18.2 The original Bid Security shall be enclosed within the sealed envelope and to be submitted physically before closing time for submission of bids. Whereas, scanned copy of bid security shall be uploaded electronically through EPADS v2.0 before closing hours for submission of bids.

18.3 The Bidder who failed to submit the original Bids security before the submission deadline shall be disqualified straightaway.

18.4 The Bid Security or Bid Securing Declaration is required to protect the Procuring Agency against the risk of Bidder’s conduct which would warrant the security’s forfeiture, pursuant to **ITB 18.7.**

18.5 The Bid Security shall be denominated in the local currency or in another freely convertible currency, and it shall be in the form specified in the BDS which shall be in any of the following:

a) a bank guarantee, a bank draft, an irrevocable letter of credit issued by a Scheduled bank in the form provided in the Bidding Documents or another form acceptable to the Procuring Agency;

b) a cashier’s or certified cheque; or

c) another security if indicated in the BDS.

The Bid Security shall be valid for twenty-eight (28) days beyond the end of the validity of the Bid. This shall also apply if the period for Bid Validity is extended. In either case, the form must include the complete name of the Bidder.

18.6 The Bid Security shall be payable promptly upon written demand by the Procuring Agency in case any of the conditions listed in **ITB 18.7** are invoked.

18.7 Unsuccessful Bidders' Bid Security will be discharged or returned as promptly as possible, however in no case later than thirty (30) days after the expiration of the period of Bid Validity prescribed by the procuring agency pursuant to **ITB 17.** The Procuring Agency shall make no claim to the amount of the Bid Security, and shall promptly return the Bid Security documents, after whichever of the following that occurs earliest:

a. the expiry of the Bid Security;

b. the entry into force of a procurement contract and the provision of a Performance Guarantee, for the performance of the contract if such a guarantee, is required by the Bid documents;

c. the rejection by the Procuring Agency of all Bids;

d. cancellation of procurement proceedings.

e. the withdrawal of the Bid prior to the deadline for the submission of Bids, unless the Bid document stipulates that no such withdrawal is permitted.

18.8 The successful Bidder's Bid Security will be discharged upon the Bidder signing the contract**,** or furnishing the Performance Guarantee.

18.9 The Bid Security may be forfeited or the Bid Securing Declaration executed:

a. if a Bidder:

b. withdraws its Bid during the period of Bid Validity as specified by the Procuring Agency, and referred by the Bidder on the Form of Bids except as provided for in **ITB 16.2**; or

c. does not accept the correction of errors**;** or

d. in the case of a successful Bidder, if the Bidder fails:

e. to sign the contract; or

f. to furnish Performance Guarantee**.**

19. Withdrawal, Substitution, and Modification of Bid

19.1 Before Bid submission deadline, any Bidder may withdraw, substitute, or modify its Bid after it has been submitted through EPADS v2.0.

20. Format and Signing of Bid

20.1 The Bidder shall prepare and submit Bids with due diligence after carefully reading all the terms and condition before bid submission deadline through EPADS v2.0.

D. Submission of Bids

21. Submission of Bids through EPADS v2.0 before bid submission deadline.

21.1 The Technical and Financial Bids, shall be submitted electronically through EPADS, before bid submission deadline. The bid submission option shall be automatically disabled once the deadline is over.

22. Deadline for Submission of Bids

22.1 Bids shall be received by the Procuring Agency through EPADS v2.0 before bid submission deadline.

22.2 The Procuring Agency may, under exceptional circumstances, extend the deadline for the submission of Bids, after recording reasons in writing and in an equal opportunity manner.

In such case, all rights and obligations of the Procuring Agency and the Bidders that were previously governed by the original deadline shall thereafter be subject to the revised deadline.

E. Opening and Evaluation of Bids

23. Opening of Bids

23.1 The respective Bid Evaluation Committee of the Procuring Agency shall open all Bids through the EPADS v2.0, on the date and time specified in the Bid Data Sheet (BDS).

23.2 The respective Bid Evaluation Committee **shall generate minutes through EPADS v2.0 containing brief details of bid opening process.** The record of the Bid opening shall include, as a minimum: the name of the Bidder, the Bid price if applicable, and the presence or absence of a Bid Security or Bid Securing Declaration.

23.3 The procuring agency shall live broadcast the opening of bids on national media or on their website or digital channels, if the volume of procurement exceeds five hundred million rupees in case of goods and services and one thousand million rupees in case of works.

23.4 In case the date of opening of bid has been declared as public holiday or the procuring agency fails to open bid due to any EPADS v2.0 related issues, the submission and opening of bids shall be shifted to the next working day at the same time.

23.5 In case of Single Stage One Envelope Procedure, the Bidders names, the Bid prices, the total amount of each Bid and, the presence or absence of Bid Security, Bid Securing Declaration and such other details as the Procuring Agency may consider appropriate, will be announced by the Bid respective Evaluation Committee.

23.6 No bid will be rejected at the time of bid openning except for bids whose original bid security has not been provided to the procuring agency before bid submission deadline.

24. Clarification of Bids

24.1 To assist in the examination, evaluation and comparison of Bids of the Bidders, the respective Bid Evaluation Committee may, ask any Bidder for a clarification of its Bid including breakdown of prices.

24.2 The request for clarification and the response shall be sought through EPADS v2.0 before **three days prior to the deadline for submission of bids.** No change in the prices or substance of the Bids shall be sought, offered, or permitted.

24.3 The alteration or modification in the bids which in any way affect the following parameters will be considered as a change in the substance of a Bid:

1. evaluation & qualification criteria;
2. required scope of work or specifications;
3. all securities requirements;
4. tax requirements;
5. terms and conditions of Bidding documents.
6. change in the ranking of the Bidder

24.4 From the time of bid(s) opening to the time of Contract award if any Bidder wishes to contact the Procuring Agency on any matter related to the Bids it should do so through **EPADS v2.0**.

25. Preliminary Examination of Bids

25.1 Prior to the detailed evaluation of Bids, the respective Bid Evaluation Committee will determine whether each Bid:

1. meets the eligibility criteria defined in **ITB 3**;

2. has been prepared as per the format and contents defined by the Procuring Agency in the Bidding documents;

3. is accompanied by the required securities; and

4. is substantially responsive to the requirements of the Bidding documents.

25.2 The respective Bid Evaluation Committee's determination of a Bid's responsiveness will be based on the contents of the Bid itself.

25.3 A substantially responsive Bid is one which conforms to all the terms, conditions, and specifications of the Bidding documents, without material deviation or reservation. A material deviation or reservation is one that: -

1. affects in any substantial way the scope, quality, or performance of the Goods;

2. limits in any substantial way, inconsistent with the Bidding documents, the Procuring Agency's rights or the Bidders obligations under the Contract; or

3. if rectified, would affect unfairly the competitive position of other Bidders presenting substantially responsive Bids.

25.4 If a Bid is not substantially responsive, it will be rejected by the respective Bid Evaluation Committee and may not subsequently be evaluated for complete technical responsiveness.

26. Examination of Terms and Conditions; Technical Evaluation

26.1 The respective Bid Evaluation Committee shall examine the Bids to confirm that all terms and conditions specified in the **GCC** and the **SCC** have been accepted by the Bidder without any material deviation or reservation.

26.2 The respective Bid Evaluation Committee shall evaluate the technical aspects of the Bids submitted, to confirm that all requirements specified in Schedule of Requirements and Technical Specifications of the Bidding documents have been met without material deviation or reservation.

26.3 If after the examination of the terms and conditions and the technical evaluation, the respective Bid Evaluation Committee determines that the Bid is not substantially responsive in accordance with **ITB,** it shall reject the Bid.

27. Correction of Errors

27.1 Bids determined to be substantially responsive will be checked for any arithmetic errors. Errors will be corrected as follows: -

1. if there is a discrepancy between unit price and the total price that is obtained by multiplying the unit price and quantity, the unit price shall prevail, and the total price shall be corrected, unless in the opinion of the respective Evaluation Committee there is an obvious misplacement of the decimal point in the unit price, in which the total price as quoted shall govern and the unit price shall be corrected;

2. if there is an error in a total corresponding to the addition or subtraction of sub-totals, the sub-totals shall prevail and the total shall be corrected; and

3. where there is a discrepancy between the amounts in figures and in words, the amount in words will govern.

4. Where there is discrepancy between grand total of price schedule and amount mentioned on the Form of Bid, the amount referred in Price Schedule shall be treated as correct subject to elimination of other errors.

27.2 The amount stated in the Bid will be adjusted by the respective Bid Evaluation Committee in accordance with the above procedure for the correction of errors and, with the concurrence of the Bidder, shall be considered as binding upon the Bidder. If the Bidder does not accept the corrected amount, its Bid will then be rejected, and the Bid Security may be forfeited or the Bids Securing Declaration may be executed.

28. Conversion to Single Currency

28.1 For the purposes of comparison of bids quoted in different currencies, the price shall be converted into a single currency in accordance with Rule 42(2) of Public Procurement Rules,2026.

29. Evaluation of Bids

29.1 The Bids, quotations, or proposals shall be evaluated by the respective evaluation committees as per evaluation criteria prescribed in the Bidding Documents in accordance with Rule 11, 12 and 13 of the Public Procurement Rules, 2026.

29.2 While evaluating the bids, the procuring agency shall consider the following:

i. Bids will be evaluated on lump sum bid basis or items wise or Lot wise (contracts), as specified in the BDS; and the Bid Price;

ii. correction of arithmetic errors in accordance with ITB 27;

30. Domestic Preference

30.1 The respective Bid Evaluation Committee shall evaluate and compare bids, allow for preference to domestic bidders, while competing with the international bidders in accordance with the policies of the Federal Government.

The percentage of preference, to be accorded shall be clearly mentioned in the bidding documents under the bid evaluation criteria.

31. Determination of Successful Bid

31.1 **Selection technique will be adopted for determining the Successful Bid in accordance with the criteria referred in the BDS or prescribed in the separate section titled as Evaluation Criteria.**

31.2 **Least Cost Based Selection (LCBS)**
After meeting the requirements of eligibility, qualification and substantial responsiveness, the bid in compliance with all the mandatory (technical) specifications/requirements and/or requisite quality threshold (if any), and having lowest evaluated cost (or financial proposal) shall be considered Successful Bid.

31.3 **Quality and Cost Based Selection (QCBS)**
In such combination, there shall be some specific weightage of both the technical features and financial aspects of the proposal. The financial marks shall be awarded on the basis of inverse proportion calculations. The successful bid shall be declared, on the basis of combined evaluation.

31.4 **Quality Based Selection (QBS)**
After meeting the requirements of eligibility, qualification and substantial responsiveness the bid in compliance with all the mandatory (technical) specifications/requirements and attaining highest marks in the Technical Evaluation considering all other qualitative and/or quantitative parameters (or point rated criteria) for technical proposal(s) such as working methodology, implementation plan, resource allocation, additional functionalities, risk

management approach, knowledge transfer techniques, post implementation methodology etc. shall be treated as highest ranked bid. Later on, the financial proposal of highest ranked bidder shall be opened, however, in case of failure to proceed further with such a bidder, the procuring agency may resort to second highest bidder and so on.

31.5 The Procuring Agency may adopt the Quality & Cost Based Selection Technique due to the following two reasons:

1. Where the Procuring Agency knows about the main features, usage and output of the products; however not clear about the complete features, technical specifications and functionalities of the goods to be procured and requires the bidders to submit their proposals defining those features, specifications and functionalities; or

2. Where the Procuring Agency, in addition to the mandatory requirements and mandatory technical specifications, requires parameters specified in Evaluation Criteria to be evaluated while determining the quality of the goods.

31.6 In such cases, the Procuring Agency may allocate certain weightage to these factors as a part of Evaluation Criteria, and may determine the ranking of the bidders on the basis of combined evaluation in accordance with provisions of Rule 2(1)(xxviii) of the Public Procurement Rules, 2026.

32. Abnormally Low Financial Bids

32.1 An abnormally low bid is a bid that, in light of the Procuring Agency's cost estimate, market conditions, or other received bids, appears to be unrealistically low and may not be sustainable for successfull contract execution.

32.2 **Where the Bid price is considered to be abnormally low, the Procuring Agency shall perform price analysis either during determination of Successful Bids or as a part of the post-qualification process.**

32.3 The Procuring Agency may reject an Abnormally low financial bid in accordance with Rule 43 of the Public Procurement Rules, 2026.

32.4 In order to identify the Abnormally Low Bids (ALB) following approaches can be considered to minimize the scope of subjectivity:

1. Comparing the Bid price with the cost estimate;

2. Comparing the Bid price with the Bid(s) offered by other Bidders submitting substantially responsive Bids; and

3. Comparing the Bids price with prices paid in similar contracts in the recent past either government- or development partner-funded.

32.5 The respective Bid Evaluation Committee will determine to its satisfaction whether the Bidder that is selected as having submitted the successful bid is qualified to perform the contract satisfactorily.

32.6 The determination will take into account the Bidder's financial, technical, and production capabilities. It will be based upon an examination of the documentary evidence of the Bidder's qualifications submitted by the Bidder, as well as such other information as the Procuring Agency deems necessary and appropriate. Factors not included in these Bidding documents shall not be used in the evaluation of the Bidders' qualifications.

32.7 Respective Bid Evaluation Committee may seek "Certificate for Independent Price Determination" from the Bidder and the results of reference checks may be used in determining an award of contract.

Explanation: The Certificate shall be furnished by the Bidder. The Bidder shall certify that the price is determined keeping in view of all the essential aspects such as raw material, its processing, value addition, optimization of resources due to economy of scale, transportation, insurance and margin of profit etc.

32.8 An affirmative determination will be a prerequisite for award of the contract to the Bidder. A negative determination will result in rejection of the Bidder's Bid, in which event the respective Bid Evaluation Committee will proceed to the next ranked Bidder to make a similar determination of that Bidder's capabilities to perform satisfactorily.

F. Award of Contract

33. Criteria of Award

33.1 The Procuring Agency will award the Contract to the Bidder whose Bids has been determined to be substantially responsive to the Bidding documents and who has been declared as Successful Bidder.

34. Negotiations

34.1 In accordance with Rule 52A of Public Procurement Rules, 2026, without changing the cost and scope of work or services, the procuring agency may

negotiate with the successful bidder (with a view to streamline the work or task execution, at the time of contract finalization) on methodology, work plan, staffing and special conditions of the contract.

There shall be no limitation on the successful bidder offering voluntary reduction in bid price without affecting the quality or scope of the procurement.

35. Procuring Agency's Right to reject all bids

35.1 The Procuring Agency reserves the right to reject all bids or proposals at any time prior to the issuance of the Letter of Award, without incurring any liability, in accordance with Rule 45 of the Public Procurement Rules, 2026.

36. Cancellation of Procurement

36.1 The procuring agency reserves the right to cancel the procurement proceedings in accordance with Rule 46 of the Public Procurement Rules, 2026.

37. Procuring Agency’s Right to Vary Quantities at the Time of Award

37.1 The Procuring Agency reserves the right at the time of contract award to increase or decrease the **quantity of** Goods originally specified in these Bidding documents provided this does not exceed **by** 15%, without any change in unit price or other terms and conditions of the Bids and Bidding documents.

38. Notification of Award

38.1 Prior to the award of contract, the procuring agency shall announce and publish the result of bid evaluation on EPADS v2.0 in accordance with Rule 48 of the Public Procurement Rules, 2026.

The Bidder whose Bids has been accepted will be notified of the award by the Procuring Agency prior to expiration of the Bids/Bid Validity period. The Letter of Award will state the sum that the Procuring Agency will pay the successful Bidder in consideration for the delivery of Goods as prescribed by the Contract (hereinafter and in the Contract called the "Contract Price).

38.2 The Letter of award will constitute the formation of the Contract, subject to the Bidder furnishing the Performance Guarantee and signing of the contract.

39. Signing of Contract

39.1 Promptly after issuance of Letter of award, Procuring Agency shall send the successful Bidder the draft Contract, incorporating all terms and conditions as agreed by the parties to the contract.

39.2 Immediately after the Redressal of grievance by the GRC (if any), and **after fulfillment of all conditions precedent** of the Contract Form, the successful Bidder and the Procuring Agency shall sign the Contract.

40. Corrupt & Fraudulent Practices

40.1 Procuring Agencies (including beneficiaries of Government funded projects and procurement) as well as Bidders/Contractors under Government financed contracts, observe the highest standard of ethics during the procurement and execution of such contracts, and will avoid engaging in any corrupt and fraudulent practices.

F. Grievance Redressal & Complaint Review Mechanism

41. Constitution of Grievance Redressal Committee

41.1 The Grievance Redressal Committee shall address the grievance, if any submitted by any party, including the bidder, in accordance with Rule 65 of the Public Procurement Rules, 2026 read with Redressal of Grievances Regulations, 2021.

In case if any party or the bidder is not satisfied with the decision of the GRC or if it fails to decide within ten days, the bidder or the party may file an appeal before the Appellate Committee of the Authority in accordance with Rule 65(7) of the Public Procurement Rules, 2026 to be read with Redressal of Grievances Regulations, 2021.

G. Mechanism of Blacklisting

42. Mechanism of Blacklisting

42.1 The Procuring Agency shall initiate blacklisting proceedings against any bidder, supplier, or contractor in accordance with the Rule 25 of the Public Procurement Rules, 2026.

42.2 The blacklisted/debarred bidder may file the review petition before the Authority in accordance with Rule 25 (6) of the Public Procurement Rules, 2026 to be read with Procedure of filing and disposal of Review Petitions Regulations, 2021.

43. Contract Management

43.1 For each procurement, the Procuring Agency shall designate a Contract Manager, who shall be duly responsible for the efficient management and administration of the contract in strict compliance with the provisions set forth under Rules 58, 59, and 60 of the Public Procurement Rules, 2026.

44. Inspection of goods and evaluation of services.

44.1 The Inspection Committee or the Firm shall have the right to conduct inspections of the goods in accordance with Rule 61 of the Public Procurement Rules, 2026.

45. Socio-economic development.

45.1 In accordance with Rule 63 of the Public Procurement Rules, 2026, preference may be granted to small and medium enterprises and marginalized groups in accordance with the policies notified by the Federal Government.

46. Environmental objectives

46.1 As per Rule 64 of the Public Procurement Rules, 2026, the procuring agency may seek to procure goods with a reduced environmental impact throughout their life cycle when compared to goods services with the same primary function that may otherwise be procured.

Bid Data Sheet

Bids Data Sheet (BDS)

The following specific data for the procurement of Goods to be procured shall complement, supplement, or amend the provisions in the Instructions to Bidders (ITB). Whenever there is a conflict, the provisions herein shall prevail over those in ITB.

BDS Clause Number
ITB Number
Amendments of, and Supplements to, Clauses in the Instruction to Bidders

A. Introduction

BDS Clause Number 1
ITB Number 1.1

Name of Procuring Agency: **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA)**

The subject of procurement is: **Procurement of "132KV & 220KV Isolators alongwith essential spare parts for Allai Khwar Power Station" through Internnational Competitive Bidding (ICB) on FOB Basis**

Period for Provision of Goods:

Extension Period (if applicable):

Expected commencement date: **Thursday, May 27, 2027**

BDS Clause Number 2
ITB Number 2.1

Source of funds [Enter source of funds]

Financial year for the operations of the Procuring Agency: **2026-27**

Name and identification number of the Contract: **P69836**

Identification Number:

BDS Clause Number 3
ITB Clause Number 3.1

Eligible Bidder [Enter eligibility of bidder]

JV/Consortium or Association Allowed: **Yes**
Number of JV/Consortium Members: **3**
see section of eligibility criteria.

B. Bidding Documents

BDS Clause Number 4

ITB Clause Number 4.1

Eligible goods and related services [Enter requirements for eligible goods and related services, if any]

ITB Number 8.1

The Bidders may seek clarifications through **EPADS v2.0** : Clarification Date: Saturday, February 13, 2027

ITB Number 8.2

The Bidders may seek clarifications through **EPADS v2.0** : Clarification Date: Saturday, February 13, 2027

ITB Number 8.3

The Bidders may seek clarifications through **EPADS v2.0** : Clarification Date: Saturday, February 13, 2027

ITB Number 8.5

Pre-bid meeting will be/will not be held [Tick the appropriate] If yes write down the time, and date of the pre-Bid meeting:
[The meeting should take place not later than one weeks before the deadline for Bid submission.]

C. Preparation of Bids

BDS Clause Number 5
ITB Number 10.1

The Language of all correspondences and documents related to the Bids shall be in: **English**

List of documents required along with the bid:

1. Bid must be supported by suitable technical literature, manual and dimensional sketch/drawing elaborating function of each component; same is mandatory for technical evaluation. Successful bidder shall submit final drawing for vetting/approval before placing of PO.

BDS Clause Number 6
ITB Number 11.1

Documents required / not required with bid submission [enter list of documents] Samples required / not required with the bid [Enter the names and number of samples]

Items/Lots and their related documents:
See section items and Lots

BDS Clause Number 7
ITB Number 12.1

Items / Lots Specifications:

see section of items specifications.

BDS Clause Number 8
ITB Number 15.6

The price shall be **Fixed**.

BDS Clause Number 9
ITB Number 16.1

Currency of the Bids shall be : **PKR**

BDS Clause Number 10
ITB Number 17.1

The Bids/Bid Validity period shall be: **180 Days**

BDS Clause Number 11
ITB Number 18.1

The amount of Bid Security shall be as defined in Bid Security Section for items and lots given in **BDS 6**
Instrument of Bid Security shall be in the Name of : **Resident Engineer (O&M), Allai Khwar Power Station WAPDA ALLAI**
The Bid Security shall be in the form of: **Pay Order, Call at Deposit, Bank Guarantee**

ITB Number 18.2

The address for submission of original bid security is [Insert the address for bid security submission]

D. Submission of Bids

BDS Clause Number 12
ITB Number 20.1

Bid shall be submitted online on EPADS v2.0 whereas hard copy of the bid security should be submitted to the following;

Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). before bid submission deadline.

Bids that are not submitted on EPADS v2.0 shall be disqualified.

The deadline for Bids submission is: **Tuesday, February 16, 2027 11:00 AM**

Day *:* ***Tuesday***

Date: ***Tuesday, February 16, 2027***

Time *:* ***11:30 AM***

E. Opening and Evaluation of Bids

BDS Clause Number 13
ITB Number 23.1

The Bids opening shall take place on **EPADS v2.0**.

Day *:* ***Tuesday***

Date: ***Tuesday, February 16, 2027***

Time *:* ***11:30 AM***

ITB Number 29.2

The procuring agency shall consider the following:
lump sum bid basis; or
items wise; or
Lot wise (contracts),

ITB Number 30.1

BDS Clause Number 14
ITB Number 31.1

Domestic Preference [applicable / not applicable]

ITB Number 31.2

Selection technique adopted will be:
The Procuring Agency shall use any of the following evaluation techniques for determination of successful bid.

Least Cost Base Selection (LCBS)
Quality and Cost Based Selection (QCBS)
Quality Based Selection (QBS)
[Insert the Evaluation Technique]

Selection technique adopted will be: **Least Cost Based Selection (LCBS)**
see Evaluation Criteria

F. Review of Procurement Decisions

BDS Clause Number 15
ITB Number 41.1

Grievence against this procurement shall be submitted online on EPADS v2.0.

Arbitrator shall be appointed by mutual consent of the both parties.

ITB Number 42.2

The Address of PPRA Grievance Redressal Appellate Committee to submit a copy of grievance:

Grievance Redressal Appellate Committee,
Public Procurement Regulatory Authority
1st Floor, G-5/2, Islamabad, Pakistan
Tel: +92-51-9202254

Eligibility Criteria

Eligible Bidders: Partnership Firm, Company (Private Limited), Company (Public Limited), Company (Holding Company), Company (Limited by Guarantee), State Owned Enterprise (Private Limited), State Owned Enterprise (Public Limited)

Required Registration
FBR (NTN)
FBR (GSTN)
SECP

Eligibility Criteria	Document
The local bidder must have Authorization letter by the foreign principal (Original Equipment Manufacturer).	Yes
The local bidder must submit the proforma invoice of the OEM and warranty certificate issued by OEM.	Yes
The supplier shall give website and email address of the equipment manufacturer for the verification/authentication	Yes
The bid shall be considered non-responsive, in case of downloading the certificates from website using jugglery of cutting and pasting from internet.	No

Evaluation Criteria

Eligibile bidder(s) with substantially responsive bid(s) offering **Least Cost Based Selection (LCBS)** shall be consider for the award of contract(s).

Least Cost Based Selection (LCBS)

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Items/Lots

Lot Title : Procurement of Islolators for 132/220 KV Switchyard

Bid Security : 2200000 PKR

Item	UNSPSC	Delivery Schedule	Quantity	Manufacturer / Dealer Authorization	Warranty
Isolator for 220 KV Switchyard without earth switch coulped	Isolators	**Address:** Resident Engineer (O&M), Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Isolator for 220 KV Switchyard with earth switch coulped	Isolators	**Address:** Resident Engineer (O&M), Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months

Item	UNSPSC	Delivery Schedule	Quantity	Manufacturer / Dealer Authorization	Warranty
Isolator for 132KV Switchyard without earth switch coulped	Isolators	**Address:** Resident Engineer (O&M), Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Isolator for 132 KV Switchyard with earth switch coulped	Isolators	**Address:** Resident Engineer (O&M), Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Complete operating mechanism for 220 KV Isolator without earth switch coulped	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months

PUBLIC PROCUREMENT REGULATORY AUTHORITY PPRA EPADS

Item	UNSPSC	Delivery Schedule	Quantity	Manufacturer / Dealer Authorization	Warranty
Complete operating mechanism for 220 KV Isolator with earth switch coulped	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Spring Charge Motor for 220 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/Qty	2 / Qty	Manufacturer Authorization form	18 Months
Complete operating mechanism for 132 KV Isolator without earth switch coulped	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months

Item	UNSPSC	Delivery Schedule	Quantity	Manufacturer / Dealer Authorization	Warranty
Complete operating mechanism for 132 KV Isolator with earth switch coulped	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Spring Charge Motor for 132 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/Qty	2 / Qty	Manufacturer Authorization form	18 Months
Thermal overload relay / Breaker for 132 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months

PUBLIC PROCUREMENT REGULATORY AUTHORITY PPRA EPADS

Item	UNSPSC	Delivery Schedule	Quantity	Manufacturer / Dealer Authorization	Warranty
Auxiliary contacts Pack for 132 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Insulator for 132 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Thermal overload relay / Breaker for 220 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months

PUBLIC PROCUREMENT REGULATORY AUTHORITY PPRA EPADS

Item	UNSPSC	Delivery Schedule	Quantity	Manufacturer / Dealer Authorization	Warranty
Auxiliary contacts Pack for 220 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months
Insulator for 220 KV Isolator	Isolators	**Address:** Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province). **Schedule:** 120 days after opening of irrevocable letter of Credit **Quantity:** 2/set	2 / set	Manufacturer Authorization form	18 Months

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Related Services of Goods:

No

Items/Lot Specification

Lot Title : Procurement of Islolators for 132/220 KV Switchyard

Item: Isolator for 220 KV Switchyard without earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Isolator for 220 KV Switchyard without earth switch coulped (1) 245KV Isolator Type: CBD 245 - 2000, (2) Manufacturer: Coelme, (3) Number of Pole : 3, (4) Class: 25 mm / kV = 6125 mm creepage distance (III anti-plution type), (5) Rated voltage: 245KV, (6) Rated impulse withstand voltage to earth 1050 KV Peak, (7) Rated impulse withstand voltage to across the isolating distance 1200 KV Peak, (8) Rated one minute power frequency withstand voltage, dry and wet to earth 460 KV, (9) Rated one minute power frequency withstand voltage, dry and wet to across the isolating distance 530 KV, (10) Rated frequency 50Hz, (11) Rated normal current 2000A, (12) Rated short-time withstand current 1s: 40 KA arms, (13) Maximum service voltage: 245KV, (14) Rated dynamic current 100 KA Peak, (15) Maximum temperature rise of current carrying parts at rated current 65 deg centigrade, (16) Number of aux. contacts 6NO + 6NC, 220VDC, (17) Operating mechanism : Manual + Motor, (18) Detailed technical specifications and drawings are attached at annexure.

Item: Isolator for 220 KV Switchyard with earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Isolator for 220 KV Switchyard with earth switch coupled, (1) 245KV Isolator Type: CBD 245 - 2000, (2) Manufacturer: Coelme, (3) Number of Pole : 3, (4) Class: 25 mm / kV = 6125 mm creepage distance (III anti-plution type), (5) Rated voltage: 245KV, (6) Rated impulse withstand voltage to earth 1050 KV Peak, (7) Rated impulse withstand voltage to across the isolating distance 1200 KV Peak, (8) Rated one minute power frequency withstand voltage, dry and wet to earth 460 KV, (9) Rated one minute power frequency withstand voltage, dry and wet to across the isolating distance 530 KV, (10) Rated frequency 50Hz, (11) Rated normal current 2000A, (12) Rated short-time withstand current 1s: 40 KA arms, (13) Maximum service voltage: 245KV, (14) Rated dynamic current 100 KA Peak, (15) Maximum temperature rise of current carrying parts at rated current 65 deg centigrade, (16)

Number of aux. contacts 6NO + 6NC, 220VDC, (17) Operating mechanism: Manual + Motor. (18) 245 kV Earthing Switches built on disconnector: Manfucturer: Coelme, (19) Class: III (anti-pollution type), (20) Rated voltage 245KV, (21) Rated impulse withstand voltage to earth 1050 KV Peak, (22) Rated one minute power frequency withstand voltage, dry and wet to earth 460 KV, (23) Rated Frequency 50Hz, (24) Rated short-time withstand current 1s: 40 KA rms, (25) Number of aux. contacts 4NO + 4NC, 220VDC, (26) Operating mechanism : Manual + Motor, (27) Detailed technical specifications and drawings are attached at annexure.

Item: Isolator for 132KV Switchyard without earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Isolator for 132KV Switchyard without earth switch coupled, (1) 145KV Isolator Type: CBD 145 - 2000, (2) Manufacturer: Coelme, (3) Number of Pole : 3, (4) Class: 25 mm / kV = 3625 mm creepage distance (III anti-plution type), (5) Rated voltage: 132KV, (6) Rated impulse withstand voltage to earth 650 KV Peak, (7) Rated impulse withstand voltage to across the isolating distance 750 KV Peak, (8) Rated one minute power frequency withstand voltage, dry and wet to earth 650 KV rms, (9) Rated one minute power frequency withstand voltage, dry and wet to across the isolating distance 750 KV rms, (10) Rated frequency 50Hz, (11) Rated normal current 2000A, (12) Rated short-time withstand current 1s: 40 ~ 50 KA arms, (13) Maximum service voltage 145KV, (14) Rated dynamic current 100 ~ 145 KA Peak, (15) Maximum temperature rise of current carrying parts at rated current 65 deg centigrade, (16) Number of aux. contacts 6NO + 6NC, 220 VDC, (17) Operating mechanism: Manual + Motor.

Item: Isolator for 132 KV Switchyard with earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Isolator for 132 KV Switchyard with earth switch coupled (1) 145 KV Isolator Type: CBD 145 - 2000, (2) Manufacturer: Coelme, (3) Number of Pole : 3, (4) Class: 25 mm / kV = 3625 mm creepage distance (III anti-plution type), (5) Rated voltage: 132KV, (6) Rated impulse withstand voltage to earth 650 KV Peak, (7) Rated impulse withstand voltage to across the isolating distance 750 KV Peak, (8) Rated one minute power frequency withstand voltage, dry and wet to earth 650 KV rms, (9) Rated one minute power frequency withstand voltage, dry and wet to across the isolating distance 750 KV rms, (10) Rated frequency 50Hz, (11) Rated normal current 2000A, (12) Rated short-time withstand current 1s: 40 ~ 50 KA arms, (13) Maximum service voltage 145KV, (14) Rated dynamic current 100 ~ 145 KA Peak, (15) Maximum temperature rise of current carrying parts at rated current 65 deg centigrade, (16) Number of aux. contacts 6NO + 6NC, 220 VDC, (17) Operating mechanism : Manual + Motor, (18) 145 kV Earthing Switches built on disconnector: Manufacturer: Coelme, (19)

Class: III (anti-pollution type), (20) Rated voltage 132KV, (21) Rated impulse withstand voltage to earth 650 KV Peak, (22) Rated impulse withstand voltage across the isolating distance 315 KV Peak, (23) Rated one minute power frequency withstand voltage, dry and wet to earth 650 KV rms, (24) Rated one minute power frequency withstand voltage, dry and wet to across the isolating distance 750 KV rms, (25) Rated Frequency 50Hz, (26) Rated short-time withstand current 1s: 40 ~ 50 KA arms, (27) Number of aux. contacts 4NO + 4NC, 220VDC, (28) Operating mechanism : Manual + Motor.

Item: Complete operating mechanism for 220 KV Isolator without earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Complete operating mechanism for 220 KV Isolator without earth switch coulped (Additional Spare)

Item: Complete operating mechanism for 220 KV Isolator with earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Complete operating mechanism for 220 KV Isolator with earth switch coulped (Additional Spare)

Item: Spring Charge Motor for 220 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Spring Charge Motor for 220 KV Isolator (Additional Spare)

Item: Complete operating mechanism for 132 KV Isolator without earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Complete operating mechanism for 132 KV Isolator without earth switch coulped (Additional Spare)

Item: Complete operating mechanism for 132 KV Isolator with earth switch coulped

UNSPSC: Isolators

Specifications / Requirements:

Complete operating mechanism for 132 KV Isolator with earth switch coulped (Additional Spare)

Item: Spring Charge Motor for 132 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Spring Charge Motor for 132 KV Isolator (Additional Spare)

Item: Thermal overload relay / Breaker for 132 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Thermal overload relay for 132 KV Isolator (Additional Spare)

Item: Auxiliary contacts Pack for 132 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Auxiliary contacts Pack for 132 KV Isolator (Additional Spare)

Item: Insulator for 132 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Insulator for 132 KV Isolator (Additional Spare)

Item: Thermal overload relay / Breaker for 220 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Thermal overload relay / Breaker for 220 KV Isolator (Additional Spare)

Item: Auxiliary contacts Pack for 220 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Auxiliary contacts Pack for 220 KV Isolator (Additional Spare)

Item: Insulator for 220 KV Isolator

UNSPSC: Isolators

Specifications / Requirements:

Auxiliary contacts Pack for 220KV Isolator (Additional Spare)

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Price Schedule

For Individual Items

#	Item Title	Quantity	Unit Price (PKR)	Total Price (PKR)	Delivery Location	Delivery Period / Year	Country of Origin
1							
2							

For Lots

#	Lot Title	Total Lot Price (PKR)	Country of Origin
1	[Lot 1 Title]		

Lots Media

Lot Title : Procurement of Islolators for 132/220 KV Switchyard

Item: Isolator for 220 KV Switchyard without earth switch coulped



Item: Isolator for 220 KV Switchyard with earth switch coulped



Item: Isolator for 132KV Switchyard without earth switch coulped



Item: Isolator for 132 KV Switchyard with earth switch coulped



PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

PUBLIC PROCUREMENT REGULATORY AUTHORITY
(PPRA)
EPADS

General Conditions of Contract

A. General

1. Definitions

1.1 Unless the context otherwise requires, the following terms whenever used in this Contract shall have the same meaning and shall be interpreted as indicated

a. “Applicable Law” means the laws and any other instruments having the force of law in the Government’s Country, or in such other country as may be specified in the Special Conditions of the Contract (SC), as they may be issued and in force from time to time;

b. The “Arbitrator” is the person appointed with mutual consent of both the parties, to resolve contractual disputes as provided for in the General Conditions of the Contract GCC Clause 35 hereunder.

c. “Authority” means Public Procurement Regulatory Authority.

d. The “Commencement Date” is the date when the Supplier shall commence execution of the contract as specified in the SCC.

e. “Completion date” means the date of completion of the Contract by the Bidder as certified by the Procuring Agency.

f. “Procuring Agency” means:-

a. any Ministry, Division, Department or any Office of the Government;

b. any authority, corporation, body or organization established by or under a Law or which is owned or controlled by the Government;.

g. “The Contract” means an agreement enforceable by law;

h. “The Contract Price” means the price payable to the Bidder under the Contract for the full and proper performance of its contractual obligations;

i. “Ancillary Services” means those services ancillary to the provision of Goods, such as transportation and insurance, and any other incidental services, such as installation, commissioning, provision of technical assistance, training, and other such obligations of the Bidder covered under the Contract;

j. “GCC” means the General Conditions of Contract contained in this section;

k. “SCC” means the Special Conditions of Contract by which the GCC may be amended or supplemented;

l. **“**Day” means calendar day unless indicated otherwise.

m. “Defective Goods” are those goods which are below standards, requirements or specifications stated by the Contract.

n. “Delivery” means the transfer of the goods from the supplier equipment, machinery, and /or other materials which the Supplier is required to supply to the Procuring Agency under Contract.

o. “Effective Date” means the date on which this Contract comes into force and effect.

p. “Force Majeure” means an unforeseeable event which is beyond reasonable control of either Party and which makes a Party’s performance of its obligations under the Contract impossible or so impractical as to be considered impossible under the circumstances.

For the purposes of this Contract, “Force Majeure” means an event which is beyond the reasonable control of a Party, is not foreseeable, is unavoidable, and its origin is not due to negligence or lack of care on the part of a Party, and which makes a Party’s performance of its obligations hereunder impossible or so impractical as reasonably to be considered impossible in the circumstances. and includes, but is not limited to, war, riots, civil disorder, earthquake, fire, explosion, storm, flood, epidemics, or other adverse weather conditions, strikes, lockouts or other industrial action (except where such strikes, lockouts or other industrial action are within the power of the Party invoking Force Majeure to prevent), confiscation or any other action by Government agencies.

q. The Bidder” means the individual or corporate body whose Bids to provide the Goods has been accepted by the Procuring Agency;

r. “The Project Site,” where applicable, means the place or places named in Bids Data Sheet and technical Specifications;

s. “Government” means the Government of Pakistan;

t. “Subcontractor” means any entity to which the Bidder subcontracts any part of the Goods.

u. The “Services” means the work to be performed by the Bidder pursuant to this Contract and as prescribed in the Specifications and Schedule of Activities included in the Bidder’s Bids;

v. “Party” means the Procuring Agency or the Bidder, as the case may be, and “Parties” means both of them;

w. “Foreign Currency” means any currency other than the currency of the country of the Procuring Agency;

x. “Completion Date” means the date of completion of the contract by the Bidder as certified by the Procuring Agency;

y. “In Writing” means communicated in written form with proof of receipt;

z. “Local Currency” means the currency of Pakistan;

a. “Origin” means the place where the Goods were mined, grown, or produced or from which the Services are supplied. Goods are produced when, through manufacturing, processing, or substantial and major assembly of components, a commercially recognized new produce results that is substantially different in basic characteristics or in purpose or utility from its components.

b. “Specification” means the Specification of the Goods and performance of incidental services in accordance with the relevant standards included in the Contract and any modification or addition made or approved by the Procuring Agency.

c. “Procuring Agency” means: -
any Ministry, Division, Department or any Office of the Federal Government;
any authority, corporation, body or organization established by or under a Federal Law or which is owned or controlled by the Federal Government;

2. Application and Interpretation

2.1 These General Conditions shall apply to the extent that they are not superseded by provisions of other parts of the Contract.

2.2 In interpreting these Conditions of Contract headings and marginal notes are used for convenience only and shall not affect their interpretations unless specifically stated; references to singular include the plural and vice versa; and masculine include the feminine. Words have their ordinary meaning under the language of the Contract unless specifically defined.

3. Applicable Law

3.1 The contract shall be governed and interpreted in accordance with the laws of Pakistan, unless otherwise specified in SCC.

4. Governing Language

4.1 The Contract as well as all correspondence and documents relating to the Contract exchanged between the Bidder and the Procuring Agency, shall be written in the **English language** unless otherwise stated in the **SCC**. Supporting documents and printed literature that are part of the Contract may be in another language provided these are accompanied by an accurate translation of the relevant passages in English, in which case, for purposes of interpretation of the Contract, this translation shall govern.

5. Notices

5.1 Any notice, request, or consent made pursuant to this Contract shall be in writing and shall be deemed to have been made when delivered in person to an authorized representative of the Party to whom the communication is addressed, or when sent by registered mail, telex, telegram, or facsimile to such Party at the address specified in the **SCC**.

6. Standard

6.1 The Goods supplied under this Contract shall conform to the standards mentioned in the Technical Specifications, and, when no applicable standard is mentioned, the American Standards (such as ACI, IEEE, ASME, etc.) or the Pakistani standards such as PSQCA Such standards shall be the latest issued by the concerned institution.

7. Delivery/Location

7.1 The Goods shall be delivered to such locations as the Procuring Agency may approve and as specified in SCC.

8. Authorized Representatives / Authority of Member in charge

8.1 Any action required or permitted to be taken, and any document required or permitted to be executed, under this Contract by the Procuring Agency or the Bidder may be taken or executed by the officials specified in the **SCC**.

B. Commencement, Completion, Modification, and Termination of Contract

8. Effectiveness of Contract

8.1 This Contract shall come into effect on the date the Contract is signed by both parties and such other later date as may be stated in the SCC.

9. Commencement of the Contract

9.1 The Bidder shall confirm availability of Key Experts and begin carrying out the Services not later than the number of days after the Effective Date specified in the SCC.

10. Program

10.1 Before commencement of the Contract, the Bidder shall submit to the Procuring Agency for approval a Program showing the general methods, arrangements, order and timing for all activities. The Services shall be carried out in accordance with the approved Program as updated.

11. Starting Date/Expiration Date

11.1 The Bidder shall start carrying out the Services Five (05) days after the date the Contract becomes effective, or at such other date as may be specified in the **SCC.**

11.2 Unless terminated earlier pursuant to Clause **GCC 16** hereof, this Contract shall expire at the end of such time period after the Effective Date as specified in the SCC.

12. Entire Agreement

12.1 This Contract contains all covenants, stipulations and provisions agreed by the Parties. No agent or representative of either Party has authority to make, and the Parties shall not be bound by or be liable for, any statement, representation, promise or agreement not set forth herein.

13. Modification

13.1 Any modification or variation of the terms and conditions of this Contract, including any modification or variation of the scope, may only be made by written agreement between the Parties. However, each Party shall give due consideration to any Bids for modification or variation made by the other Party.

13.2 In cases of any modifications or variations, the prior written consent of the Procuring Agency is required.

14. Force Majeure

14.1 Definition

For the purposes of this Contract, "Force Majeure" means an event which is beyond the reasonable control of a Party and which makes a Party's performance of its obligations under the Contract impossible or so impractical as to be considered impossible under the circumstances.

14.2 No Breach of Contract

The failure of a Party to fulfill any of its obligations under the contract shall not be considered to be a breach of, or default under, this Contract in so far as such inability arises from an event of Force Majeure, provided that the Party affected by such an event (a) has taken all reasonable precautions, due care and reasonable alternative measures in order to carry out the terms and conditions of this Contract, and (b) has informed the other Party as soon as possible about the occurrence of such an event.

14.3 Extension of Time

Any period within which a Party shall, pursuant to this Contract, complete any action or task, shall be extended for a period equal to the time during which such Party was unable to perform such action as a result of Force Majeure. However, such period shall not exceed sixty (60) days.

14.4 Payments

During the period of their inability to perform the Services as a result of an event of Force Majeure, the Bidder shall be entitled to continue to be paid under the terms of this Contract, as well as to be reimbursed for additional costs reasonably and necessarily incurred by them during such period for the purposes of the Services and in reactivating the Service after the end of such period.

15. Termination

15.1 By the Procuring Agency

The Procuring Agency may terminate this Contract in case of the occurrence of any of the events specified in paragraphs (a) through (e) of this Clause. In such an occurrence the Procuring Agency shall give at least thirty (30) calendar days' written notice of termination to the Bidder in case of the events referred to in (a) through (d); at least sixty (60) calendar days' written notice in case of the event referred to in (e);

a. If the Bidder fails to remedy a failure in the performance of its obligations hereunder, as specified in a notice of suspension;

b. If the Bidder becomes (or, if the Bidder consists of more than one entity, if any of its members becomes) insolvent or bankrupt or enter into any agreements with their creditors for relief of debt or take advantage of any law for the benefit of debtors or go into liquidation or receivership whether compulsory or voluntary;

c. If the Bidder fails to comply with any final decision reached as a result of arbitration proceedings;

d. If, as the result of Force Majeure, the Bidder is unable to perform a material portion of the Services for a period of not less than sixty (60) calendar days;

e. If the Procuring Agency, in its sole discretion and for any reason whatsoever, decides to terminate this Contract;

15.2 By the Bidder

The Bidder may terminate this Contract, by not less than thirty (30) calendar days' written notice to the Procuring Agency, in case of the occurrence of any of the events specified in paragraphs (a) through (d) of this Clause.

a. If the Procuring Agency fails to pay any money due to the Bidder pursuant to this Contract and not subject to dispute within forty-five (45) calendar days after receiving written notice from the Bidder that such payment is overdue.

b. If, as the result of Force Majeure, the Bidder is unable to perform a material portion of the Services for a period of not less than sixty (60) calendar days.

c. If the Procuring Agency fails to comply with any final decision reached as a result of arbitration.

d. If the Procuring Agency is in material breach of its obligations pursuant to this Contract and has not remedied the same within forty-five (45) days (or such longer period as the Bidder may have subsequently approved in writing) following the receipt by the Procuring Agency of the Bidder's notice specifying such breach.

C. Obligations of the Bidder

16. General

16.1 Standard of Performance

1. The Bidder shall deliver the product and carry out the Services with all due diligence, efficiency and economy, in accordance with generally accepted professional standards and practices, and shall observe sound management practices, and employ appropriate technology and safe and effective equipment, machinery, materials and methods. The Bidder shall always act, in respect of any matter relating to this Contract or to the Services, as a faithful adviser to the Procuring Agency, and shall at all times support and safeguard the Procuring Agency's legitimate interests in any dealings with the third parties.

16.2 Law Applicable to Goods

The Bidder shall deliver the goods in accordance with the Contract and in accordance with the Law of Pakistan and shall take all practicable steps to ensure that any of its Experts and Sub-Bidders, comply with the Applicable Law.

17. Conflict of Interests

17.1 Bidder Not to Benefit from Commissions and Discounts.

The remuneration of the Bidder shall constitute the Bidder's sole remuneration in connection with this Contract or the Services, and the Bidder shall not accept for their own benefit any trade commission, discount, or similar payment in connection with activities pursuant to this Contract or to the Services or in the discharge of their obligations under the Contract, and the Bidder shall use their best efforts to ensure that the Personnel, any Subcontractors, and agents of either of them similarly shall not receive any such additional remuneration.

17.2 Bidder and Affiliates Not to be Otherwise Interested in Project

The Bidder agree that, during the term of this Contract and after its termination, the Bidder and its affiliates, as well as any Subcontractor and any of its affiliates, shall be disqualified from providing Goods for any project resulting from or closely related to the Services.

17.3 Prohibition of Conflicting Activities

Neither the Bidder nor its Subcontractors nor the Personnel shall engage, either directly or indirectly, in any of the following activities:

a. during the term of this Contract, any business or professional activities in the Government's country which would conflict with the activities assigned to them under this Contract;

b. during the term of this Contract, neither the Bidder nor their Subcontractors shall hire public employees in active duty or on any type of leave, to perform any activity under this Contract;

18. Confidentiality

18.1 Except with the prior written consent of the Procuring Agency, the Bidder and the Experts shall not at any time communicate to any person or entity any confidential information acquired in the course of the contract.

19. Insurance to be Taken Out by the Bidder

19.1 The Bidder(a) shall take out and maintain, and shall cause any Subcontractors to take out and maintain, at its (or the Subcontractors', as the case may be) own cost but on terms and conditions approved by the Procuring Agency, insurance against the risks, loss or damage, and for the coverage, as shall be specified in the SCC; and (b) at the Procuring Agency's request, shall provide evidence to the Procuring Agency showing

that such insurance has been taken out and maintained and that the current premiums have been paid.

20. Bidder's Actions Requiring Procuring Agency's Prior Approval

20.1 The Bidder shall obtain the Procuring Agency's prior approval in writing before taking any of the following actions:

(a) appointing such members of the Personnel not provided by the Bidder;

(b) changing the Program of activities; and

(c) any other action that may be specified in the SCC.

21. Reporting Obligations

21.1 The Bidder shall submit to the Procuring Agency the reports and documents in the numbers, and within the periods as prescribed by the Procuring Agency.

22. Liquidated Damages

22.1 If the Supplier fails to deliver any or all of the Goods or to perform the Services within the period(s) specified in the Contract, the Procuring Agency shall, without prejudice to its other remedies under the Contract, deduct from the Contract Price, as liquidated damages, a sum equivalent to the percentage specified in **SCC** of the delivered price of the delayed Goods or unperformed Services for each week or part thereof of delay until actual delivery or performance, up to a maximum deduction of the performance security (or guarantee) specified in **SCC**. Once the said maximum is reached, the Procuring Agency may consider termination of the Contract pursuant to **GCC Clause 16.**

22.2 Correction for Over-payment

If the Intended Completion Date is extended after liquidated damages have been paid, the Procuring Agency shall correct any overpayment of liquidated damages by the Bidder by adjusting the next payment certificate. The Bidder shall be paid interest on the overpayment, calculated from the date of payment to the date of repayment, at the rates specified in SCC.

22.3 Lack of performance penalty

If the Bidder has not corrected a Defect within the time specified in the Procuring Agency's notice, a penalty for Lack of performance will be paid by the Bidder. The amount to be paid will be calculated as a percentage of the cost of having the Defect corrected, assessed as specified in the SCC.

23. Performance Guarantee

23.1 The Performance Security (or Guarantee) shall be provided to the Procuring Agency no later than the date specified in the Letter of Acceptance and shall be issued in an amount and form acceptable to the Procuring Agency as specified in SCC, and denominated in the types and proportions of the currencies in which the Contract Price is payable as specified in the SCC.

23.2 Within Seven (07) days from the issuance of acceptance letter from the Procuring Agency, the successful Bidder shall furnish the Performance Guarantee in shape of ------- at the discretion of the PA in the amount **specified in SCC.** In case the amount of Bids security is equal or greater than

23.3 The proceeds of the Performance Guarantee shall be payable to the Procuring agency as compensation for any loss resulting from the Supplier's failure to complete its obligations under the Contract.

23.4 The Performance Guarantee shall be denominated in the currency of the Contract, or in a freely convertible currency acceptable to the Procuring agency and shall be in the acceptable form as specified in SCC.

23.5 The Performance Guarantee will be discharged by the Procuring agency and returned to the Supplier not later than thirty (30) days following the date of completion of the Supplier's performance obligations under the Contract, including any warranty obligations, unless otherwise **specified in SCC.**

23.6 The bid security of the successful bidder shall not be substituted with the Performance Guarantee.

24. Fraud and Corruption

24.1 The Procuring Agency requires the Supplier to disclose any commissions or fees that may have been paid or are to be paid to agents or any other party with respect to the Bidding process or execution of the Contract. The information disclosed must include at least the name and address of the agent or other party, the amount and currency, and the purpose of the commission, gratuity or fee.

25. Sustainable Procurement

25.1 The Bidder shall conform to the sustainable procurement contractual provisions, if and as specified in the SCC.

D. Bidder's Personnel

26. Description of Personnel

26.1 The titles, agreed job descriptions, minimum qualifications, and estimated periods of engagement in the carrying out of the Services of the Bidder's Key Personnel. The Key Personnel listed by title as well as by name are hereby approved by the Procuring Agency.

27. Removal and/or Replacement of Personnel

27.1 Except as the Procuring Agency may otherwise agree, no changes shall be made in the Key Personnel. If, for any reason beyond the reasonable control of the Bidder, it becomes necessary to replace any of the Key Personnel, the Bidder shall provide as a replacement a person of equivalent or better qualifications.

27.2 If the Procuring Agency finds that any of the Personnel have (i) committed serious misconduct or have been charged with having committed a criminal action, or (ii) have reasonable cause to be dissatisfied with the performance of any of the Personnel, then the Bidder shall, at the Procuring Agency's written request specifying the grounds thereof, provide as a replacement a person with qualifications and experience acceptable to the Procuring Agency.

27.3 The Bidder shall have no claim for additional costs arising out of or incidental to any removal and/or replacement of Personnel.

E. Obligations of the Procuring Agency

28. Assistance and Exemptions

28.1 The Procuring Agency shall use its best efforts to ensure that the Government shall provide the Bidder such assistance and exemptions as specified in the SCC.

29. Change in the Applicable Law

29.1 If, after the date of this Contract, there is any change in the Applicable Law with respect to taxes and duties which increases or decreases the cost of the related Services rendered by the Bidder, then the remuneration and reimbursable expenses otherwise payable to the Bidder under this Contract shall be increased or decreased accordingly by agreement between the Parties, and corresponding adjustments shall be made to the amounts referred in the SCC.

30. Services and Facilities

30.1 The Procuring Agency shall make available to the Bidder and the Experts, for the purposes of the Services and free of any charge, the services, facilities and property described , at the times and in the manner specified in the SCC or terms of reference.

30.2 In case that such services, facilities and property shall not be made available to the Bidder, the Parties shall agree on (i) any time extension that it may be appropriate to grant to the Bidder for the performance of the Services, (ii) the manner in which the Bidder shall procure any such services, facilities and property from other sources, and (iii) the additional payments, if any, to be made to the Bidder as a result thereof.

F. Payments to the Bidder

31. Contract Price

31.1 The price payable shall be in Pakistani Rupees unless otherwise specified in the SCC. Prices charged by the Supplier for Goods delivered under the Contract shall not vary from the prices quoted by the Supplier in its Bid.

32. Terms and Conditions of Payment

32.1 Payments will be made to the Bidder according to the payment schedule stated in the SCC and as per actual invoice submitted by the Bidder.

32.2 Unless otherwise stated in the SCC, the advance payment shall be made against the provision by the Bidder of a bank guarantee for the same amount, and shall be valid for the period stated in the SCC. Any other payment shall be made after the conditions listed in the SCC for such payment have been met, and the Bidder have submitted an invoice to the Procuring Agency specifying the amount due.

33. Currency of Payment

33.1 Any payment under this Contract shall be made in the currency(ies) specified in the SCC.

G. Quality Control

34. Identifying Defects

34.1 The principle and modalities of Inspection of the Goods by the Procuring Agency shall be as indicated in the SCC. The Procuring Agency shall check the Bidder’s performance and notify him of any Defects that are found. Such checking shall not affect the Bidder’s responsibilities. The Procuring Agency may instruct the Bidder to search for a Defect and to uncover and test any service that the Procuring Agency considers may have a Defect. Defect Liability Period is as defined in the SCC.

35. Correction of Defects, and

Lack of Performance Penalty

35.1 The Procuring Agency shall give notice to the Bidder of any Defects before the end of the Contract. The Defects liability period shall be extended for as long as Defects remain to be corrected.

35.2 Every time notice a Defect is given, the Bidder shall correct the notified Defect within the length of time specified by the Procuring Agency's notice.

35.3 If the Bidder has not corrected a Defect within the time specified in the Procuring Agency's notice, the Procuring Agency will assess the cost of having the Defect corrected, the Bidder will pay this amount, and a Penalty for Lack of Performance.

36. Taxes and Duties

36.1 A Supplier shall be entirely responsible for all taxes, duties, fees, etc., incurred until delivery of the contracted Goods to the Procuring Agency.

H. Settlement of Disputes

37. Alternate Dispute Resolution

37.1 Upon the commencement of the Procurement Contract, any disputes arising between the contracting parties shall be resolved in accordance with Rule 66 of the Public Procurement Rules, 2026.

37.2 The procuring agency may refer the matter to the Chief Justice Islamabad High Court or Managing Director PPRA or the Secretary Ministry of Law & Justice for appointment of Arbitrator.

37.3 The fee for the Arbitrator shall be specified in Pak Rupees as determined by the appointing authority which shall be borne and shared equally by the contracting parties.

38. Change Orders

The Procuring Agency may at any time, by a written order given to the Supplier, make changes within the general scope of the Contract in any one or more of the following:

a)Drawings, designs, or specifications, where Goods to be furnished under the Contract are to be specifically manufactured for the Procuring Agency;
b)The method of shipment or packing;
c)The place of delivery; and/or
d)The Services to be provided by the Supplier.

39. Contract Amendenments

39.1 Subject to GCC Clause 32, no variation in or modification of the terms of the Contract shall be made except by written amendment signed by the parties.

40. Sub-Contracts

40.1 The Supplier shall consult the Procuring Agency in the event of subcontracting under this contract if not already specified in the Bid. Subcontracting shall not alter the Supplier's obligations.

Special Conditions of Contract

SECTION VIII. SPECIAL CONDITIONS OF CONTRACT

The following Special Conditions of Contract shall supplement the General Conditions of Contract. Whenever there is a conflict, the provisions herein shall prevail over those in the Conditions of Contract. The corresponding clause number of the GCC is indicated in parentheses.

Number of GC Clause

Amendments of, and Supplements to, Clauses in the General Conditions of Contract

Number of GC Clause 1

Definitions

The Procuring Agency is: **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).**

The Supplier is:

The title of the subject procurement is: **Procurement of "132KV & 220KV Isolators alongwith essential spare parts for Allai Khwar Power Station" through Internnational Competitive Bidding (ICB) on FOB Basis**

Number of GC Clause 3

Applicable/Governing Law:

The Contract shall be interpreted in accordance with the laws of Islamic Republic of Pakistan

Number of GC Clause 4

Language:

The language of the Contract, all correspondence and communications to be given, and all other documentation to be prepared and supplied under the Contract shall be in **English.**

Number of GC Clause 5

Notices:

The addresses for the notices are:

The Authority:

Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer
Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).
+92-347-409-7358
reakph@gmail.com

Contractor/ Bidder:

[Name, address and telephone number].

The Contractor/ Bidder's Representative(s)

[Name, address, telephone number and e-mail address]

Number of GC Clause 7.1

The Authorized Representatives are:

For the Procuring Agency:

Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer
Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).
+92-347-409-7358
reakph@gmail.com

For the Bidder:

Name: ……

Designation: ……..

Address: ……..

Number of GC Clause 8

Effectiveness of the contract

Number of GC Clause 9

Commencement of Contract:

Number of GC Clause 11.2

Expiration of Contract:

Number of GC Clause 15

Termination

In the event of termination of the contract due to any reason as already defined in the General Conditions of Contract, the Bidder shall be responsible for providing to the Authority the Goods till the time of alternate arrangements.

Number of GC Clause 17

Conflict of Interest:

The Procuring Agency reserves the right to determine on a case-by-case basis whether the Bidder should be disqualified from providing goods or services due to a conflict of a nature described in Clause GCC 17**.**

Number of GC Clause 22

Liquidated Damages

If the Bidder fails to provide services as required under the contract or in case of any data loss/data breach or any incident compromising the data security or other such failures related to any services, the Bidder shall pay to the Procuring Agency as Liquidated Damages at a rate of **0.10%** to **10.00%** of the Contract value, in accordance with the extent of performance failure & the cost of investigating such incidents as judged by the Authority.

Number of GC Clause 23

Performance Guarantee:

Instrument of Performance Guarantee shall be in the Name of : **Resident Engineer (O&M), Allai Khwar Power Station WAPDA ALLAI**

The amount of performance guarantee shall be **10.00%** of the contract price in acceptable form of **Call at Deposit, Bank Guarantee**

Number of GC Clause 32

Payment terms:

Payment will be made to the Bidder against the procured Goods and services according to the actual invoice or running bills submitted by the Bidder against the services provided within the time given in the conditions of the contract.

Number of GC Clause 33

Currency of Payment:

All the payment to be released to the contractor/Bidder shall be in Pakistani Rupees.

Number of GC Clause 34

Identifying Defects:

The Authority reserves the right at any time to inspect the premises of the provider to inspect the goods and monitor the goods being provided.

Inspections & Tests Requirements

For being Brand New, bearing relevant reference numbers of the equipment (Certificate from supplier)

For Physical Fitness having No Damages (Certificate from supplier)

For the Country of Origin as quoted by the Supplier (Certificate from manufacturer)

For conformance to specifications and performance parameters, through Prior to delivery inspection (Inspection Report by Procurement Committee / Inspection Team)

For successful operation at site after complete installation, testing and commissioning of the equipment (Installation, Testing and Commissioning Report by Procurement Committee / Inspection Team)

All the Routine and type tests shall be performed on offered 132KV and 220KV Isolators as per IEEE/ IEC standards. The Bidder shall submit copy of design tests report from recognized testing laboratory for the circuit breaker of the offered model along with the bid.

The bidder can visit the site to examine the installed equipment as convenient at their own expenses.

Factory Acceptance Test: After Goods become ready at factory, prior to dispatch, the purchaser shall depute two (02) engineers/technical personnel for 07 days including travel time to witness the factory inspection at the contractor's factory premises. Travelling expenses, per diem, and other expense incurred during their visit for inspection shall be borne by the Contractor.

The cost of performing as well as witnessing all tests as per standards during pre-shipment foreign inspection for 02 WAPDA Engineers for pre-shop tests at various stages for seven (07) days including travel shall be borne by the supplier/manufacturer. The cost will also include visa fee, round trip economy class air ticket,local transport, boarding & lodging and daily allowance as per GoP Letter No. FO (B&F)/15-3/Vol VII/3231-3280 dated 29.02.2008 per person per day.

The bidder is instructed to mention the FAT charges separately in the quoted price.

As soon as Goods are ready for Inspection the Contractor shall give a written notice to the Employer at least 75 days prior to scheduled FAT for witnessing such tests with date, time and place. The Employer representative will carry out inspection and witness the inspection and factory acceptance tests. Contractor will provide access and facilities.

For making travel and other arrangement by the Contractor, the Employer (Resident Engineer, Wapda, Allai Khwar Power Station, Allai), shall provide the name of nominees for the FAT to the Contractor at least 45 days in advance of inspection and factory acceptance tests to commence.

In case, the Goods fail to withstand any test, the cost of repeating such test and the cost of witnessing such test by the Purchaser or his representatives/Inspector shall be borne by the Supplier/Manufacturer and the equipment released or modified to the satisfaction of the Purchaser without any extra cost to the Purchaser.

Any inspection and/or witnessing of tests or the waiving of such tests and /or surveillance by the Purchaser or their representatives/Inspector shall not relieve the Supplier/Manufacturer of his obligations and responsibilities under the Contract regardless of any approval or consent given by the Purchaser or his representatives/Inspector.

All expenses / arrangements / supporting documents regarding visa stamping fee etc. of the approved inspectors shall be arranged by the Contractor.

Tests to be performed during FAT: a)Construction Inspection b) Operating Speed Check c)Operating mechanism system check d)Temperature rise test e)Short-time withstand current and peak withstand current tests

In case individual (s) is unable to proceed on FAT for any reason or circumstances, Factory Acceptance Test (FAT) will be arranged by the Contractor as per schedule without the individual(s) having been able to participate in the FAT. In such case; an amount mutually agreed will be deducted by the Employer from payments of total Contract value to be made to the Contractor.

Final inspection of the material will be carried out at ultimate consignee store i.e. Resident Engineer (O&M), Allai Khwar Hydel Power Station, WAPDA, Allai on arrival of goods/material. The Purchaser may reject a part or the whole of the consignment tendered for inspection, if after inspection such portion thereof as he may decide in his discretions, he is satisfied that the consignment is below the requirements of the particulars governing the supply given in the Contract Agreement.

The decision of the inspector during pre-delivery inspection (FAT) and final inspection at ultimate consignee store shall be binding on supplier/contractor.

In case a part or while of the equipment being supplied by the bidder is from within the Purchaser's country (Pakistan) the cost of performing as well as witnessing all tests by the Inspector(s) during pre-shipment local inspection shall be borne by the Supplier/Manufacturer.

Delivery & Documents

Copies of the Supplier's invoice showing Goods' description, quantity, unit price, and total amount;

Insurance Certificate; The Supplier/Manufacturer shall insure and transport the Goods, materials and his Equipment from its place of manufacture or origin to the Port of Shipment (FOB). Shipment will be arranged by PNSC and issuance of the consignment from port of shipment to ultimate consignee store shall be arranged by Director Insurance WAPDA.

Inspection Certificate issued by the Nominated Inspection Agency (if any), and the Supplier's Factory Inspection Report;

Following non-negotiable correct documents should be endorsed to the Pakistan Water and PowerDevelopment Authority represented by Chief Resident Representative, WAPDA C-26, Block-5, Sardar Ali Sabri Road, Gulshan-e-Iqbal,Karachi(Pakistan).Phone#+92 21-34823591-95,under a Registered Cover by"AirMail"courier and/or by email(clearance.crrkwapda@gmail.com, accounts.crrk@gmail.com)being mandatoryfor the supplier so as to reach him immediately/21 days in advance of the ship carrying the goods, ordered

a) 8 copies of the manufacturer's / Supplier's original invoice showing Goods' description, quantity, unitprice, and total amount.

b) 8 copies of the packing list showing exact description of goods, weight, size, specifications, volume andquantity.

c) 8 copies of country of origin certificate.

d) 8 copies of the warranty certificate.

e) 8 copies of Bill of lading.

f) English version of Catalogue / Literature of the equipment

g) Certificate of country of origin issued by the chamber of commerce and industry or equivalent authority in the country of origin in duplicate.

The above documents shall be received by the Chief Resident Representative, WAPDA C-26, Block-5, Sardar Ali Sabri Road, Gulshan-e-Iqbal, Karachi (Pakistan)., Phone # +92 21-34823591-95 at least 21 Days before arrival of the Goods at the port or place of arrival and, if not received, the Supplier will be responsible for any consequent expenses.

The above documents would be required even if the equipment has already been imported and is available with the supplier ex-stock

Payment for Goods supplied from abroad: Payment of foreign currency portion shall be made in_____. ThePakistan Water and Power Development Authority represented by the Chief Resident

Representative,WAPDA, C-26, Block-5, Sardar Ali Sabri Road, Gulshan-e-Iqbal, Karachi, (Pakistan) will open irrevocableLetter of Credit for the total F.O.B value of _____ in favour of Successful Bidder as per followingbreakup:

a) 80% payment of Letter of Credit shall be made on presentation of the following documents: - • Original invoice showing item-wise prices. • Warranty as specified in Purchase Order. • Bill of Lading/Airway Bill of items of Purchase Order along with relevant shipping documents. • Confirmation copy about acceptance of Performance Guarantee by the Purchaser.

b) 20% balance payment of the Letter of Credit payment shall be made after receipt of Material at UltimateConsignee Store i.e. Allai Khwar Power Station, WAPDA, Allai, Dist: Battagram, KPK (Pakistan) and Inspection of the consignment will be carryout by WAPDA authorized representative in the presence of surveyor appointed byNICL, Lahore. The payment will be released after issuance of successful Inspection Report and GoodsReceipt Note (GRN) by the Employer.

Initial charges for the establishment of Letter of Credit will be met by WAPDA. Any subsequent confirmation, if desired by contractor/supplier or corresponding bank, shall be to contractor/supplier's account. Once the Letter of Credit has been established, any amendment sought by contractor/supplier of his own accord the charges for cancellation of the original and establishment of the second Letter of Credit will be borne by contractor/supplier, and not by WAPDA.

Custom clearance of all imported material / goods / shipments / material & equipment and inland transportation, on F.O.B. basis will be cleared/routed from the office of The Chief Resident Representative, WAPDA C-26, Block-5, Sardar Ali Sabri Road, Gulshan-e-Iqbal, Karachi.

For Goods from within Pakistan: Upon delivery of the Goods to the transporter, the Supplier shall notify thePrcuring Agency and mail the following documents to the Procuring Agency: i. one original plus fourcopies of the Supplier's invoice showing Goods' description, quantity, unit price, and total amount; ii.delivery note, railway receipt, or truck receipt; iii. Manufacturer's or Supplier's warranty certificate;

iv. inspection certificate issued by the nominated inspection agency, and theSupplier's factory inspection report; and v. Certificate of country of origin issued by Pakistan Chamber ofCommerce and Industry or equivalent authority in the country of origin in duplicate.The above documentsshall be received by the Procuring Agency before arrival of the Goods and, if not received, the Supplier will be responsible for any consequent expenses.

Payment for Goods and Services supplied from within Pakistan shall be made in Pakistani Rupees, on provision of following documents: •Bill in triplicate supported by sales tax invoice •Warranty Certificate •Certificate to the effect that the billed amount has not been claimed or received earlier •Copy of GST Paid Challan •Copy of Sales Tax Return along with Annex-C •Certificate regarding Active Tax Payer of FBR

• Affidavit that Sales Tax Return covers suchGST amount. • Certificate regarding filer towards Income Tax. • Inspection Certificate/GRN by end user.

Drawings, Data And Manuals: The outline drawings of the isolators and control cubicle with accessories shall be furnished along with the Bid. After award of Contract the successful Bidder shall submit the required number of copies of the following drawings and data for approval of the Employer. a) General equipment layout b) Outline drawings of the isolator and control cubicle with accessories c) Internal wiring diagrams

d) External connection diagrams, showing terminal boards and other external Connection points for each assembly and the required interconnecting wiring e) Drawings showing typical cross-sections of the operating mechanism f) Drawings showing assembly of principal component parts and accessories g) Drawings showing details of bushings or porcelain supporting columns, including dimension.

h) Any other drawings and data required for installation of the isolators i) Instruction manual for storage, installation, operation and maintenance of isolators and operating mechanism.

Number of GC Clause 37

Following is the guidance for Dispute Resolution

(a) For Contracts to be entered with foreign Contractor/ Service Provider:

All disputes arising in connection with the present Contract shall be finally settled under the Rules of Conciliation and Arbitration of the International Chamber of Commerce by one or more arbitrators appointed in accordance with said Rules.

(b) For Contracts to be entered with nationals of Pakistan:

i. If any dispute of any kind whatsoever shall arise between the Authority and the Bidder in connection with or arising out of the Contract, including without prejudice to the generality of foregoing, any question regarding its existence, validity, termination and the execution of the Contract – whether during developing phase or after their completion and whether before or after the termination, abandonment or breach of the Contract – the parties shall seek to resolve any such dispute or difference by mutual diligent negotiations in good faith within 14 (fourteen) days following a notice sent by one Party to the other Party in this regard.

ii. At future of negotiation the dispute shall be resolved through mediation and mediator shall be appointed with the mutual consent of the both parties.

iii. At the event of failure of mediation to resolve the dispute relating to this contract such dispute shall finally be resolved through binding Arbitration in accordance with GCC clause 38.

iv. The cost of the mediation and arbitration shall be shared by the parties in equal proportion however the both parties shall bear their own costs and lawyer's fees regarding their own participation in the mediation and arbitration. However, the Arbitrator may make an award of costs upon the conclusion of the arbitration making any party to the dispute liable to pay the costs of another party to the dispute.
v. Arbitration proceedings as mentioned in the above clause regarding resolution of disputes may be commenced prior to, during or after completion of the contract.

Notwithstanding any reference to the arbitration herein, the parties shall continue to perform their respective obligations under the Contract unless they otherwise agree that the Authority shall pay the Bidder any monies due to the Bidder.

Rules of procedure for arbitration proceedings:

Any dispute between the Authority and a Bidder who is a national of the Islamic Republic of Pakistan arising in connection with the present Contract shall be referred to adjudication or arbitration in accordance with the laws of the Islamic Republic of Pakistan including Arbitration Act 1940, however above provision shall prevail in referring the case to the Arbitrator.

Place of Arbitration and Award:

The arbitration shall be conducted in English language and place of arbitration shall be at Islamabad. The award of the arbitrator shall be final and shall be binding on the parties.

Bid Securing Declaration

Form 9: Bid Securing Declaration

Date: *[insert date (as day, month and year)]*

Bid No.:***P69836***

Alternative No.: **[insert identification No if this is a Bid for an alternative]**

To: **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).**

We, the undersigned, declare that:

We understand that, according to your conditions, Bids must be supported by a Bid Securing Declaration.

We accept that we will be blacklisted and henceforth cross debarred for participating in respective category of public procurement proceedings for a period of (not more than) six months, if fail to abide with a bid securing declaration, however without indulging in corrupt and fraudulent practices, if we are in breach of our obligation(s) under the Bid conditions, because we:

1. have withdrawn or modified our Bid during the period of Bid Validity specified in the Form of Bid;

2. Disagreement to arithmetical correction made to the Bid price; or

3. having been notified of the acceptance of our Bid by the Procuring Agency during the period of Bid Validity, (i) failure to sign the contract if required by Procuring Agency to do so or (ii) fail or refuse to furnish the Performance Security or to comply with any other condition precedent to signing the contract specified in the Bidding Documents.

We understand this Bid Securing Declaration shall expire if we are not the successful

Bidder, upon the earlier of (i) our receipt of your notification to us of the name of the successful Bidder; or (ii) twenty-eight (28) days after the expiration of our Bid.

Signed: [insert signature of person whose name and capacity are shown] In the capacity of
[insert legal capacity of person signing the Bid Securing Declaration]

Name: [insert complete name of person signing the Bid Securing Declaration]

Duly authorized to sign the Bid for and on behalf of: [insert complete name of Bidder]

Dated on day of , [insert date of signing]
Corporate Seal (where appropriate)

Contract Form

SECTION IX: CONTRACT FORMS

THIS AGREEMENT made the _____ day of _____ 20_____ between **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).**

(hereinafter called "the Procuring Agency") of the one part and *[name of Bidder]* of *[city and country of Bidder]* (hereinafter called "the Bidder") of the other part:

WHEREAS the Procuring Agency invited Bids for provision of goods, viz., **Procurement of "132KV & 220KV Isolators alongwith essential spare parts for Allai Khwar Power Station" through Internnational Competitive Bidding (ICB) on FOB Basis (*P69836*)** and has accepted a Bids by the Bidder for the provision of Goods in the sum of *[contract price in words and figures]* (hereinafter called "the Contract Price").

NOW THIS CONTRACT WITNESSETH AS FOLLOWS:

1. In this Contract words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract referred to.

2. The following documents shall be deemed to form and be read and construed as part of this Contract, In the event of any ambiguity or conflict between the Contract Documents listed below, the order of precedence shall be the order in which the Contract Documents are listed below:-

1. This form of Contract;
2. the Form of Bids and the Price Schedule submitted by the Bidder;
3. the Schedule of Requirements;
4. the Technical Specifications;
5. the Special Conditions of Contract;
6. the General Conditions of the Contract;
7. the Procuring Agency's Letter of Acceptance; and
8. [*add here: any other documents*]

3. In consideration of the payments to be made by the Procuring Agency to the Bidder as hereinafter mentioned, the Bidder hereby covenants with the Procuring Agency to provide the Goods related services and to remedy defects therein in conformity in all respects with the provisions of the Contract.

4. The Procuring Agency hereby covenants to pay the Bidder in consideration of the provision of Goods and the remedying of defects therein, the Contract Price or such other sum as may become payable under the provisions of the contract at the times and in the manner prescribed by the contract.

IN WITNESS whereof the parties hereto have caused this Contract to be executed in accordance with their respective laws the day and year first above written.

Signed, sealed, delivered by _____the _____ (for the Procuring Agency)

Witness to the signatures of the Procuring Agency:

……

Signed, sealed, delivered by _____the _____ (for the Procuring Agency)

Witness to the signatures of the Bidder: ……

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Integrity Pact

Integrity Pact

DECLARATION OF FEES, COMMISSION AND BROKERAGE ETC. PAYABLE BYTHE SUPPLIERS OF GOODS, SERVICES & WORKS IN CONTRACTS WORTH RS.10.00 MILLION OR MORE

Contract Number: Contract Value: Contract Title:

Dated:

[Name of Supplier] hereby declares that it has not obtained or induced the procurement of any contract, right, interest, privilege or other obligation or benefit from Government of Pakistan or any administrative subdivision or agency thereof or any other entity owned or controlled by it (GoP) through any corrupt business practice.

Without limiting the generality of the foregoing [Name of Supplier] represents and warrants that it has fully declared the brokerage, commission, fee etc. paid or payable to anyone and not given or agreed to give and shall not give or agree to give to anyone within or outside Pakistan either directly or indirectly through any natural or juridical person, including its affiliate, agent, associate, broker, consultant, director, promoter, shareholder, sponsor or subsidiary, any commission, gratification, bribe, finder's fee or kickback, whether described as consultations fee or otherwise, with the object of obtaining or inducing the procurement of a contract, right, interest, privilege or other obligation or benefit in whatsoever form from GoP, except that which has been expressly declared pursuant hereto.

[Name of Supplier] certifies that it has made and will make full disclosure of all agreements and arrangements with all persons in respect of or related to the transaction with GoP and has not taken any action or will not take any action to circumvent the above declaration, representative or warranty.

[Name of Supplier] accepts full responsibility and strict liability for making and false declaration, not making full disclosure, misrepresenting fact or taking any action likely to defeat the purpose of this declaration, representation and warranty. It agrees that any contract, right interest, privilege or other obligation or benefit obtained or procured as aforesaid shall, without prejudice to any other right and remedies available to GoP under any law, contract or other instrument, be voidable at the option of GoP.

Notwithstanding any rights and remedies exercised by GoP in this regard, [Name of Supplier] agrees to indemnify GoP for any loss or damage incurred by it on account of its corrupt business practices and further pay compensation to GoP in an amount equivalent to ten time the sum of any commission, gratification, bribe, finder's fee or kickback given by [Name of Supplier] as aforesaid for the purpose of obtaining or inducing the procurement of any contract, right, interest, privilege or other obligation or benefit in whatsoever form from GoP.

Performance Guarantee Form

Performance Guarantee Form

To: **Allai Khwar Power Station WAPDA ALLAI (General Manager Finance (Power) WAPDA), Resident Engineer Allai Khwar Power Station WAPDA ALLAI, Allai, Battagram (District), Hazara Division (Division), Khyber Pakhtunkhwa (KP) (Province).**

WHEREAS *[name of Bidder]* (hereinafter called "the Bidder") has undertaken, in pursuance of Contract No. *[reference number of the contract]* dated *[insert date]* for provision of Goods*(*hereinafter called "the Contract").

AND WHEREAS it has been stipulated by you in the said Contract that the Bidder shall furnish you with a Bank Guarantee by a reputable bank for the sum specified therein as security for compliance with the Bidder's performance obligations in accordance with the Contract.

AND WHEREAS we have agreed to give the Bidders guarantee:

THEREFORE, WE hereby affirm that we are Guarantors and responsible to you, on behalf of the Bidder, up to a total of *[amount of the guarantee in words and figures]*, and we undertake to pay you, upon your first written demand declaring the Bidder to be in default under the Contract and without cavil or argument, any sum or sums within the limits of *[amount of guarantee]* as aforesaid, without your needing to prove or to show grounds or reasons for your demand or the sum specified therein.

This guarantee is valid until the: *[insert date]*

Signature and seal of the Guarantors

_____

[name of bank or financial institution]

_____

[address]

_____

[date}

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Annexure

220 kV Disconnector & Earthing switch Technical Data

Information (Read-Only)

See Form Under Additional Forms and Documents: **220 kV Disconnector & Earthing switch Technical Data** (page number: 85)

Outline Drawings of 220 kV Disconnector, Nameplate, Motor Operating Mechanism Type Nameplate. (With and without earthing switch)

Information (Read-Only)

See Form Under Additional Forms and Documents: **Outline Drawings of 220 kV Disconnector, Nameplate, Motor Operating Mechanism Type Nameplate. (With and without earthing switch)** (page number: 88)

220 kV Disconnector Motor Circuit Diagram (With and without earthing switch).

Information (Read-Only)

See Form Under Additional Forms and Documents: **220 kV Disconnector Motor Circuit Diagram (With and without earthing switch).** (page number: 98)

Foundation Details and Loads of 220KV disconnector (With and without earthing switch).

Information (Read-Only)

See Form Under Additional Forms and Documents: **Foundation Details and Loads of 220KV disconnector (With and without earthing switch).** (page number: 104)

220 kV Disconnector Steel Structure Drawing

Information (Read-Only)

See Form Under Additional Forms and Documents: **220 kV Disconnector Steel Structure Drawing** (page number: 106)

132 kV Disconnector & Earthing Switch Technical Data

Information (Read-Only)

See Form Under Additional Forms and Documents: **132 kV Disconnector & Earthing Switch Technical Data** (page number: 108)

Outline Drawings of 132 kV Disconnector, Nameplate, Motor Operating Mechanism Type Nameplate. (With and without earthing switch).

Information (Read-Only)

See Form Under Additional Forms and Documents: **Outline Drawings of 132 kV Disconnector, Nameplate, Motor Operating Mechanism Type Nameplate. (With and without earthing switch).** (page number: 111)

132 kV Disconnector Motor Circuit Diagram (With and without earthing switch).

Information (Read-Only)

See Form Under Additional Forms and Documents: **132 kV Disconnector Motor Circuit Diagram (With and without earthing switch).** (page number: 121)

Foundation Details and Loads of 132KV disconnector (With and without earthing switch).

Information (Read-Only)

See Form Under Additional Forms and Documents: **Foundation Details and Loads of 132KV disconnector (With and without earthing switch).** (page number: 127)

132 kV Disconnector Steel Structure Drawing

Information (Read-Only)

See Form Under Additional Forms and Documents: **132 kV Disconnector Steel Structure Drawing** (page number: 129)

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Procurement Forms

Past Experience and Completed Contracts

1. The bidder shall be Equipment Manufacturer or its authorized representative. The offered equipment has to be designed, manufactured and tested as per relevant IEC or other International Standards with latest amendments.

2. Copies of at least 03 Contracts worth equal to or higher than the total Bid Price executed during last 05 years regarding subject procurement duly supported by performance certificate for satisfactory performance for last 2 years from at least 02 employers.

See Form Under Additional Forms and Documents: **Past Experience and Completed Contracts** (page number: 131)

Historical Contract Non-Performance, and Pending Litigation and Litigation History

See Form Under Additional Forms and Documents: **Historical Contract Non-Performance, and Pending Litigation and Litigation History** (page number: 132)

Current Contracts and Their Progress

See Form Under Additional Forms and Documents: **Current Contracts and Their Progress** (page number: 134)

Financial Capacity and Net Worth Evaluation Form

The Bidder is required to include with its Bid, documentation as well as financial status from the manufacturer of the goods, that it has been duly authorized to deliver, in Pakistan, the goods indicated in its Bid.

See Form Under Additional Forms and Documents: **Financial Capacity and Net Worth Evaluation Form** (page number: 135)

Average Annual Turnover

The bidder should have an average annual turnover in the last five years equal to or more than Rs. 900 Million.

See Form Under Additional Forms and Documents: **Average Annual Turnover** (page number: 137)

PUBLIC PROCUREMENT REGULATORY AUTHORITY
(PPRA)
EPADS

Additional Forms and Documents

REMARK FOR APPROVAL:

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :

HHC

HIGH HEAD HYDROPOWER CONSULTANT
JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT
ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

Index	Sheet	Revision	Date	Name	Check	Appr.
B1	all	As manufactured	14.07.08	Holzapfel	Dastl	Dastl
B0	2	Change of rated current	3.5.2005	Holzapfel	E. Dastl	E. Dastl
A	2	Change of Rated one minute 50 Hz test voltage	7.3.2005	Holzapfel	E. Dastl	E. Dastl

PURCHASER	ALLGEMEIN/GENERAL	DRAWN	02.12.2004	HOLZAPFE	REV/DATE		FILE	DISCONNECTOR
PLANT	ALLGEMEIN/GENERAL	CHECK	02.12.2004	DASTL	B1	14.07.08	DATE	16.07.2008
PROJECT-No.	..	APPR.	. .	LH-DE			SHEET	1 OF 3

VA TECH HYDRO

HYDRO VIENNA

DOC No. VATECH No.

AE06-VTH-DD-10-ADA 04-000007002-B1

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

245 kV Isolating Switches		Guarantee values according to Attachment 5	Requirements according to C 1 & C 2	for Approval
Description	**Unit**	**Value**		
Type				**CBD 245 - 2000**
Manfucturer				**Coelme**
Number of Pole	pole	2)		3
Class		Outdoor		25 mm / kV = 6125 mm creepage distance
Rated voltage	kV	245	245	245
Rated impulse withstand voltage				
- to earth	kV peak	1050	1050	1050
- across the isolating distance	kV peak	1200	not mentioned	1200
Rated one minute power frequency withstand voltage, dry and wet				
- to earth	kV	460	not mentioned	460
- across the isolating distance	kV	530	not mentioned	530
Rated frequency	Hz	50	50	50
Rated normal current	A	1600	2000	**2000**
Rated short-time withstand current 1s.	kA rms	40	40	40
Maximum service voltage	kV	145	245	245
Rated dynamic current	kA peak	100	not mentioned	100
Maximum temperature rise of current carrying parts at rated current	K	in accordance with the table 3 of IEC 60694		65°
Number of aux. contacts			sufficient	6NO + 6NC
Operating mechanism			Motor / manual	Motor / manual

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

245 kV Earthing Switches built on disconnector		Guarantee values according to Attachment 5	Requirements according to C 1 & C 2	for Approval
Description	**Unit**	**Value**		
Type				***)**
Manfucturer				**Coelme**
Class		2)		same as the Isolating switch
Rated voltage	kV	245	245	245
Rated impulse withstand voltage				
- to earth	kV peak	1050	1050	1050
- across the isolating distance	kV peak	NA	not mentioned	not applicable
Rated one minute power frequency withstand voltage, dry and wet				
- to earth	kV	460	not mentioned	460
- across the isolating distance	kV	NA		NA
Rated frequency	Hz	50	50	50
Rated short-time withstand current 1s.	kA rms	40	40	40
Rated short-circuit making current	kA	100 **)		not applicable
Number of aux. contacts			sufficient	4NO + 4NC
Operating mechanism			manual / local	manual / local

**) the earthing switches have not any "making" capability
*) Remark: The Earthing switches are build-on the disconnectors according to the single line diagram and the type will be CBD-E 245 - 2000

220 kV Substation Outline Drawing 220 kV Disconnector VATECH

VA TECH HYDRO

REMARK FOR APPROVAL:

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :

HHC

HIGH HEAD HYDROPOWER CONSULTANT
JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT

ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

Index	Sheet	Revision	Date	Name	Check	Appr.
B2	all	As manufactured	23.06.2008	Schn	Dastl	
B1	All	Modification due to new types	12.09.2006	Dastl	Holzapfel	

PURCHASER	ALLGEMEIN/GENERAL	DRAWN	02.12.2004	HOLZAPFE	REV/DATE		FILE	AE06-VTH-DD-10-
PLANT	ALLGEMEIN/GENERAL	CHECK	02.12.2004	DASTL	B2	23.06.2008	DATE	16.07.2008
PROJECT-No.	..	APPR.	. .	LH-DE			SHEET	1 OF 10


VA TECH HYDRO	HYDRO VIENNA	DOC No. VATECH No.	AE06-VTH-DD-10-ADA 28-000007002-B2


This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.


List of Content

Title	Manufacturer / Type	Drawing No:	Revision
Outline Drawing of Center Break Disconnector, Parallel Arrangement (without Earthing Switch)	Coelme/ CBD 245 – 2000	KMO 03 265	D
Outline Drawing of Center Break Disconnector, Parallel Arrangement (with Earthing Switch right)	Coelme/ CBD-E-245 - 2000	KMO 03 264	E
Outline Drawing of Center Break Disconnector, Parallel Arrangement (with Earthing Switch left)	Coelme/ CBD-E-245 - 2000	KMO 04 115	B
Disconnector Plate (Name Plate)	Coelme	KP 003988	A
Motor Operating Mechanism Type Plate (Name Plate)	Coelme	KP 003989	C

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

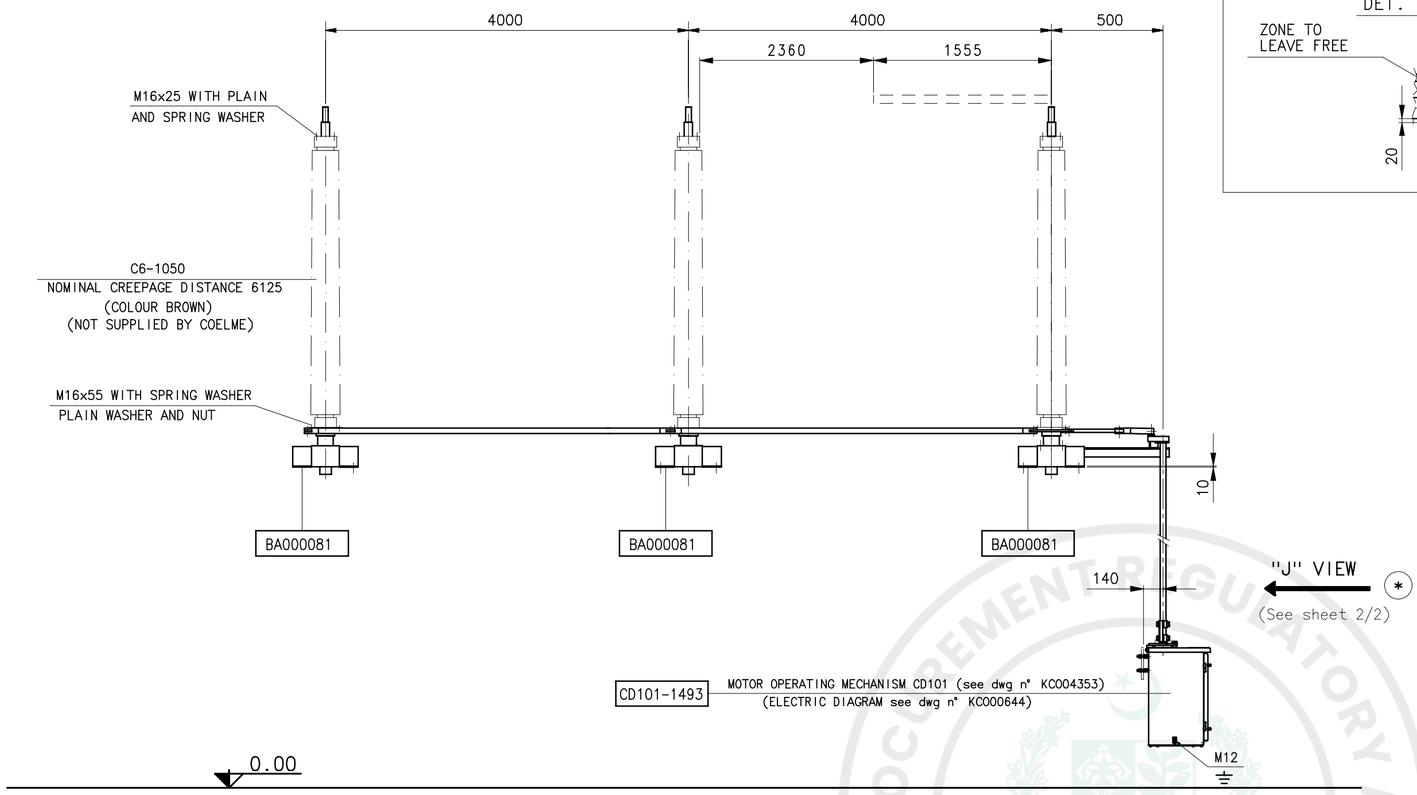


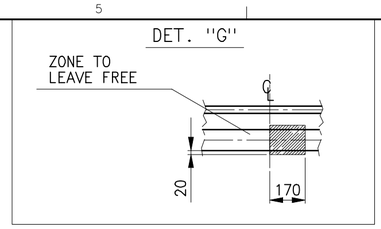

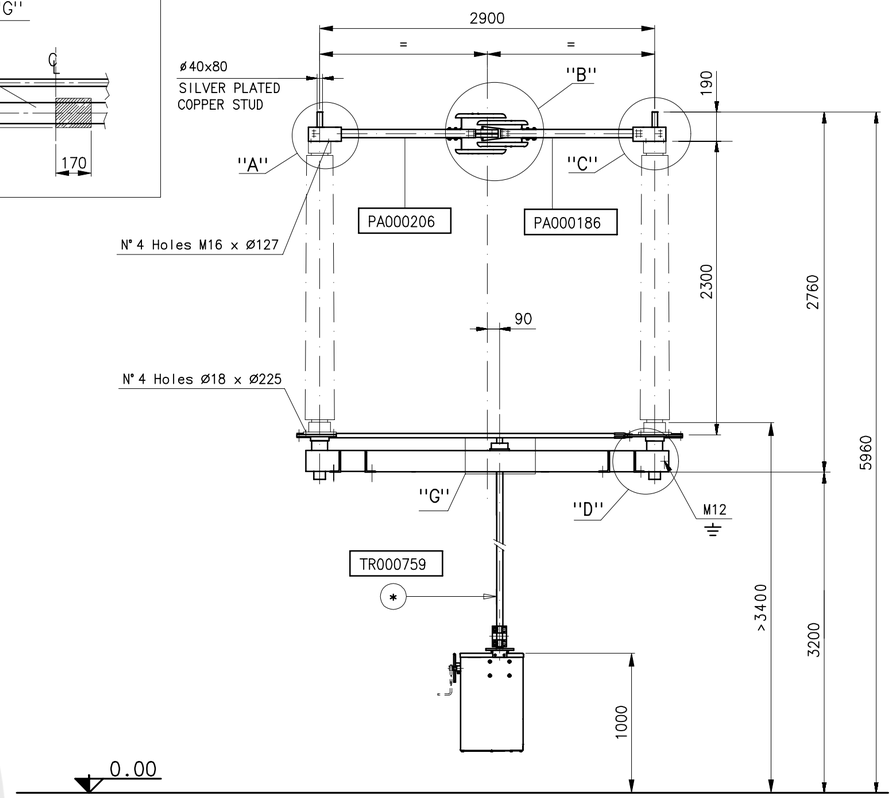


approximate weight for three pole isolator
complete of operating rods,driving shaft and insulators : Kg 1600


approximate weight motor operating mechanism : Kg 50

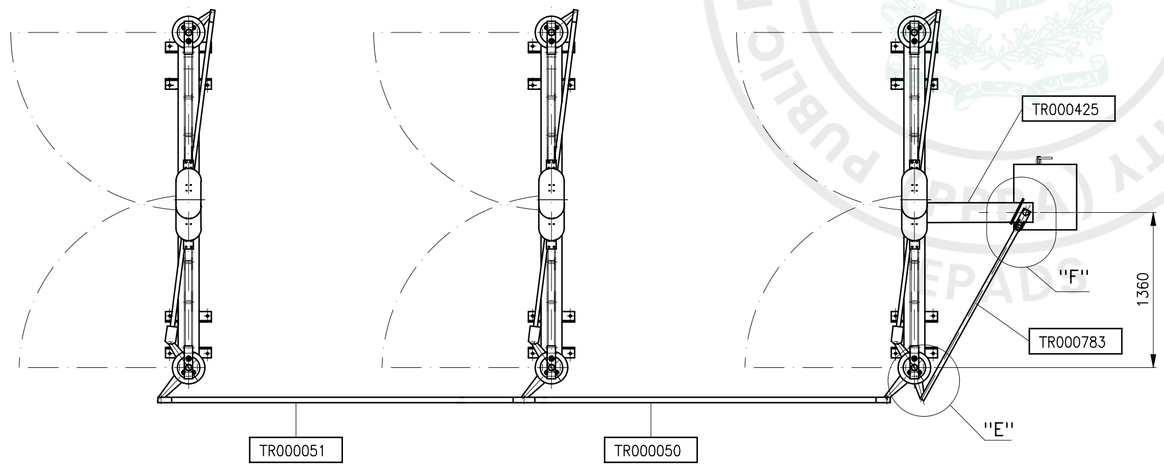



PA000206	ISOLATOR FEMALE ARM
PA000186	ISOLATOR MALE ARM
BA000081	BASE
TR000759	ISOLATOR DRIVING SHAFT
TR000425	SUPPORT
TR000783	ISOLATOR DRIVING ROD
P0001206	DRIVING BASE LEVER
TR000051	POLES CONNECTING ROD
TR000050	POLES CONNECTING ROD
PA000053	CORONA SHIELD
PA000054	CORONA SHIELD
PA000056	CORONA SHIELD
PA000057	CORONA SHIELD
CD101-1493	MOTOR OPERATING MECHANISM


(*) VERTICAL SHAFT TO BE CUT TO SIZE AT SITE

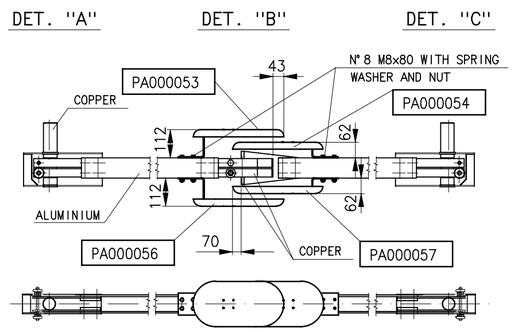

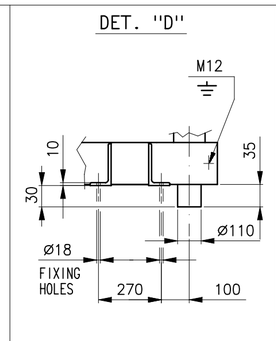

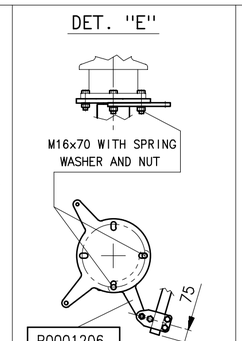

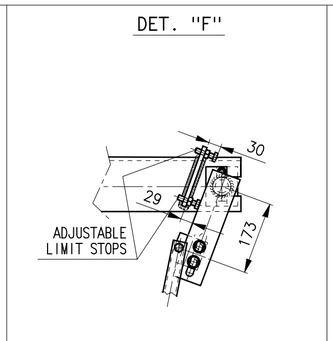

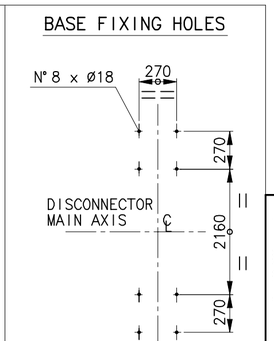

D	Added components list and sheet 2/2	SAN MARCO	18/06/2007
C	Revised	BERTATO	13/04/2007
B	Revised	BERTATO	28/03/2007
A	First issue	Dewic	08/09/2006
Rev	Description	Drawn	Date

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

DISCONNECTOR CBD 245-2000
(BIL1050 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS


Format:	Standard:	Scale:	Language:
A2		1:30	ENG
	Revision: D	Sheet/of: 1/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KM003265

File: KM003265_00026806_K0_3

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

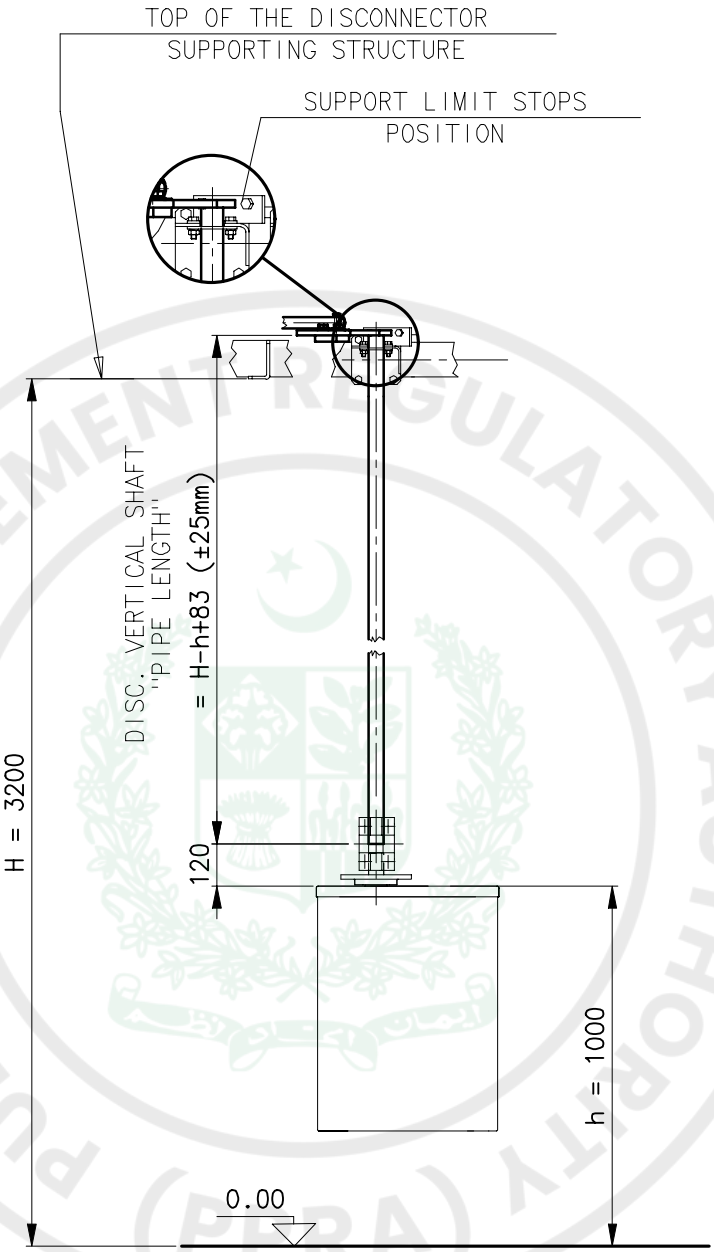

* "J" VIEW

DETAIL TO CUT
VERTICAL SHAFT(S) AT SITE

After cutting, protect the cut surface by spray zinc

Rev	Description	Drawn	Checked	Date
D	Added components list and sheet 2/2	SIMONATO	RUFFATO	18/05/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

DISCONNECTOR CBD 245-2000
(BIL1050 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS


Format:	Standard:	Scale:	Language:
A4		1:20	ENG
	Revision: D	Sheet/of: 2/2	


COELME COSTRUZIONI ELETTROMECCANICHE-SPA
egic


KM003265


File:KM003265_00031773_K0_3

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

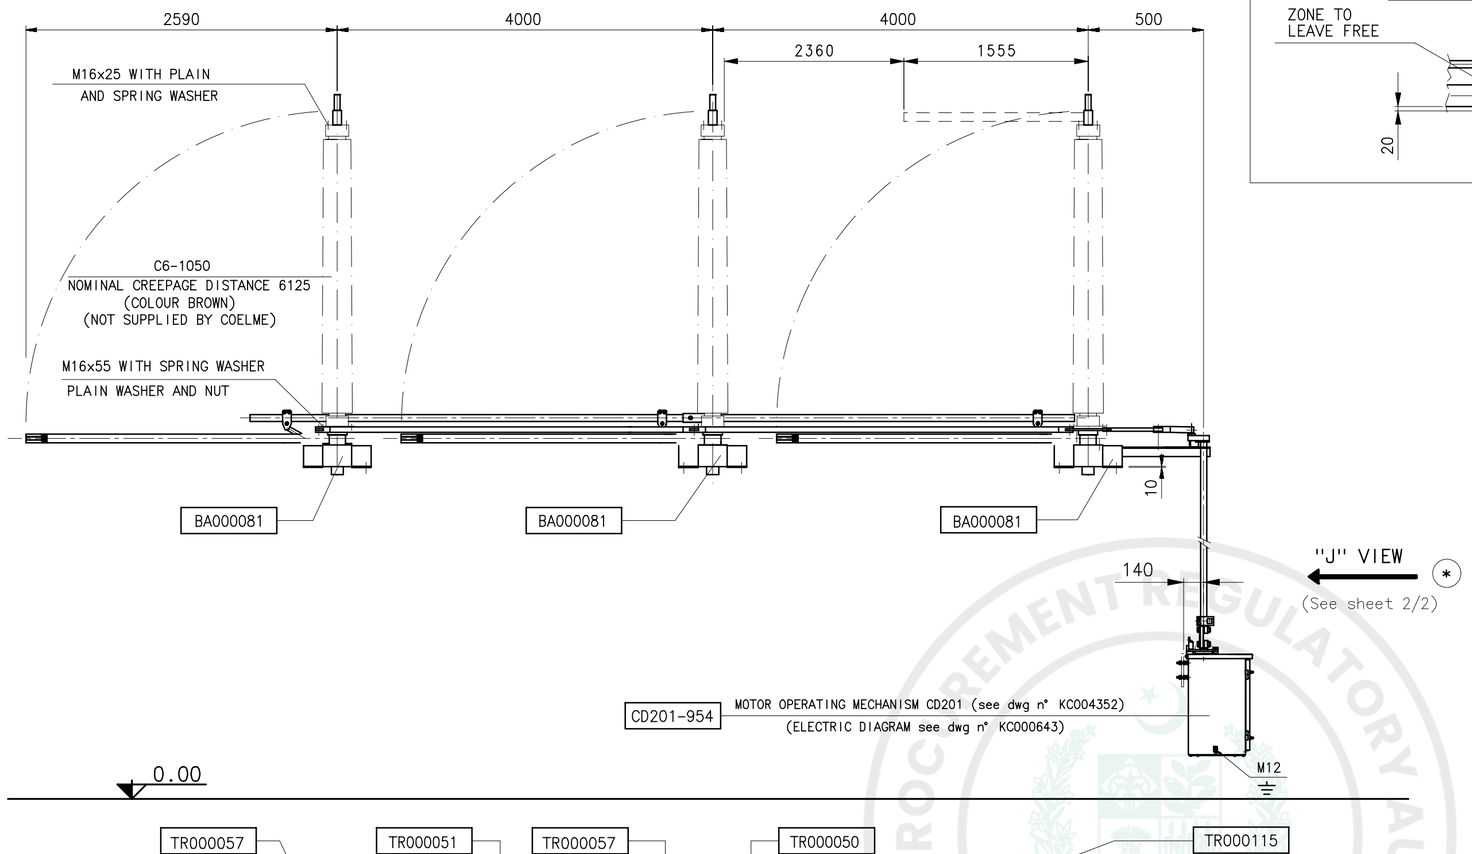

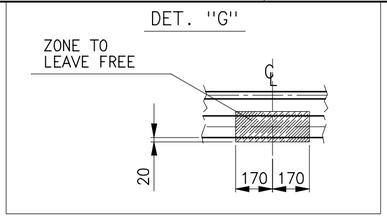

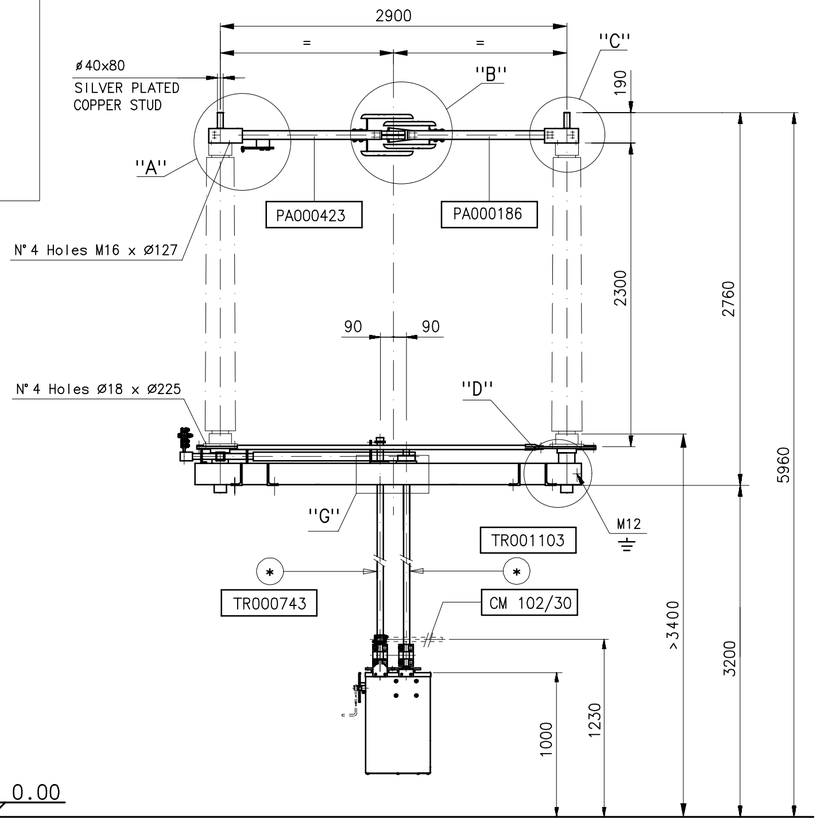


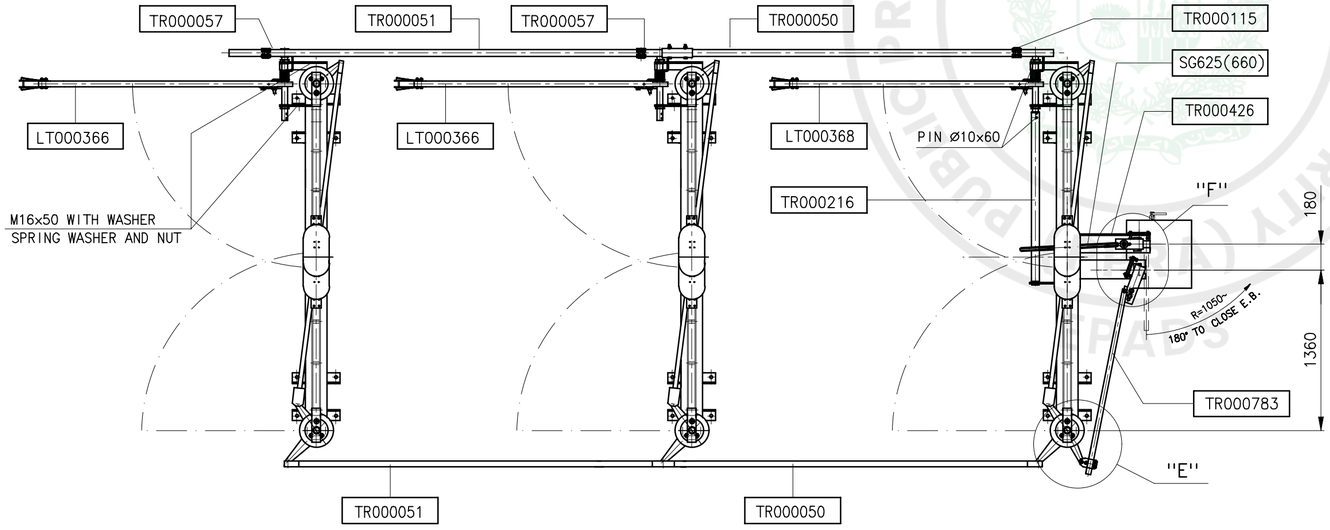



approximate weight for three pole isolator
complete of operating rods,driving shaft and insulators : Kg 1700


approximate weight motor operating mechanism : Kg 60


PA000423	ISOLATOR FEMALE ARM	TR000057	SINGLE LEVER
PA000186	ISOLATOR MALE ARM	TR000115	DOUBLE DRIVING LEVER
PA000053	CORONA SHIELD	TR000216	E.B. DRIVING LEVER
PA000054	CORONA SHIELD	SG625(660)	CONNECTING BRACE
PA000056	CORONA SHIELD	P0001206	DRIVING BASE LEVER
PA000057	CORONA SHIELD	TR000783	ISOLATOR DRIVING ROD
BA000081	BASE	TR000426	SUPPORT
LT000368	DRIVING EARTHING BLADE	TR000743	E.B. DRIVING SHAFT
LT000366	CENTRAL-SIDE EARTHING BLADE	TR001103	ISOLATOR DRIVING SHAFT
TR000050	POLES CONNECTING ROD	CM 102/30	LEVER
TR000051	POLES CONNECTING ROD	CD201-954	MOTOR OPERATING MECHANISM

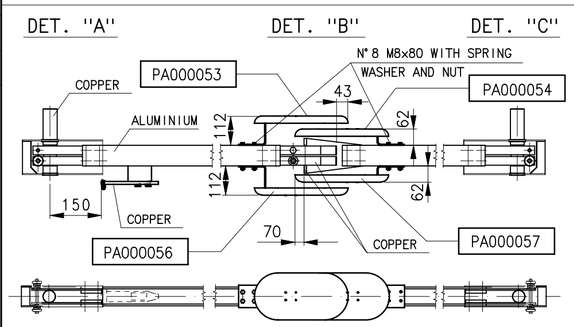

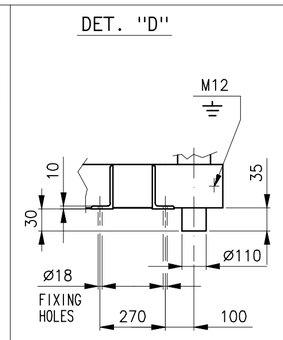

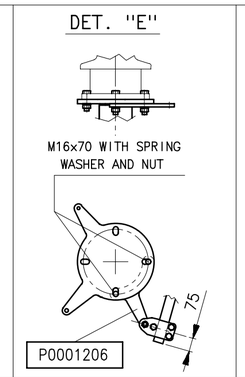

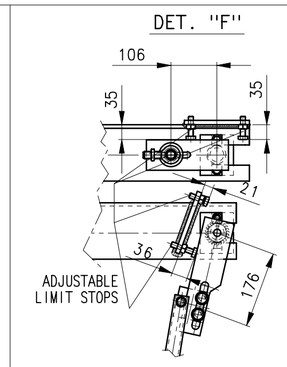

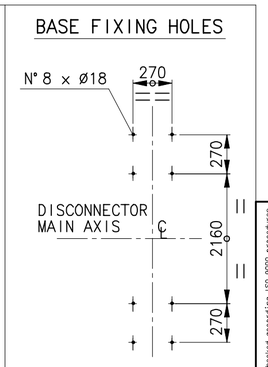

(*) VERTICAL SHAFTS TO BE CUT TO SIZE AT SITE

Rev	Description	Drawn	Checked	Date
E	Modified isolator vertical shaft code	SIMONATO	BERTATTO	18/09/2007
D	Added components list and sheet 2/2	BERTATTO	MASSORA	13/04/2007
C	Revised	BERTATTO	MASSORA	28/03/2007
B	Revised	BERTATTO	MASSORA	28/03/2007
A	First issue	Generic	BISTRIO	08/09/2006

DISCONNECTOR CBD-E 245-2000
(BIL1050 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Checked according ISO 9000 procedures

Format:	Standard:	Scale:	Language:
A2		1:30	ENG
	Revision: E	Sheet/of: 1/2	


COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KM003264

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

eProcurement Regulatory Authority Publishing System (ERAPS) generated document | © 2026

File: KM003264_00026803_K0_4

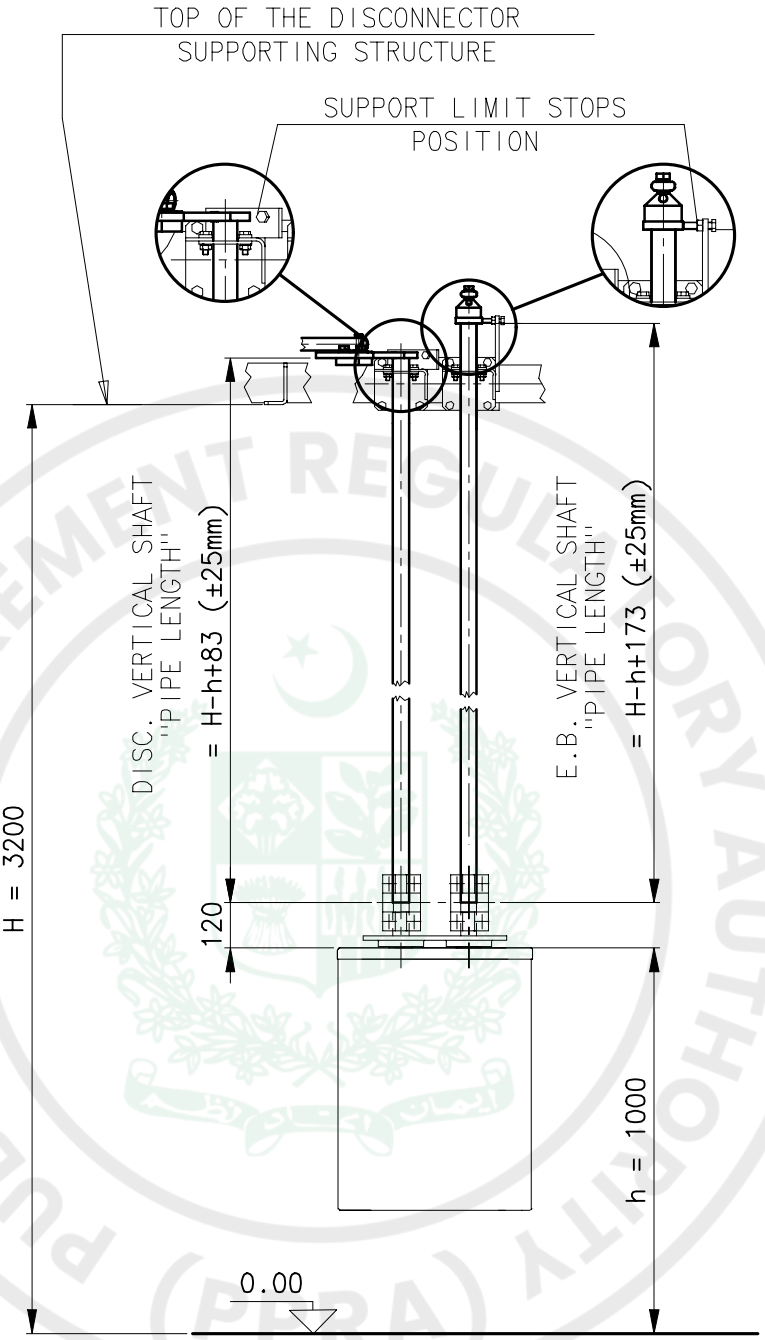

* "J" VIEW

DETAIL TO CUT
VERTICAL SHAFT(S) AT SITE

After cutting, protect the cut surface by spray zinc

Rev	Description	Drawn	Checked	Date
E	Modified isolator vertical shaft code	SIMONATO	BUSTREO	25/10/2007
D	Added components list and sheet 2/2	SIMONATO	RUFFATTO	18/05/2007

Checked according ISO 9000 procedures

DISCONNECTOR CBD-E 245-2000
(BIL1050 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A4		1:20	ENG
	Revision: E	Sheet/of: 2/2	


COELME COSTRUZIONI ELETTROMECCANICHE-SPA
egic


KM003264


THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW


ePak Acquisition and Disposal System (EPADS) generated document | © 2026


File:KM003264_00031772_K0_4

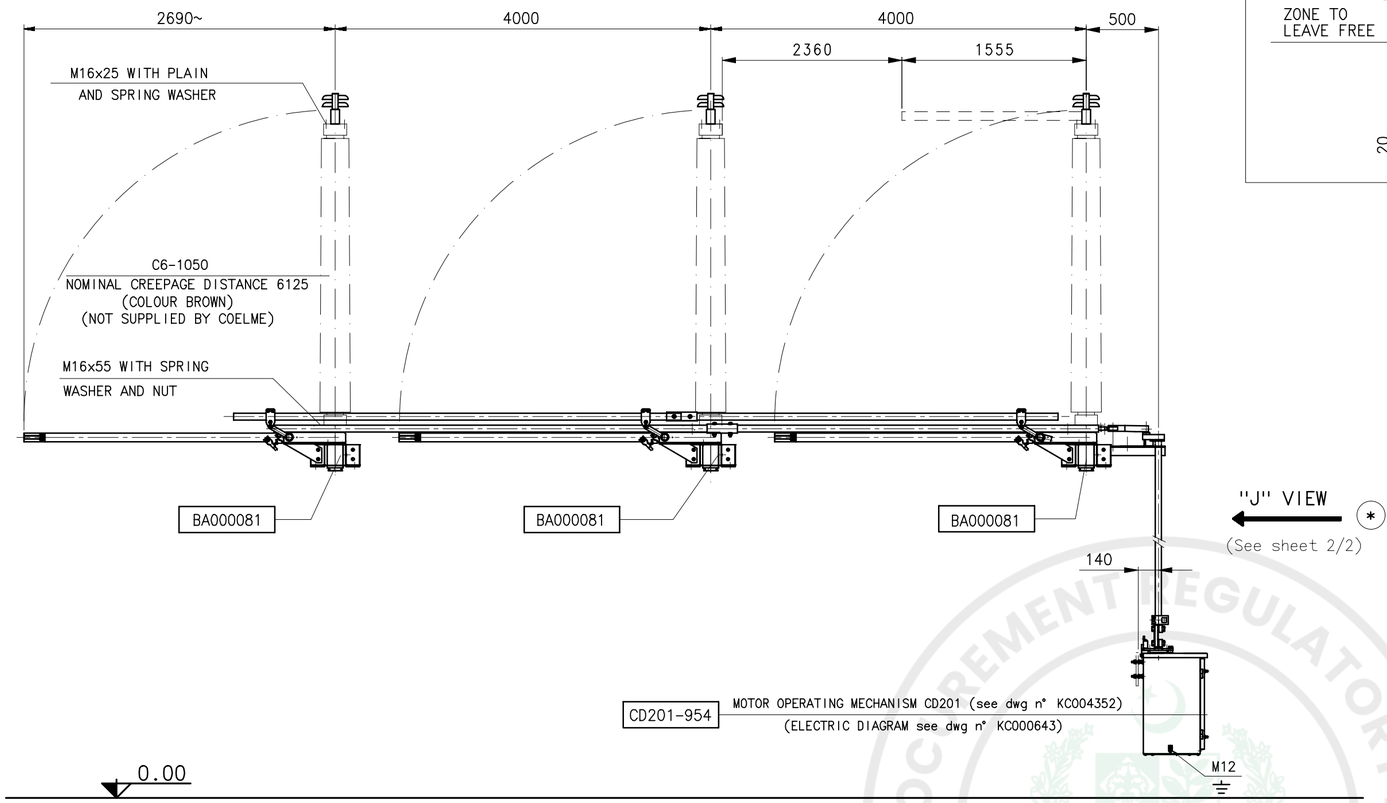


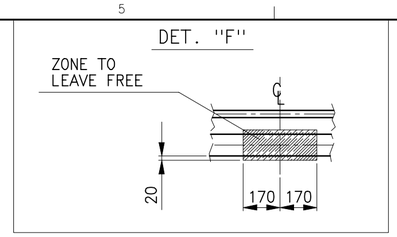


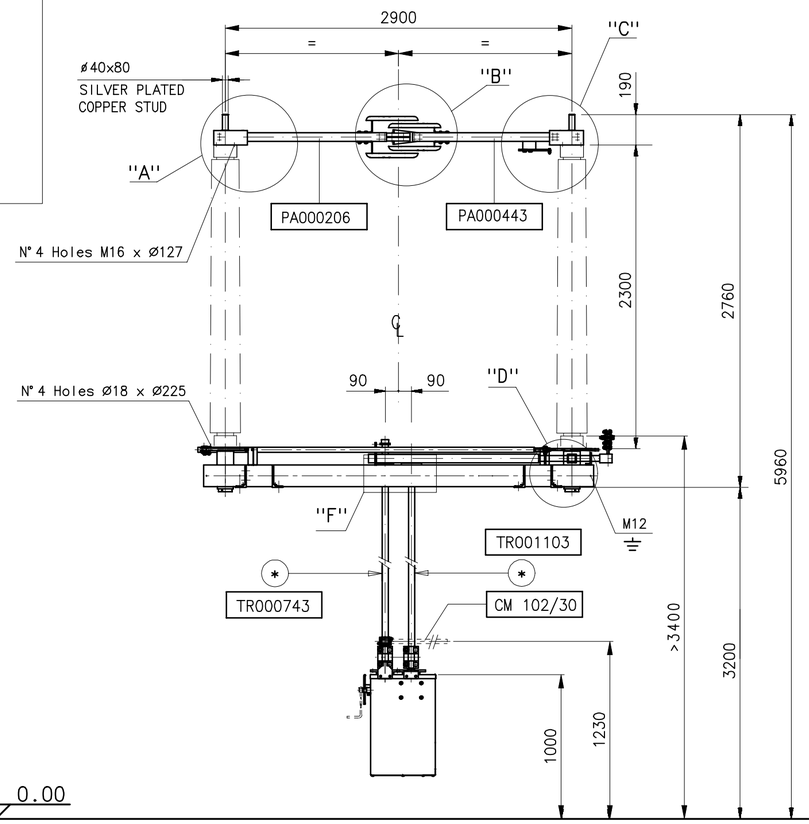


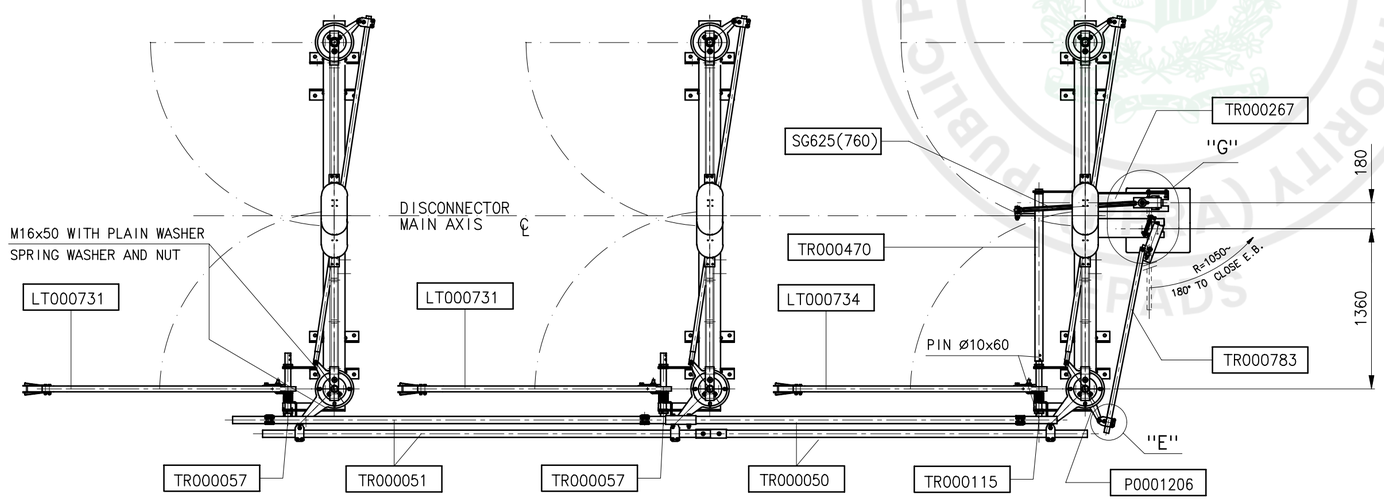


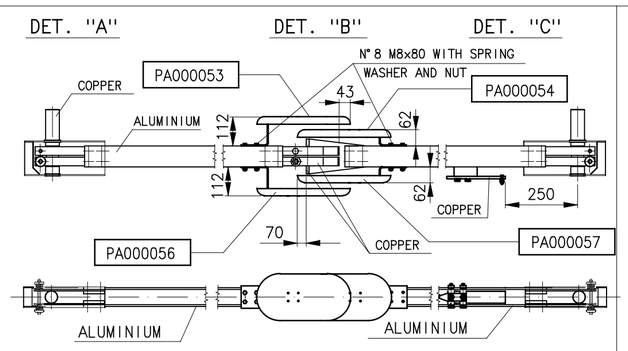

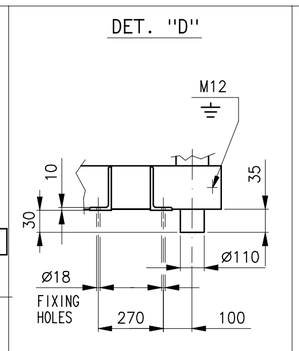

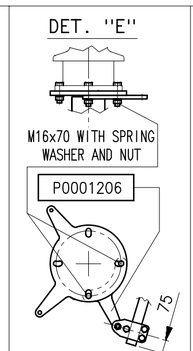

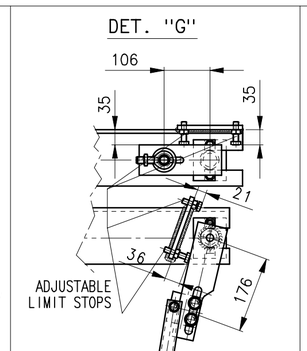

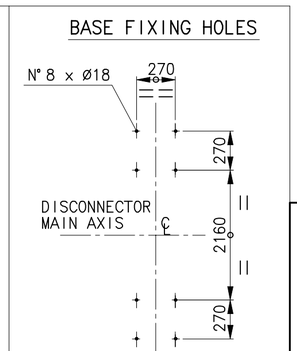

approximate weight for three pole isolator
complete of operating rods,driving shaft and insulators : Kg 1700

approximate weight motor operating mechanism : Kg 60

PA000206	ISOLATOR FEMALE ARM	TR000057	SINGLE LEVER
PA000443	ISOLATOR MALE ARM	TR000115	DOUBLE DRIVING LEVER
PA000053	CORONA SHIELD	TR000470	E.B. DRIVING LEVER
PA000054	CORONA SHIELD	SG625(760)	CONNECTING BRACE
PA000056	CORONA SHIELD	P0001206	DRIVING BASE LEVER
PA000057	CORONA SHIELD	TR000783	ISOLATOR DRIVING ROD
BA000081	BASE	TR000267	SUPPORT
LT000734	DRIVING EARTHING BLADE	TR000743	E.B. DRIVING SHAFT
LT000731	CENTRAL-SIDE EARTHING BLADE	TR001103	ISOLATOR DRIVING SHAFT
TR000050	POLES CONNECTING ROD	CM 102/30	LEVER
TR000051	POLES CONNECTING ROD	CD201-954	MOTOR OPERATING MECHANISM

(*) VERTICAL SHAFT(S) TO BE CUT TO SIZE AT SITE

Rev	Description	Drawn	Checked	Date
B	Modified isolator vertical shaft code	SWINKELS	BERTATO	25/10/2007
A	First issue	SWINKELS	BERTATO	31/05/2007

DISCONNECTOR CBD-E 245-2000
(BIL1050 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format: A2 | Standard: | Scale: 1:30 | Language: ENG | Revision: B | Sheet/of: 1/2


COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KM004115

Checked according ISO 9000 procedures

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

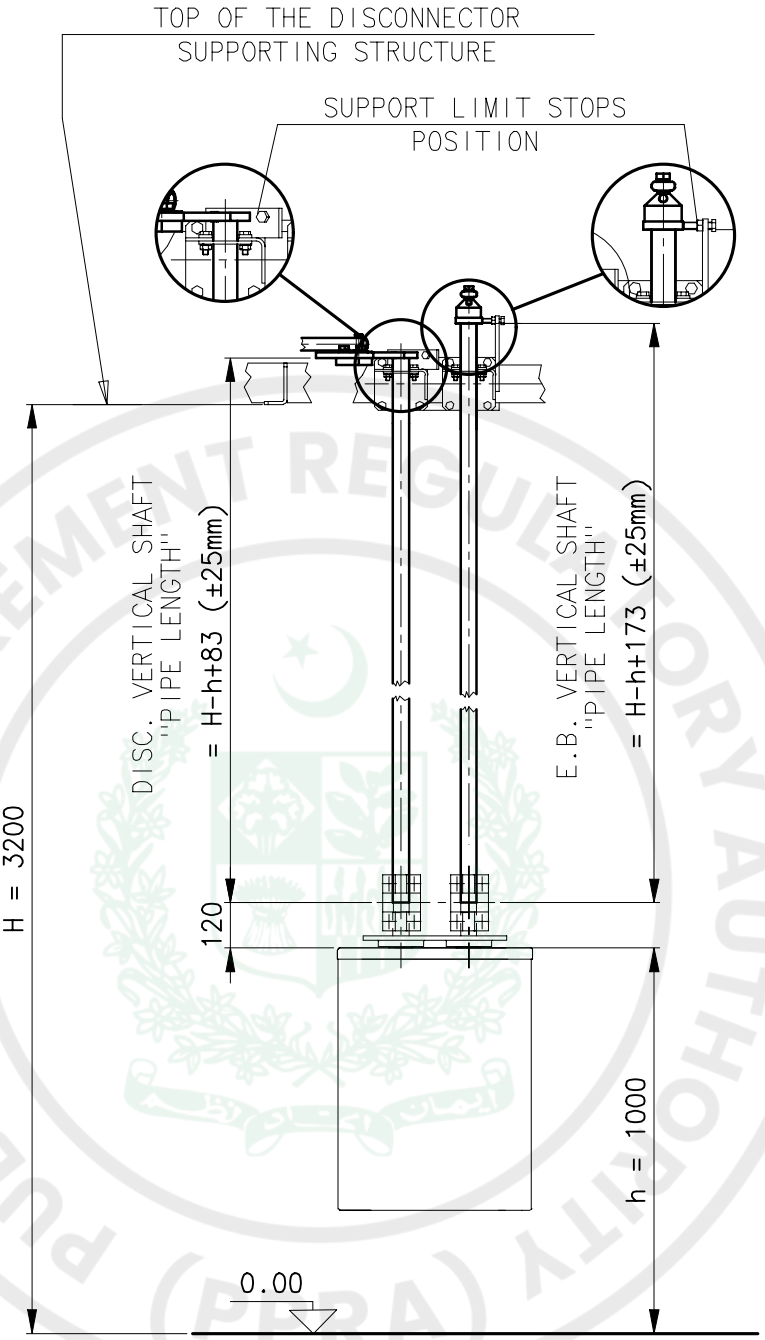

* "J" VIEW

DETAIL TO CUT
VERTICAL SHAFT(S) AT SITE

After cutting, protect the cut surface by spray zinc

Rev	Description	Drawn	Checked	Date
B	Modified isolator vertical shaft code	SIMONATO	BUSTREO	25/10/2007
A	First issue	SIMONATO	RUFFATTO	31/05/2007

Checked according ISO 9000 procedures

DISCONNECTOR CBD-E 245-2000
(BIL1050 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A4		1:20	ENG
	Revision: B	Sheet/of: 2/2	

COELME
COSTRUZIONI ELETTROMECCANICHE-SPA
egic

KM004115

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

ePak Acquisition and Disposal System (EPADS) generated document | © 2026

File:KM004115_00032221_K0_1

COELME
COSTRUZIONI ELETTROMECCANICHE-SPA
Coelme - Via G.Galilei, 1/2 - 30036 S.Maria di Sala (VE) - Italia
Egic - 60b, rue L. et R. Desgrand - 69625 Villeurbanne cedex - France
: +39 041 486 022
: +39 041 486 909
Southern States Group
egic
: +33 472 66 20 80
: +33 472 39 08 65

(1) N° (2)		U_r (3) kV	I_r (4) A	
(5)	I_k (6) kA	t_k (7) s	.	
(8)	U_p (9) kV	U_s (10) kV	f_r 50/60 Hz	
T (11) °C	Alt (12) m	I_r (13) A	U_r (14) V	
.				

65

165

MATERIAL: ALUMINIUM ALLOY

(1)	(2)	(3) Ur	(4) Ir	(5)	(6) Ik	(7) tk	(8)	(9) Up	(10) Us		(11) T	(12) Alt.	(13) Ir	(14) Ur
Type	Serial number	Rated Voltage [kV]	Rated current [A]	Year of manufacturing	Rated short-time withstand curr. [kA]	Rated short-time curr. duraction [s]	Mechanical endurance class	BIL to earth [kV]	SIL to earth [kV]	Frequency [Hz]	Temperature of use [°C]	Altitude of use [m a. s. l.]	Rated bus-transfer current (for DS's) [A]	Rated bus-transfer voltage (for DS's) [V]
CBD	C42386÷C42405	245	2000	2007	40	3	M0	1050	- *	50/60	-25° /+40°	⩽ 1000	- *	- *
CBD-E	C42406÷C42413	245	2000	2007	40	3	M0	1050	- *	50/60	-25° /+40°	⩽ 1000	- *	- *
CBD	C42414÷C42421	145	2000	2007	40	3	M0	650	- *	50/60	-25° /+40°	⩽ 1000	- *	- *
CBD-E	C42422÷C42441	145	2000	2007	40	3	M0	650	- *	50/60	-25° /+40°	⩽ 1000	- *	- *

* Not applicable

Rev	Description	Drawn	Checked	Date
B	Added serial number - Final issue	SIMONATO	RIFFATTO	19/05/2007
A	First issue	RIFFATTO	MAGGIORA	29/03/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

DISCONNECTOR
PLATE (NAMEPLATE)


Format:	Standard:	Scale:	Language:
A3		1:1	ENG
	Revision: B	Sheet/of: 1/1	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KP003988

File: KP003988_00030771_P0_1

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

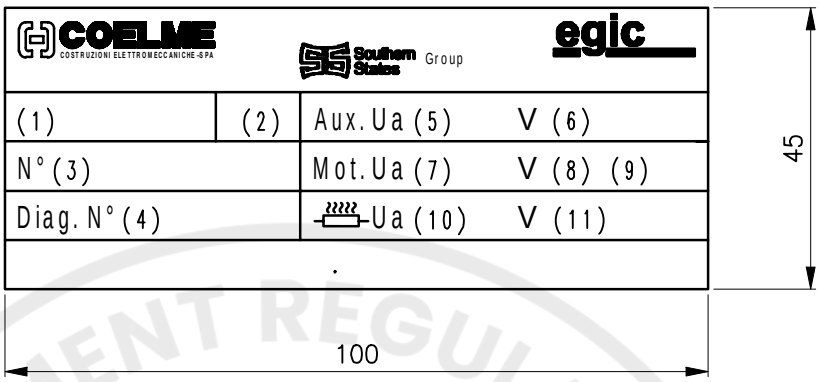

MATERIAL: METALIZED POLYESTER
fixed inside the case

(1) Type	(2) Year of Manufact.	(3) Serial number	(4) Electric Diagram	(5) Rated voltage of Auxiliaries	(6) Rated frequency of Auxiliaries	(7) Rated voltage of Motor(s)	(8) Rated frequency of Motor(s)	(9) Phases	(10) Rated voltage of Heater(s)	(11) Rated frequency Heater(s)
CD201	2007	30980÷30987	KCO00643	220	DC	400	AC	3~	230	50 Hz
CD101	2007	30940÷30959	KCO00644	220	DC	400	AC	3~	230	50 Hz
CD201	2007	30988÷30995	KCO04666	220	DC	400	AC	3~	230	50 Hz
CD101	2007	30960÷30979	KCO04667	220	DC	400	AC	3~	230	50 Hz

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Rev	Description	Drawn	Checked	Date
C	Modified 132 kV DS Mechanisms	LORENZON	RUFFATO	30/07/2007
B	Added serial number - Final issue	SIMIONATO	RUFFATO	18/05/2007
A	First issue	RUFFATO	MAGAGNA	28/03/2007

Checked according ISO 9000 procedures

MOTOR OPERATING MECHANISM TYPE PLATE (NAMEPLATE)

Format:	Standard:	Scale:	Language:
A4		1:1	ENG
	Revision: C	Sheet/of: 1/1	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KP003989

File:KP003989_00030772_P0_2

220 kV Subst. Disconnector Motor Circuit Diagram VATECH

VA TECH HYDRO

REMARK FOR APPROVAL:

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :

HHC

HIGH HEAD HYDROPOWER CONSULTANT
JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT

ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

Index	Sheet	Revision	Date	Name	Check	Appr.
B1	All	As Manufactured	04.07.2008	Schn	Dastl	
B	1 – 5	Revision acc. to HHC letter and new type	7.9.2006	Holzapfel	Dastl	
A	1-5	Revision acc. to letter HHC/AE06/VATech/PM/05-011	8.3.2005	Holzapfel	Dastl	

PURCHASER	ALLGEMEIN/GENERAL	DRAWN	02.12.2004	HOLZAPFE	REV/DATE		FILE	AE06-VTH-DD-10-
PLANT	ALLGEMEIN/GENERAL	CHECK	02.12.2004	DASTL	B1	04.07.08	DATE	15.07.2008
PROJECT-No.	..	APPR.	. .	LH-DE			SHEET	1 OF 6

VA TECH HYDRO	HYDRO VIENNA	DOC No. VATECH No.	AE06-VTH-DD-10-ADA 33-000007002-B1

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

220 kV Subst. Disconnector Motor Circuit Diagram

List of Content

Title	Manufacturer / Type	Drawing No:	Revision
Motor Mechanism Type CD 101 Circuit Diagram (without Earthing Switch)	Coelme/ CD 101	KCO 00644	G
Motor Mechanism Type CD 201 Circuit Diagram (with Earthing Switch)	Coelme/ CD 201)	KCO 00643	I

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

LEGEND

M	- DRIVING MOTOR 230/400 Va.c. 50 Hz (+10% -15%) ≤ 500W - (Wired 400 Va.c.)
IAM	- MAGNETOTHERMIC CIRCUIT BREAKER
CA	- OPENING CONTACTOR 220 Vd.c.
CC	- CLOSING CONTACTOR 220 Vd.c.
Fa	- OPENING LIMIT SWITCH
Fc	- CLOSING LIMIT SWITCH
PA	- OPENING PUSH BUTTON
PC	- CLOSING PUSH BUTTON
MLD	- LOCAL-REMOTE SELECTOR SWITCH
BM	- INTERLOCKING SWITCH
RA	- ANTICONDENSATE RESISTANCE 230 Va.c. - 50 Hz (18 W)
RR	- HEATER 230 Va.c. - 50 Hz (18 W)
T	- THERMOSTAT
ESS	- ELECTROMAGNETIC INTERLOCKING DEVICE 220 Vd.c.
PSS	- RELEASE PUSH BUTTON FOR "ESS"
A-B	- AUXILIARY SWITCHES

INTERNAL WIRING - Cable 1.5 sqmm, colour Black, type N07V-K

Rev	Description	Drawn	Checked	Date
G	Final issue	PASTRELLO	RUFFATTO	05/09/2007
F	Revised as per Customer request	Oxo	RUFFATTO	06/08/2007
E	Added "X1" terminal block	SIMONATO	RUFFATTO	19/05/2007
D	Revised	RUFFATTO	MAGGIORA	28/03/2007

Rev	Description	Drawn	Checked	Date
C	Corrected motor power consumption - added "RR" heater and "T" thermostat - Added "Vac" protection	CHINELLATO	RUFFATTO	07/09/2006
B	**Revised as per Customer request**	LOGAZION	RUFFATTO	30/03/2004
A	**First issue**	LOGAZION	RUFFATTO	30/03/2004

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

AUXILIARY CONTACTS TIMING DIAGRAM

Type	Isolator main contacts	OPEN 0° / CLOSED 180°
B	All contacts	
A	All contacts	

Contacts shown OPEN — Contacts shown CLOSED

General tolerances according to 10.S 1

MOTOR OPERATING MECHANISM TYPE
CD 101- - ELECTRIC DIAGRAM


COELME COSTRUZIONI ELETTROMECCANICHE-SPA — egic

Members of VATECH group

Standard:	Scale:	Language:
KC000574	1:1	ENG
	Revision: G	Sheet/of: 1/2
Format: A3	KC000644	

File: KC000644_00007274_K0_6

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

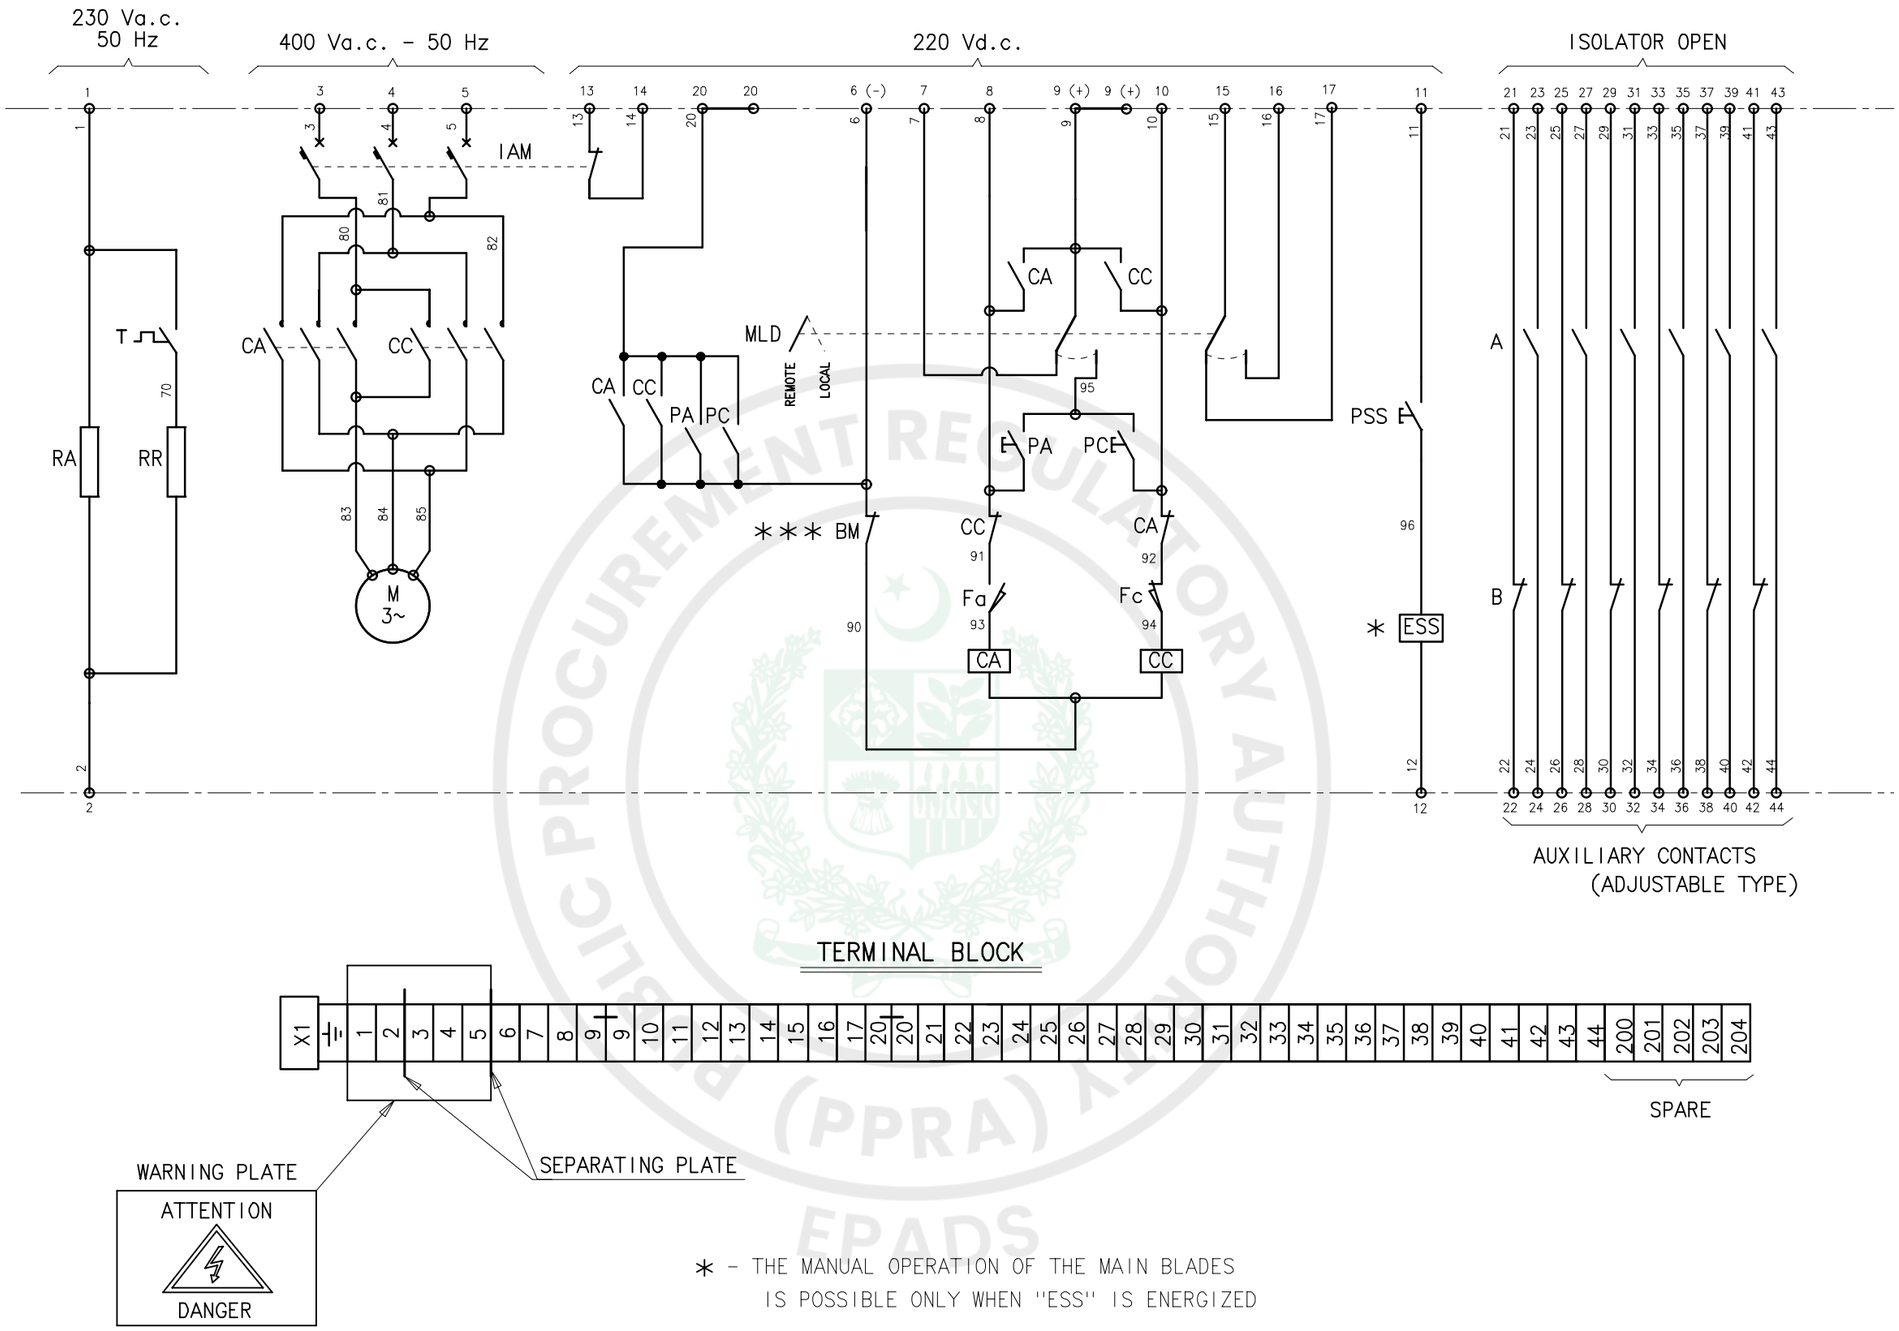

* - THE MANUAL OPERATION OF THE MAIN BLADES
IS POSSIBLE ONLY WHEN "ESS" IS ENERGIZED

*** - OPEN WITH DISCONNECTOR OPERATING CRANK INSERTED

Rev	Description	Drawn	Checked	Date
G	Final issue	PASTRELLO	RUFFATTO	05/09/2007
F	Revised as per Customer request	Oxro	RUFFATTO	06/08/2007
E	Added "X1" terminal block	SIMONATO	RUFFATTO	19/05/2007
D	Revised	RUFFATTO	MAGGIORA	28/03/2007
C	Corrected motor power consumption - added "RR" heater and "T" thermostat - Added "Vac" protection	CHINELLATO	RUFFATTO	07/09/2006
B	Revised as per Customer request	LUCREZIA	RUFFATTO	30/07/2004
A	First issue	LUCREZIA	RUFFATTO	30/03/2004

MOTOR OPERATING MECHANISM TYPE
CD 101- - ELECTRIC DIAGRAM

COELME COSTRUZIONI ELETTROMECCANICHE-SPA
egic
Members of VATECH group

General tolerances according to ISO 1

Standard:	Scale:	Language:
KC000574	1:1	ENG
	Revision: G	Sheet/of: 2/2
Format: A3	KC000644	

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File: KC000644_00007273_K0_6

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

Rev	Description	Drawn	Checked	Date
I	Final issue	PASTRELLO	RUFFATTO	05/09/2007
H	Revised	PASTRELLO	RUFFATTO	08/08/2007
G	Revised as per Customer request	Oare	RUFFATTO	06/08/2007
F	Added "X1" terminal block	SIMONATO	RUFFATTO	18/05/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

LEGEND

M	- DRIVING MOTOR 230/400 Va.c. 50 Hz (+10% -15%) ≤ 500W - (Wired 400 Va.c.)
IAM	- MAGNETOTHERMIC CIRCUIT BREAKER
CA	- OPENING CONTACTOR 220 Vd.c.
CC	- CLOSING CONTACTOR 220 Vd.c.
Fa	- OPENING LIMIT SWITCH
Fc	- CLOSING LIMIT SWITCH
PA	- OPENING PUSH BUTTON
PC	- CLOSING PUSH BUTTON
MLD	- LOCAL-REMOTE SELECTOR SWITCH
BM	- INTERLOCKING SWITCH
RA	- ANTICONDENSATE RESISTANCE 230 Va.c. - 50 Hz (18 W)
RR	- HEATER 230 Va.c. - 50 Hz (18 W)
T	- THERMOSTAT
ESS	- ELECTROMAGNETIC INTERLOCKING DEVICE 220 Vd.c.
PSS	- RELEASE PUSH BUTTON FOR "ESS"
EST	- ELECTROMAGNETIC INTERLOCKING DEVICE 220 Vd.c.
PST	- RELEASE PUSH BUTTON FOR "EST"
A-B	- AUXILIARY SWITCHES OF MAIN BLADES
C-D	- AUXILIARY SWITCHES OF EARTHING BLADES

INTERNAL WIRING - Cable 1.5 sqmm, colour Black, type N07V-K

AUXILIARY CONTACTS TIMING DIAGRAM

Type	Isolator main contacts	OPEN / CLOSED (0° – 180°)
B	All contacts	
A	All contacts	

Contacts shown OPEN — Contacts shown CLOSED

Rev	Description	Drawn	Checked	Date
E	Added "EST".	RUFFATTO	MAGGIORA	02/04/2007
D	Revised .	RUFFATTO	MAGGIORA	28/03/2007
C	Corrected motor power consumption - added "RR" heater and "T"	CHINELLATO	RUFFATTO	07/09/2006
	thermostat - Added "Vac" protection - Deleted "EST"			

General tolerances according to 10.S 1


MOTOR OPERATING MECHANISM TYPE
CD201- - ELECTRIC DIAGRAM

COELME COSTRUZIONI ELETTROMECCANICHE-SPA — egic

Members of VATECH group

Standard:	Scale:	Language:
KC000574	1:1	ENG
	Revision: I	Sheet/of: 1/2
Format: A3	KC000643	

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

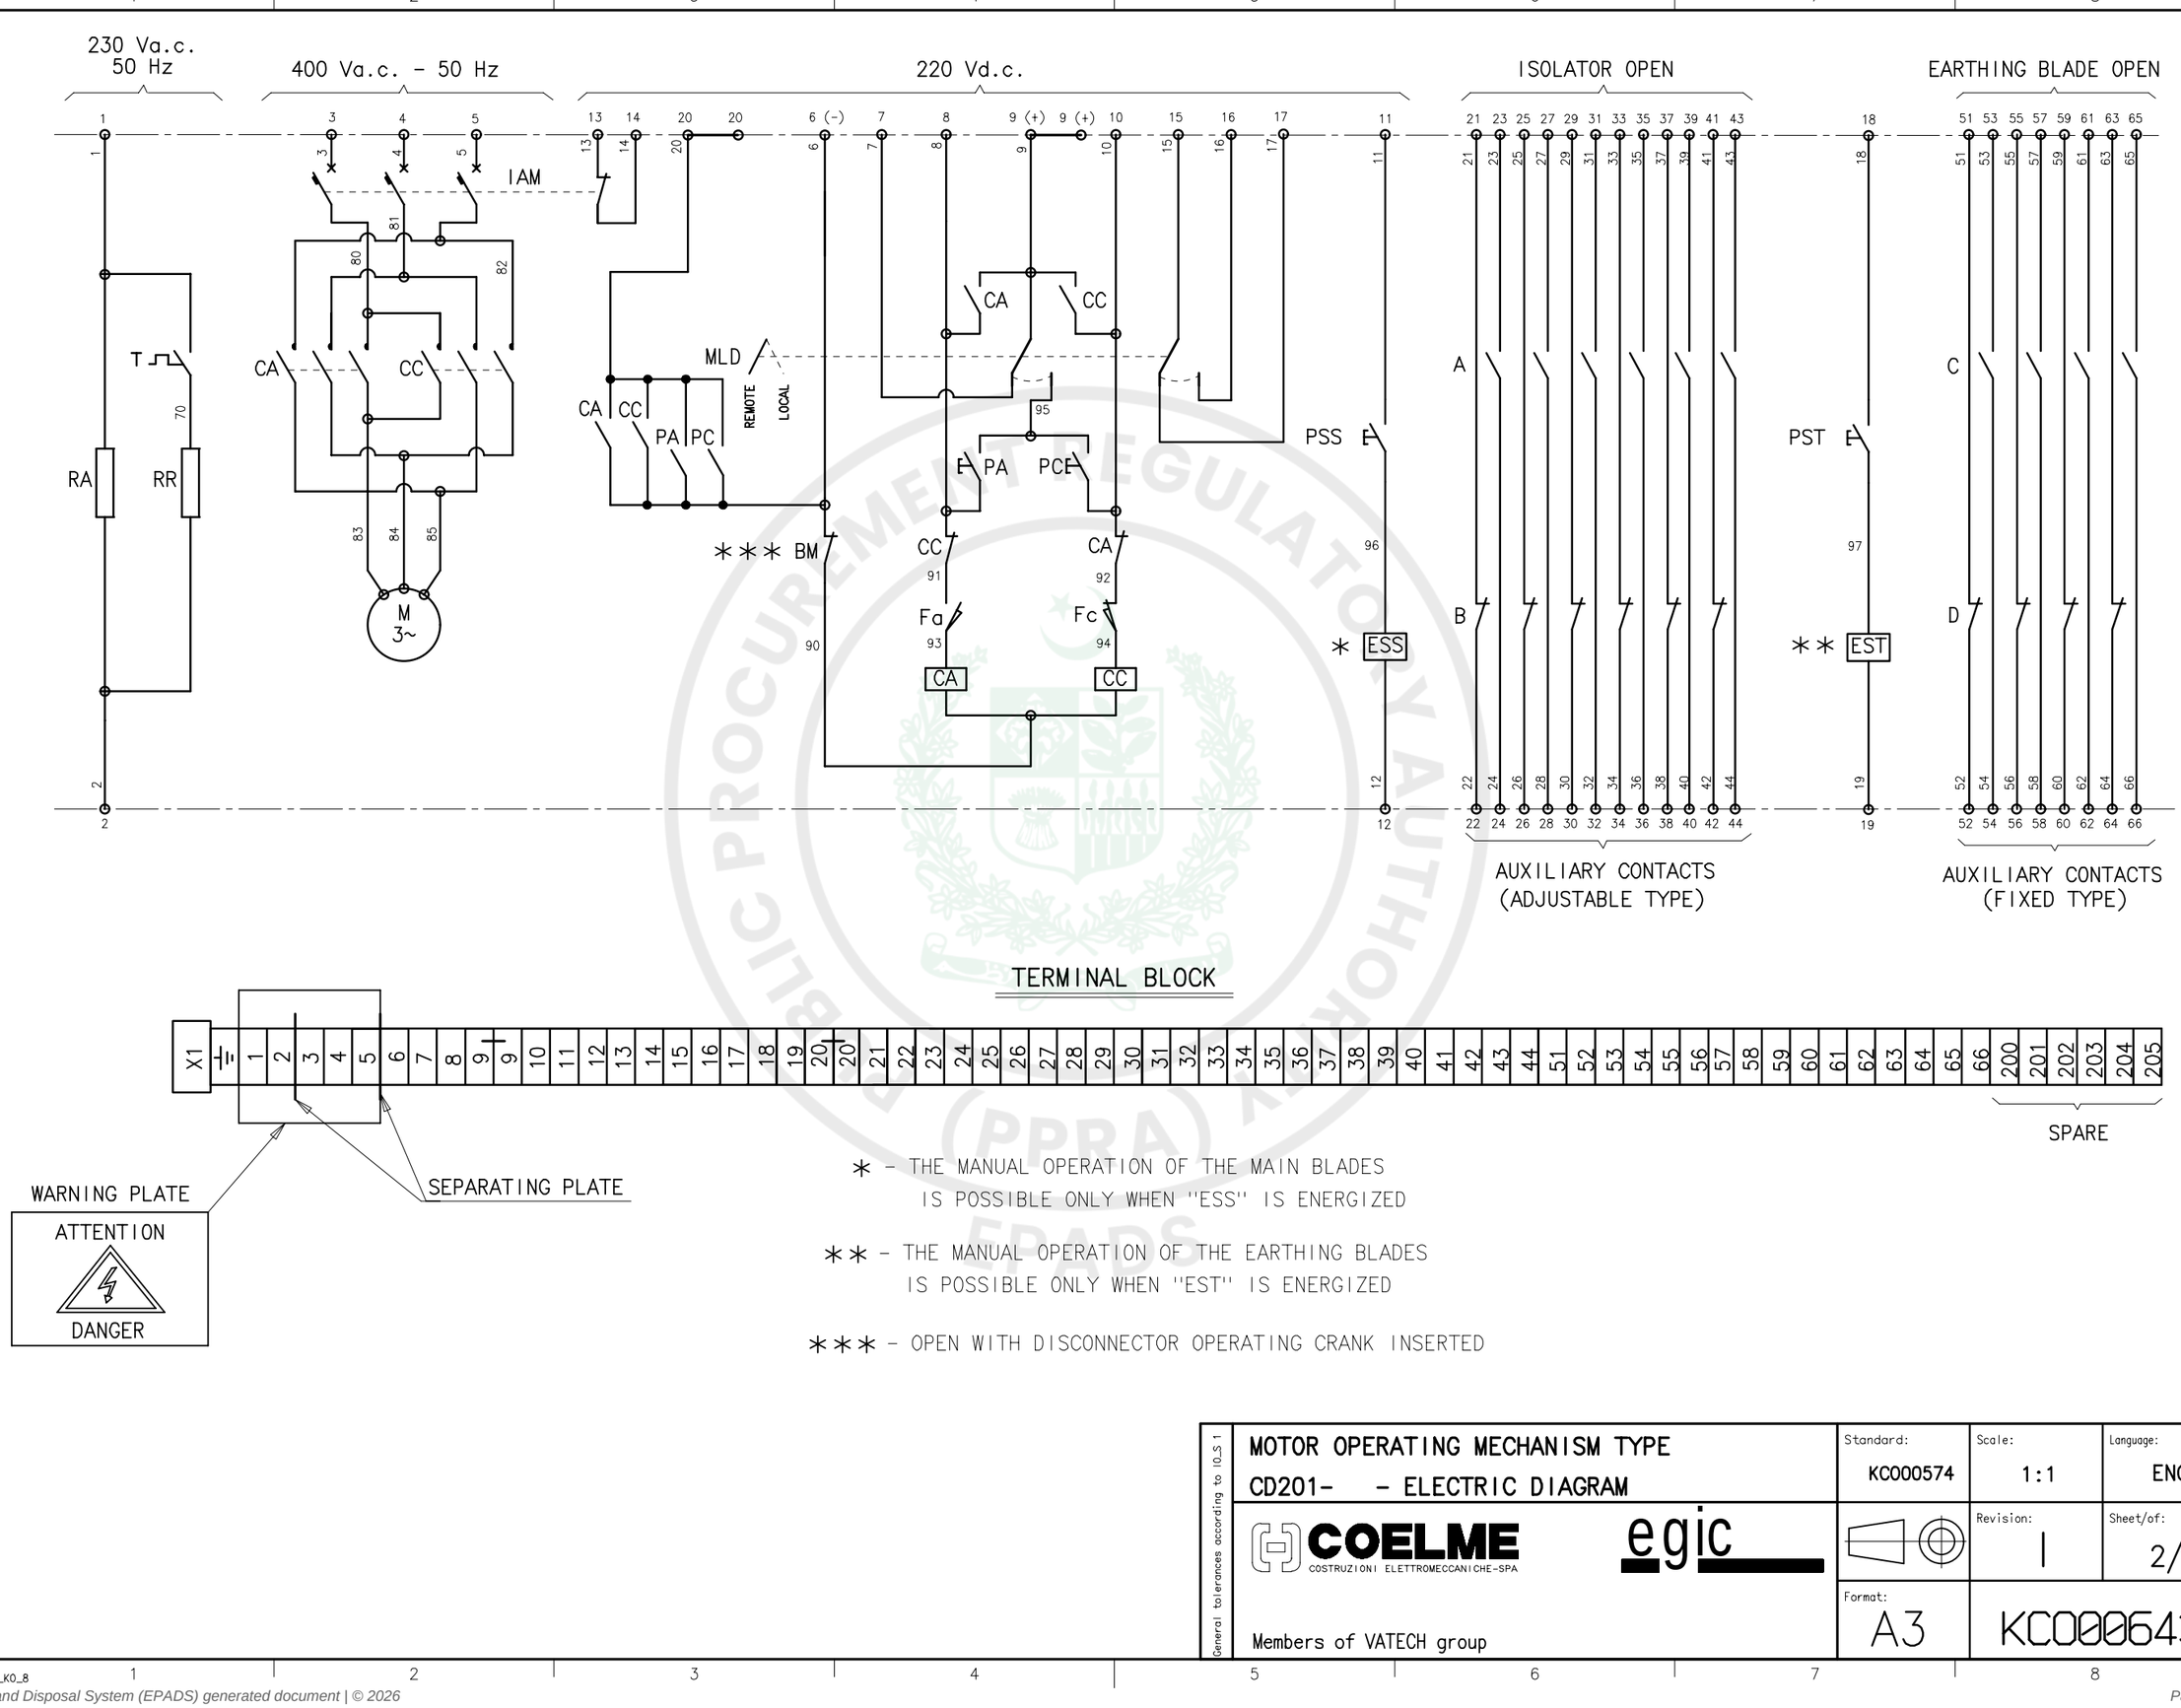

Rev	Description	Drawn	Checked	Date
I	Final issue	PASTRELLO	RUFFATTO	05/09/2007
H	Revised	PASTRELLO	RUFFATTO	08/08/2007
G	Revised as per Customer request	Oxro	RUFFATTO	06/08/2007
F	Added "X1" terminal block	SIMONATO	RUFFATTO	18/05/2007
E	Added "EST".	RUFFATTO	MAGGIORA	02/04/2007
D	Revised .	RUFFATTO	MAGGIORA	28/03/2007
C	Changed motor power consumption - added "RR" heater and "T" thermostat - Added "Vac" protection - Deleted "EST"	CHIMELLATO	RUFFATTO	07/09/2006

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

General tolerances according to ISO 1

MOTOR OPERATING MECHANISM TYPE
CD201- - ELECTRIC DIAGRAM

COELME COSTRUZIONI ELETTROMECCANICHE-SPA
egic
Members of VATECH group

Standard:	Scale:	Language:
KC000574	1:1	ENG
	Revision: I	Sheet/of: 2/2
Format: A3	KC000643	


File: KC000643_00007272_K0_8

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026


This drawing is the PROPERTY of
VA TECH T&D GmbH & Co
Penzingerstraße 76
A-1141 VIENNA AUSTRIA

Note protection DIN 34 !


VIEW X

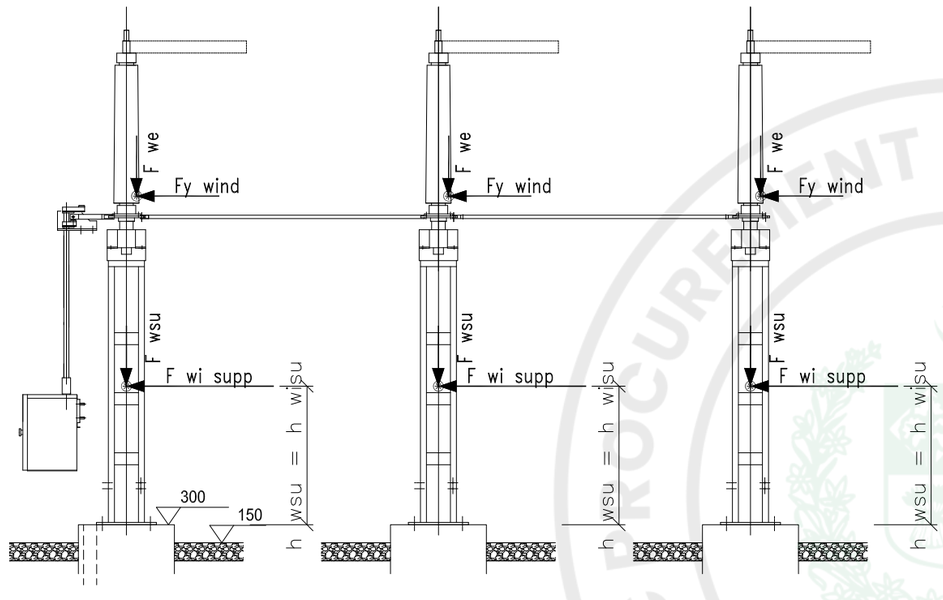

Foundation

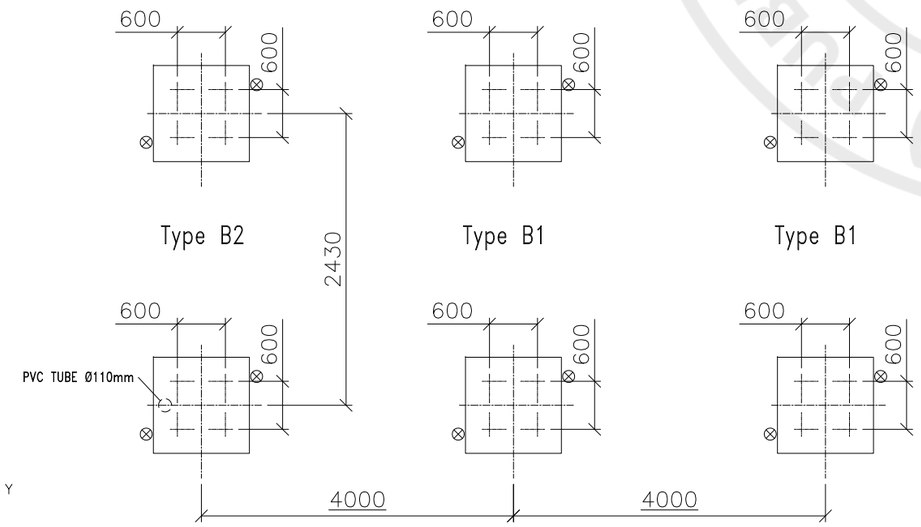

VIEW Y

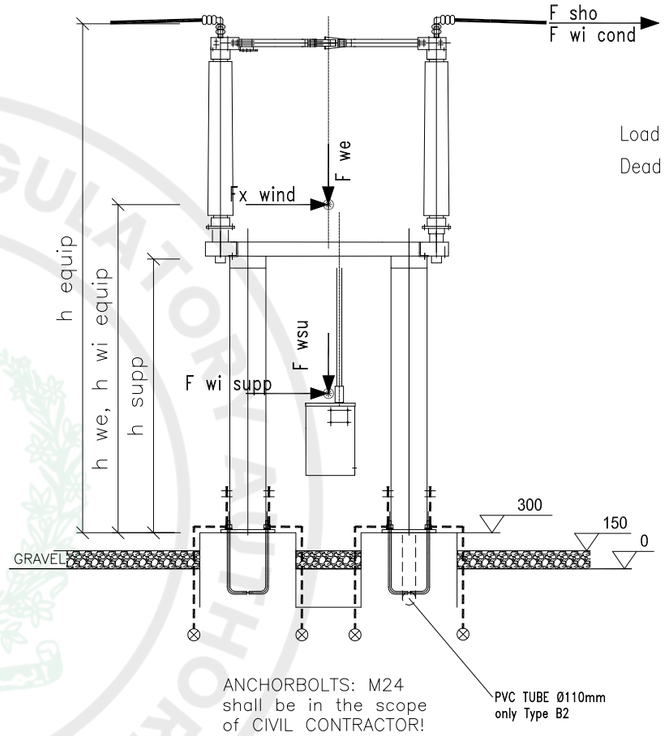

Load case:
Dead Weight + Wind + Short Circuit

F we	Dead weight Pole	5835 N
F wsu	Dead weight Support	4540 N
F sho	Short Circuit Load (Dyn. Load)	4435 N
F wi cond	Wind Load on Conductor	308 N
Fx wind	Wind Load on Equipment	534 N
Fy wind	Wind Load on Equipment	1211 N
F wi supp	Wind Load on support	5030 N
h equip	Height of Equipment	5960 mm
h supp	Height of Support	3200 mm
h wi equip	Center of Equipment	4580 mm
h wsu	Center of Support Gravity	1600 mm

				Drawn	23.04.07	SCHN	Purchaser: Pakistan W&P Authority	
				Checked			Plant: Allai Khwar	
				Approved		PA4	Proj. N°: C243 38 014	
M	Description of modification	Date	Drawn	Scale			Filedate: 13.11.07	Filename:

VA TECH T&D GmbH & Co — Projects

220kV Switchyard
Foundation Details & Loads
Disconnector

B1, B2
AE06-VTH-DD-10


ADA-01-000007002- | A2 | Sht 4 of 13 | A3

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026


This drawing is the PROPERTY of
VA TECH T&D GmbH & Co
Penzingerstraße 76
A-1141 VIENNA AUSTRIA

Note protection DIN 34 !


VIEW X

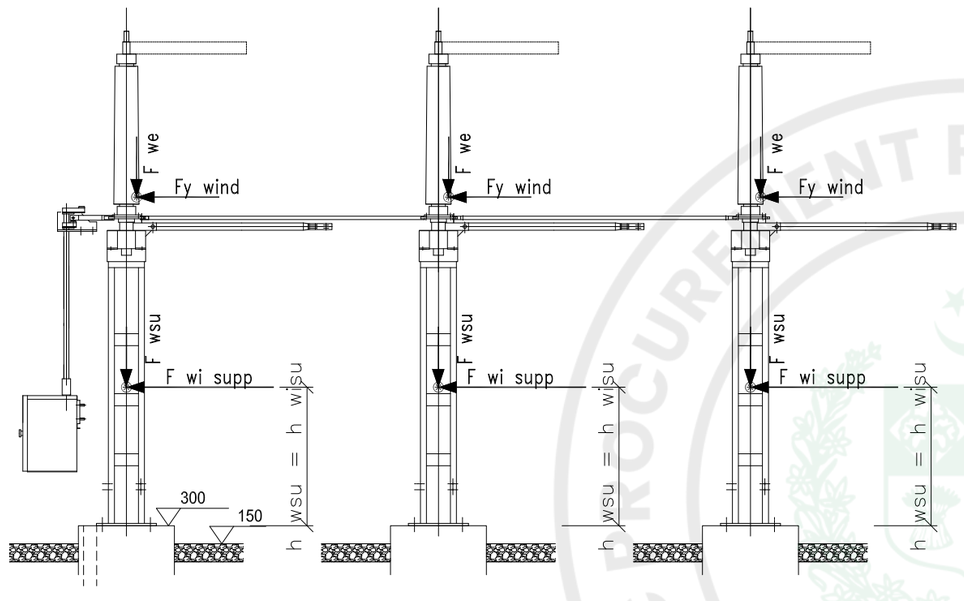

Foundation

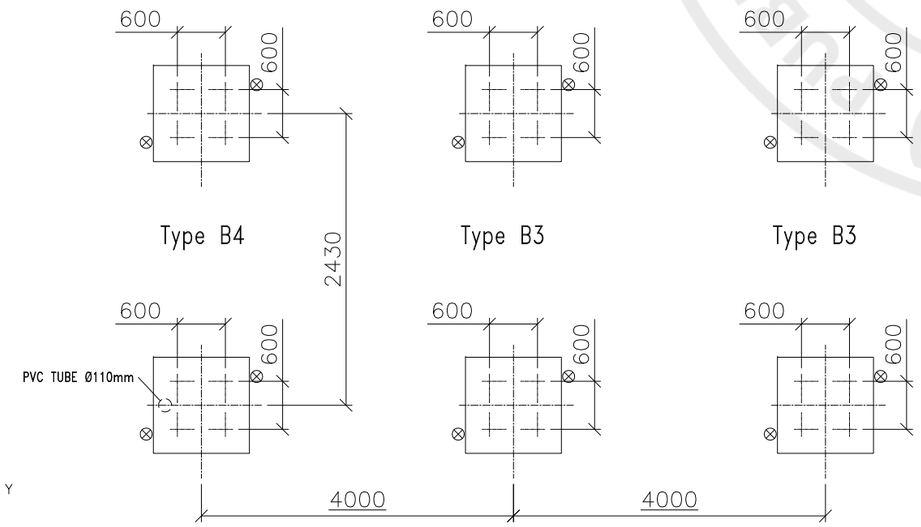

VIEW Y

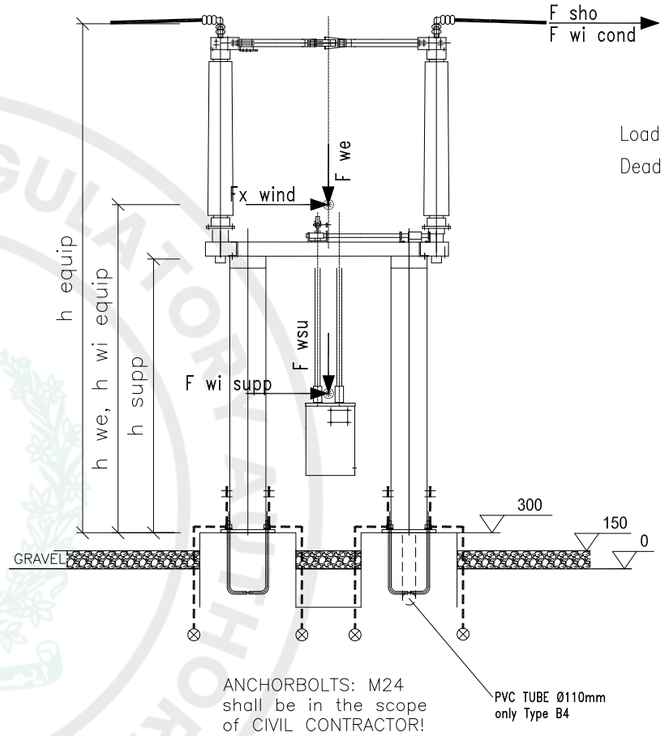

Load case:
Dead Weight + Wind + Short Circuit

F we	Dead weight Pole	6270 N
F wsu	Dead weight Support	3770 N
F sho	Short Circuit Load (Dyn. Load)	4435 N
F wi cond	Wind Load on Conductor	308 N
Fx wind	Wind Load on Equipment	648 N
Fy wind	Wind Load on Equipment	1211 N
F wi supp	Wind Load on support	4620 N
h equip	Height of Equipment	5960 mm
h supp	Height of Support	3200 mm
h wi equip	Center of Equipment	4580 mm
h wsu	Center of Support Gravity	1600 mm

				Drawn	23.04.07	SCHN	Purchaser: Pakistan W&P Authority	
				Checked			Plant: Allai Khwar	
				Approved		PA4	Proj. N°: C243 38 014	
M	Description of modification	Date	Drawn	Scale			Filedate: 13.11.07	Filename:

A3eng


VA TECH T&D GmbH & Co — Projects


220kV Switchyard
Foundation Details & Loads
Disconnector w. ESW


B3, B4
AE06-VTH-DD-10

ADA-01-000007002- | A2 | Sht 5 of 13 | A3


e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

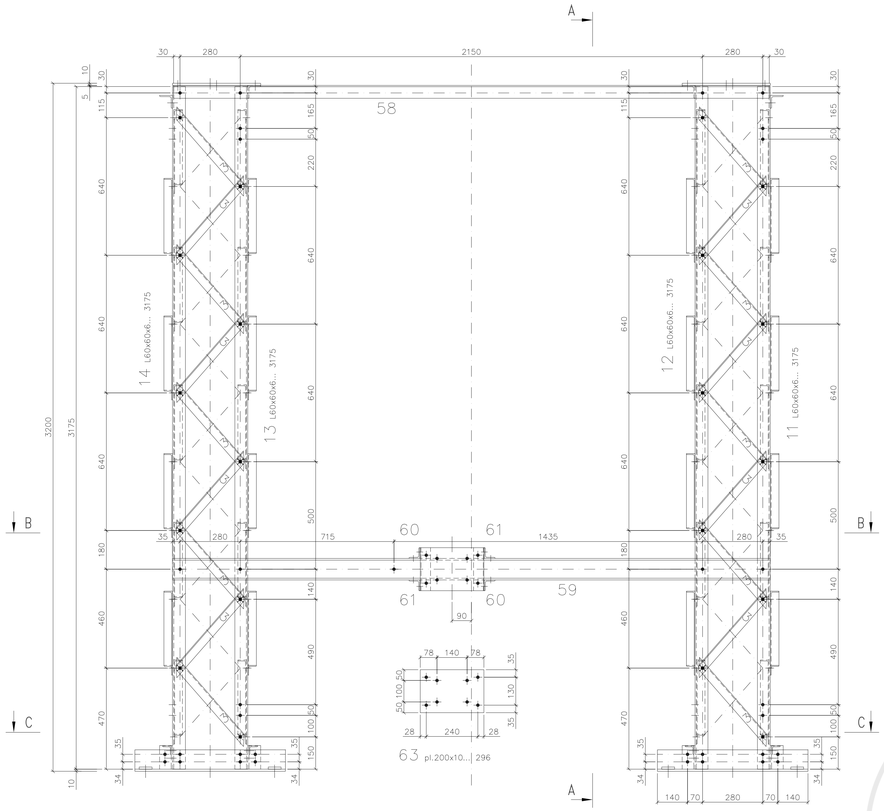


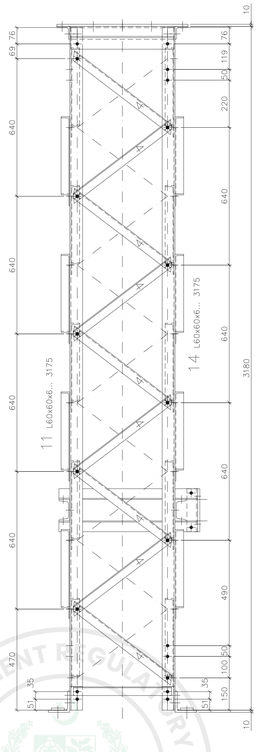

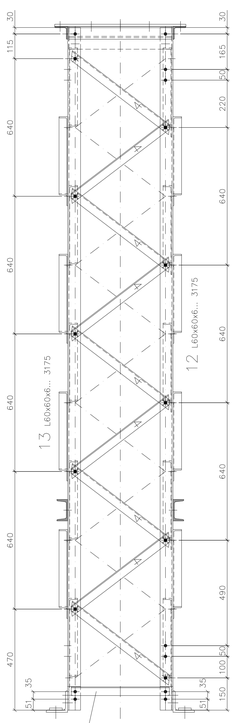



















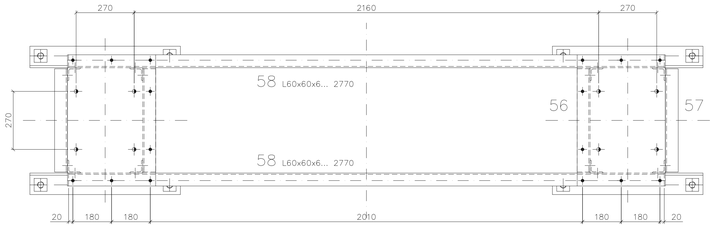















SECTION A–A

SECTION B–B

SECTION C–C

There are considered the following standards, if not in a different way given !

material:	S 235 JR
bolt quality:	5.8
HOT DIP GALVANIZED	

ø14	M12
ø18	M16
ø22	M20

L80x80	SM 45
L70x70	SM 40
L60x60	SM 35
L50x50	SM 30
L40x40	SM 25

SM

Weight: 454 kg

INDEX	REV. N° (SHEET)	N° ALT.	MODIFICATION	DATE	NAME	DATE	APPROVED
A0			First issue	22.10.07	SOHN	22.10.07	AE-PA4

REFERENCE DRAWINGS

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER : HHC — HIGH HEAD HYDROPOWER CONSULTANT JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT
ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

PURCHASER	PROJECT N° C24338014
PLANT Allai Khwar	CONTRACT N°
220kV Switchyard Disconnector with drive Steel Structure Drawing	= + CUSTOMER N° AE06-VTH-DD-10

	DATE	NAME	SCALE
DRAWN	22.10.2007	SOHN	1:10
CHECK			
APPROVED		AE-PA4	

ISO / R 128 EUROPA

SP. DATUM | MODEL | WEIGHT | MATERIAL


VA TECH HYDRO


DRAWING N° ADA-28-000007008- IND. A0


SHEET 1 OF 2

This drawing is the PROPERTY of
VA TECH HYDRO GmbH & Co
Penzingerstrasse 76
A-1141 Wien AUSTRIA
Note protection DIN 34 !

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

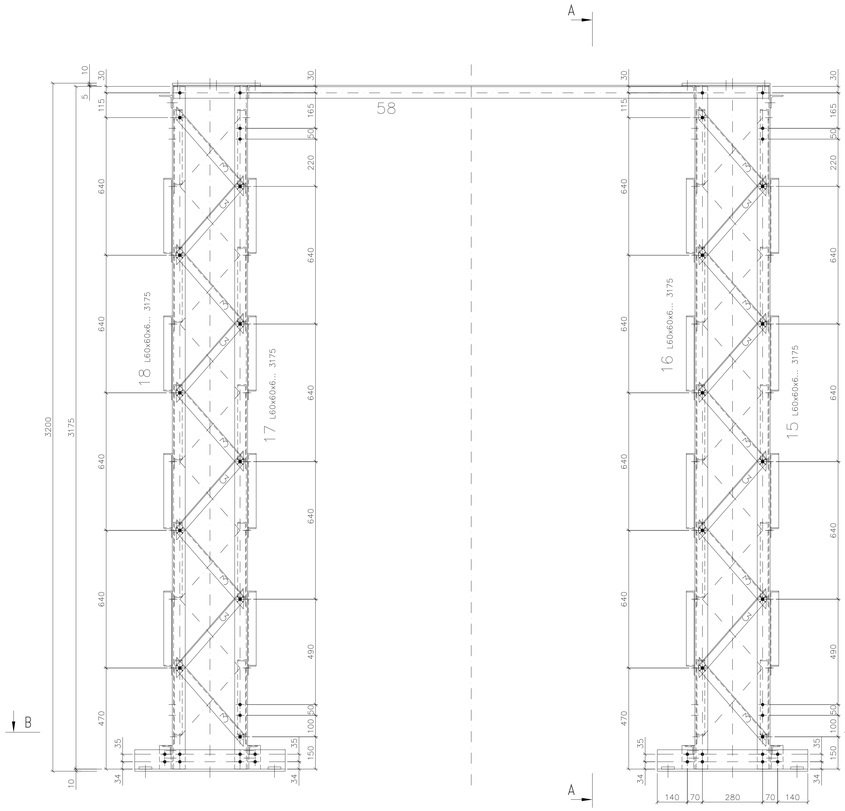

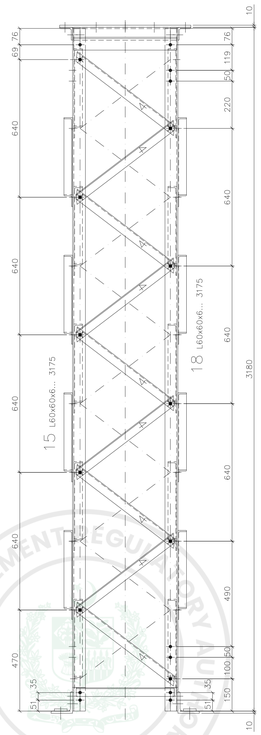


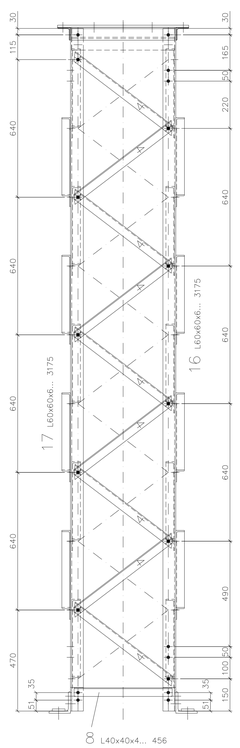


SECTION A–A


8 L40x40x4... 456
18+420+18


51 L100x100x10...700
mat. quality S355J0








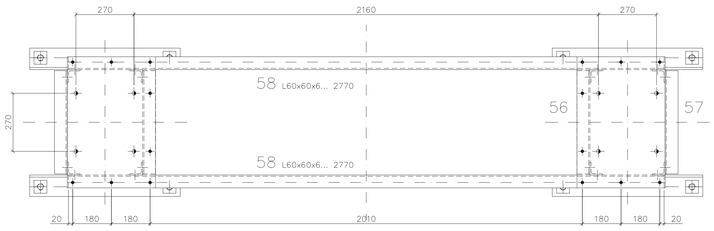









SECTION B–B





There are considered the following standards,
if not in a different way given !

material: S 235 JR
bolt quality: 5.8
HOT DIP GALVANIZED

ø14	M12
ø18	M16
ø22	M20

L80x80	SM 45
L70x70	SM 40
L60x60	SM 35
L50x50	SM 30
L40x40	SM 25

SM

Weight: 377 kg

INDEX	REV. N° (SHEET)	N° ALT.	MODIFICATION	DATE	NAME	DATE	APPROVED
A0			First Issue	22.10.07	SOHN	22.10.07	AE-PA4

REFERENCE DRAWINGS

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER : HHC
HIGH HEAD HYDROPOWER CONSULTANT JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT
ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

PURCHASER
PLANT: Allai Khwar
PROJECT N°: C24338014
CONTRACT N°:

220kV Switchyard
Disconnector
Steel Structure Drawing

CUSTOMER N°: AE06-VTH-DD-10

	DATE	NAME
DRAWN	22.10.2007	SOHN
CHECK		
APPROVED		AE-PA4

SCALE 1:10

ISO / R 128 EUROPA

SP. DATUM | MODEL | WEIGHT | MATERIAL

VA TECH HYDRO

DRAWING N°: ADA-28-000007008- | IND. A0

SHEET 2 OF 2

This drawing is the PROPERTY of
VA TECH HYDRO GmbH & Co
Penzingerstrasse 76
A-1141 Wien AUSTRIA
Note protection DIN 34 !

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

REMARK FOR APPROVAL:

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :

HHC

HIGH HEAD HYDROPOWER CONSULTANT
JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT

ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

Index	Sheet	Revision	Date	Name	Check	Appr.
B1	2	As manufactured	18.07.08	Schn.	Dastl	
B	2	Change of Type and rated voltage	29.08.06	Holzapfel	Dastl	Dastl
A	2	Change of the rated Current	3.5.2005	Holzapfel	Dastl	Dastl

PURCHASER	ALLGEMEIN/GENERAL	DRAWN	02.12.2004	HOLZAPFE	REV/DATE		FILE	DISCONNECTOR
PLANT	ALLGEMEIN/GENERAL	CHECK	02.12.2004	DASTL	B1	18.07.08	DATE	24.07.2008
PROJECT-No.	..	APPR.	. .	LH-DE			SHEET	1 OF 3

VA TECH HYDRO	HYDRO VIENNA	DOC No. VATECH No.	AE06-VTH-DD-10-AEA 04-000007002-B1

145 kV Isolating Switches		Guarantee values according to Attachment 5	Requirements according to C 1 & C 2	final
Description	**Unit**	**Value**		
Type				**CBD 145 - 2000**
Manfucturer				**Coelme**
Number of Pole		3	3	3
Class		III (anti-plution type)	25 mm / kV	25 mm / kV = 3625 mm creepage distance
Rated voltage	kV	132	132	132
Rated impulse withstand voltage				
- to earth	kV peak	275	650	650
- across the isolating distance	kV peak	315	not mentioned	750
Rated one minute power frequency withstand voltage, dry and wet				
- to earth	kV rms	650	not mentioned	275
- across the isolating distance	kV rms	750	not mentioned	315
Rated frequency	Hz	50	50	50
Rated normal current	A	2000	1600	**2000**
Rated short-time withstand current 1s.	kA arms	50	40	40
Maximum service voltage	kV rms	145	145	145
Rated dynamic current	kA peak	145	not mentioned	100
Maximum temperature rise of current carrying parts at rated current	K	338	not mentioned	65°
Number of aux. contacts				6NO + 6NC
Operating mechanism			Motor / manual	Motor / manual

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

145 kV Earthing Switches built on disconnector		Guarantee values according to Attachment 5	Requirements according to C 1 & C 2	final
Description	**Unit**	**Value**		
Type				***)**
Manfucturer				**Coelme**
Class		III (anti-pollution type)		
Rated voltage	kV	132	132	132
Rated impulse withstand voltage				
- to earth	kV peak	275	650	650
- across the isolating distance	kV peak	315	not mentioned	Not applicable
Rated one minute power frequency withstand voltage, dry and wet				
- to earth	kV rms	650	not mentioned	275
- across the isolating distance	kV rms	750	not mentioned	Not applicable
Rated frequency	Hz	50	50	50
Rated short-time withstand current 1s.	kA rms	50	40	40
Rated short-circuit making current	kA	NA		Not applicable
Number of aux. contacts			sufficient	4NO + 4NC
Operating mechanism			manual / local	manual / local

*) Remark: The Earthing switches are build-on the disconnectors according to the single line diagram and the type will be CBD-E 145 - 2000

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

REMARK FOR APPROVAL:

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :

HHC

HIGH HEAD HYDROPOWER CONSULTANT
JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT

ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

Index	Sheet	Revision	Date	Name	Check	Appr.
B2	all	as manufactured	23.06.2008	Schn	Dastl	
B1	all	Modification due to new Layout	2.11.2006	Dastl	Holzapfel	
B0	all	Modification due to new types	12.09.2006	Dastl	Holzapfel	

PURCHASER	ALLGEMEIN/GENERAL	DRAWN	02.12.2004	HOLZAPFE	REV/DATE		FILE	AE06-VTH-DD-10-
PLANT	ALLGEMEIN/GENERAL	CHECK	02.12.2004	DASTL	B2	23.06.2008	DATE	16.07.2008
PROJECT-No.	..	APPR.	. .	LH-DE			SHEET	1 OF 10

VA TECH HYDRO

HYDRO VIENNA


DOC No. VATECH No. AE06-VTH-DD-10-AEA 28-000007002-B2


This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.


List of Content


Title	Manufacturer / Type	Drawing No:	Revision
Outline Drawing of Center Break Disconnector, Parallel Arrangement (without Earthing Switch)	Coelme/ CBD 145 – 2000	KMO 04245	A
Outline Drawing of Center Break Disconnector, Line Arrangement (without Earthing Switch)	Coelme/ CBD-145 – 2000	KMO 04246	A
Outline Drawing of Center Break Disconnector, Parallel Arrangement (with Earthing Switch)	Coelme/ CBD-E-145 - 2000	KMO 04244	A
Disconnector Plate (Name Plate)	Coelme	KP 003988	B
Motor Operating Mechanism Type Plate (Name Plate)	Coelme	KP 003989	C

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

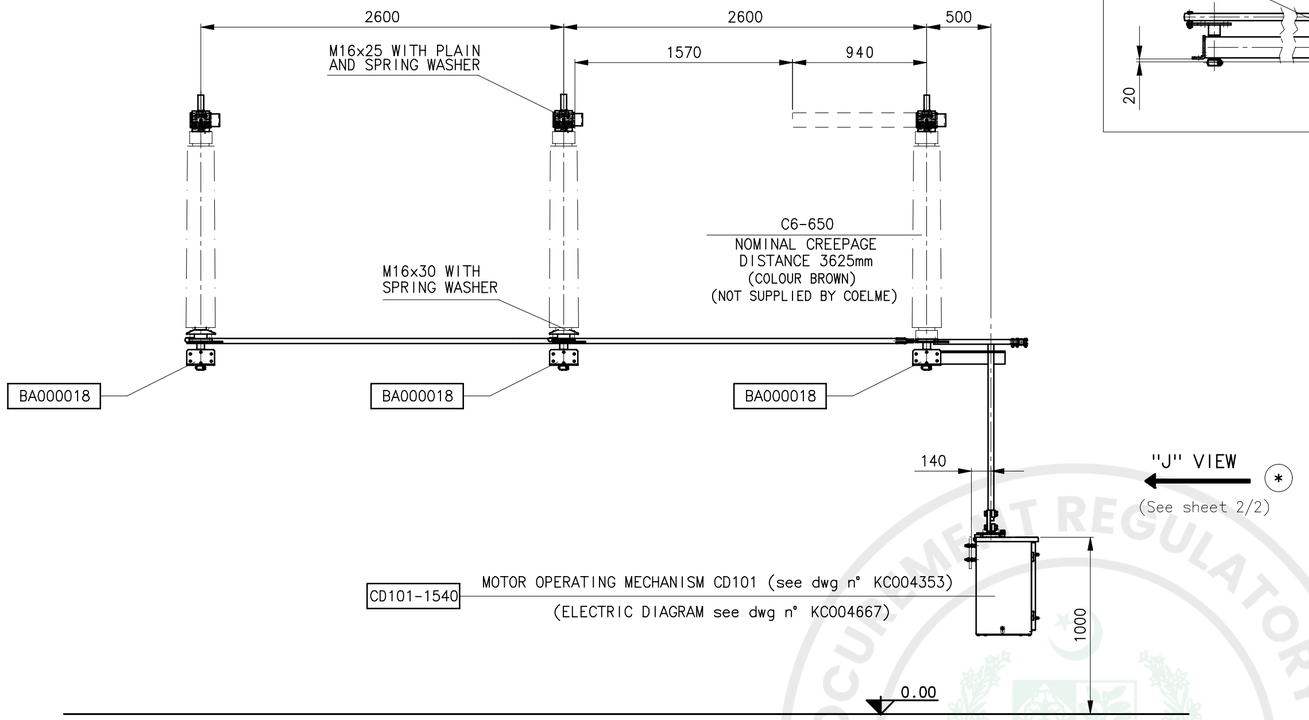

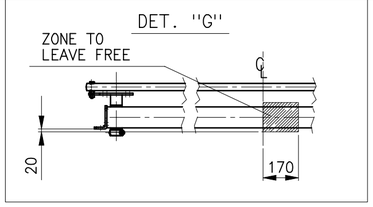

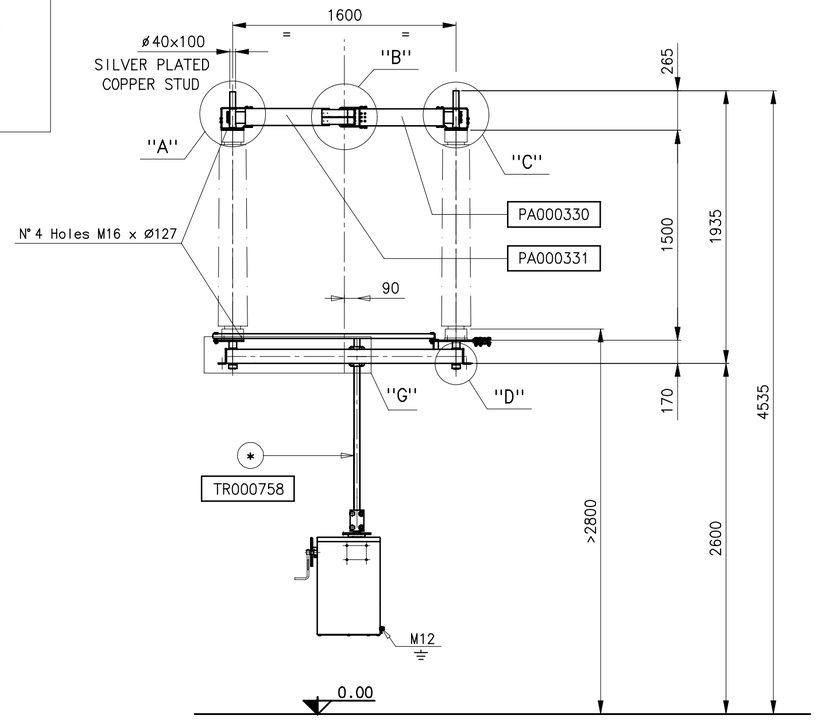


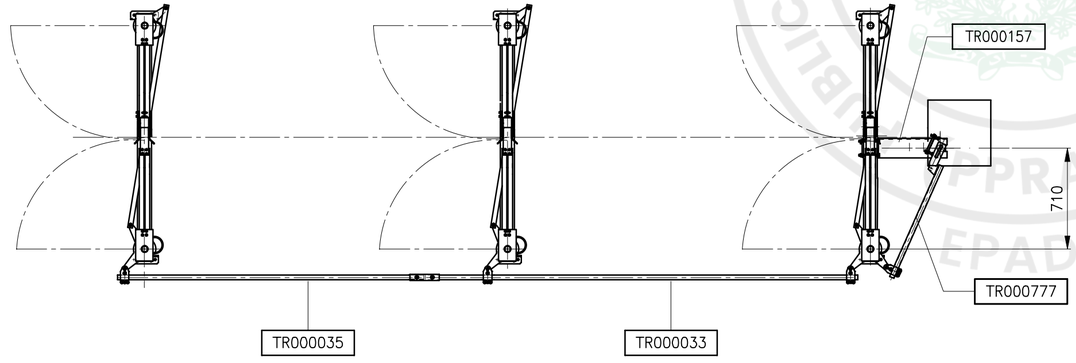



approximate weight of three pole isolator complete of operating rods,driving shaft and insulators : Kg 1100


approximate weight of motor operating mechanism : Kg 50


PA000330	ISOLATOR MALE ARM
PA000331	ISOLATOR FEMALE ARM
BA000018	BASE
TR000758	ISOLATOR DRIVING SHAFT
P0001173	LEVER
TR000033	POLES CONNECTING ROD
TR000035	POLES CONNECTING ROD
TR000157	SUPPORT
TR000777	ISOLATOR DRIVING ROD
CD101-1540	MOTOR OPERATING MECHANISM

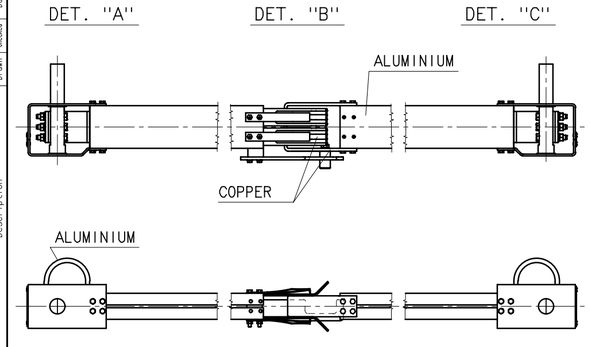

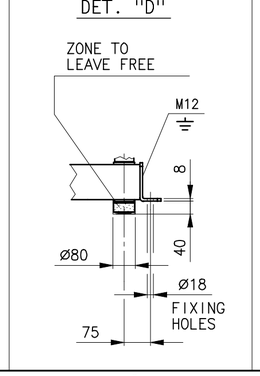

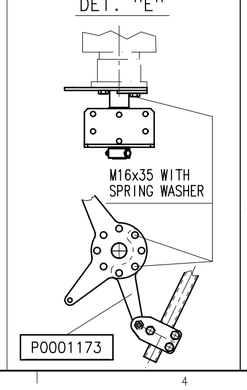

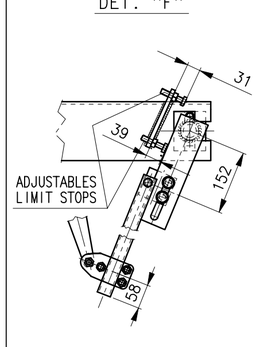

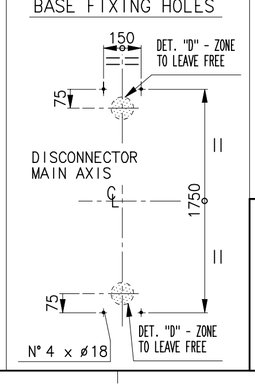

(*) VERTICAL SHAFT(S) TO BE CUT TO SIZE AT SITE

Checked according ISO 9000 procedures

DISCONNECTOR CBD 145-2000
(BIL650 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A2	KM003266	1:30	ENG
	Revision: A	Sheet/of: 1/2	


COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KM004245

Rev	Description	Drawn	Checked	Date
A	First issue	LIBERATO	RAFFATO	30/07/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File: KM004245_00033344_K0_0
e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

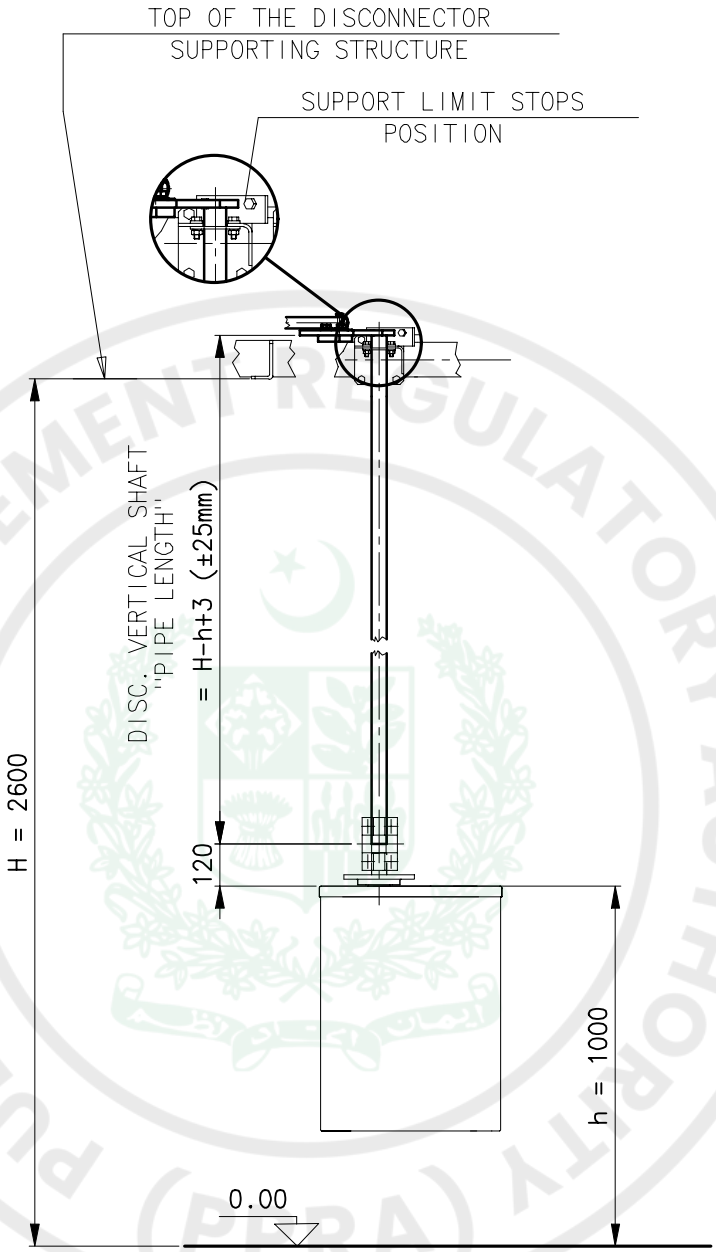

(*) "J" VIEW

DETAIL TO CUT
VERTICAL SHAFT(S) AT SITE

After cutting, protect the cut surface by spray zinc

Rev	Description	Drawn	Checked	Date
D	Added components list and sheet 2/2	SUNDARAM	RUFFATO	30/07/2007

Checked according ISO 9000 procedures

DISCONNECTOR CBD 145-2000
(BIL650 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A4	KM003266	1:20	ENG
	Revision: A	Sheet/of: 2/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA


egic


KM004245

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File:KM004245_00033345_K0_0


PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

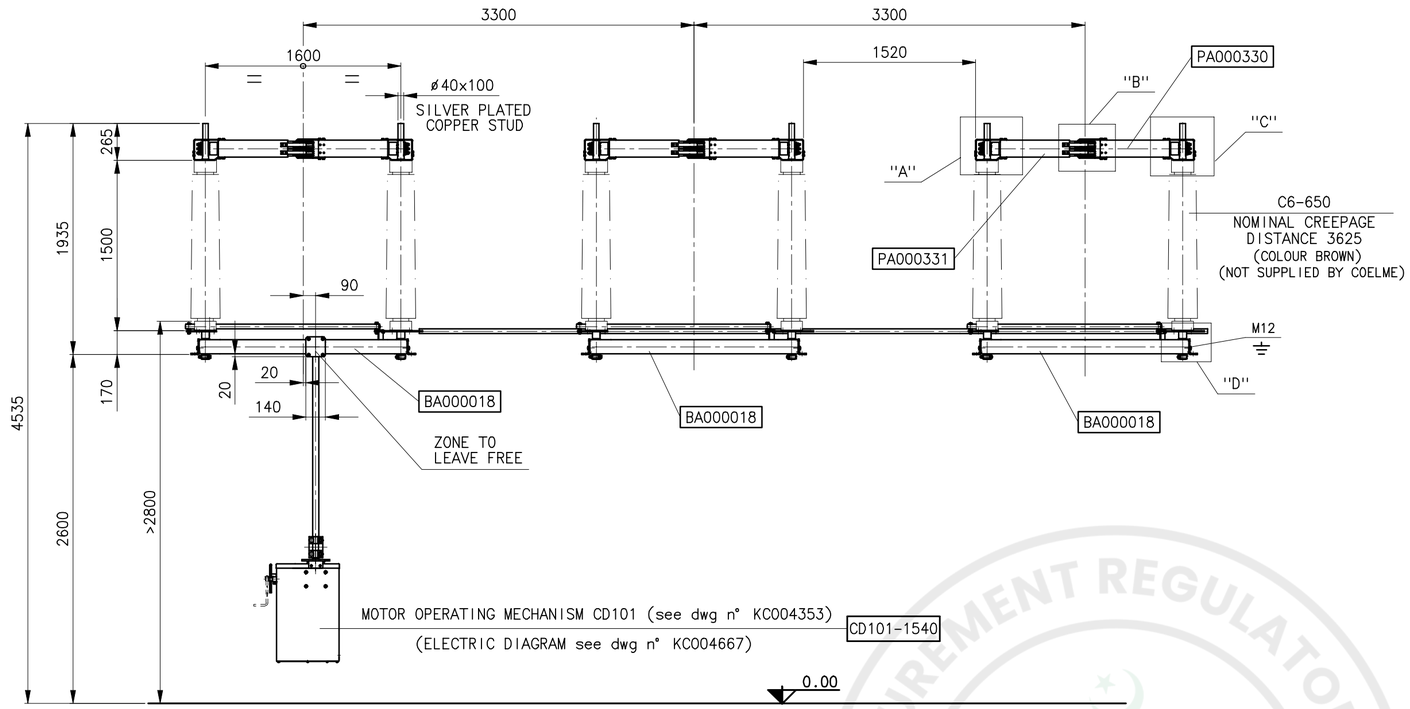

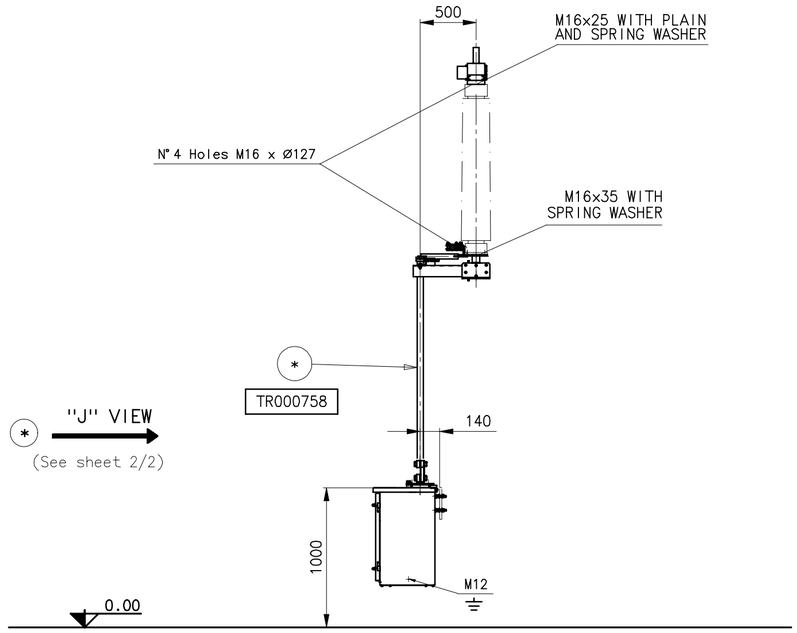



approximate weight for three pole isolator
complete of operating rods,driving shaft and insulators : Kg 1100


approximate weight of motor operating mechanism CD101 : Kg 50

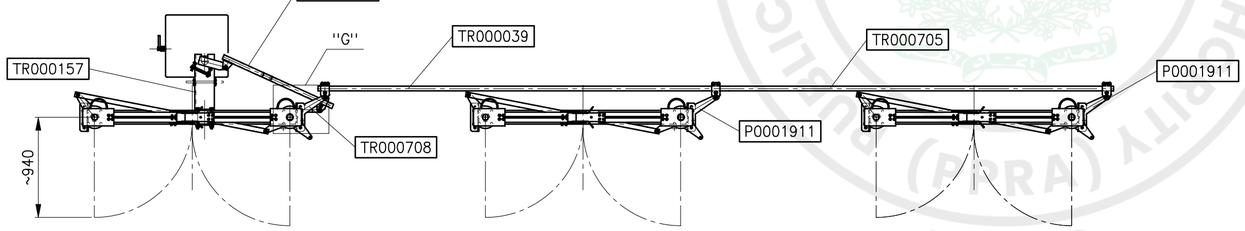



PA000330	ISOLATOR MALE ARM
PA000331	ISOLATOR FEMALE ARM
BA000018	BASE
TR000708	DOUBLE LEVER
P0001911	LEVER
TR000790	ISOLATOR DRIVING ROD
TR000039	POLES CONNECTING ROD
TR000705	POLES CONNECTING ROD
TR000157	SUPPORT
TR000758	ISOLATOR DRIVING SHAFT
CD101-1540	MOTOR OPERATING MECHANISM

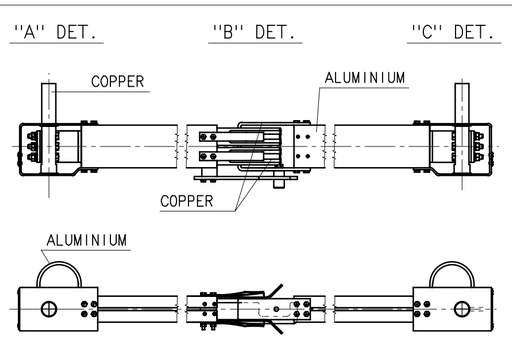

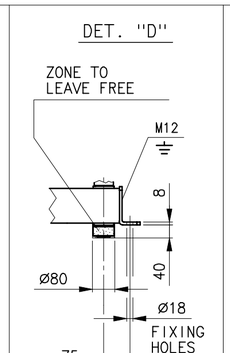

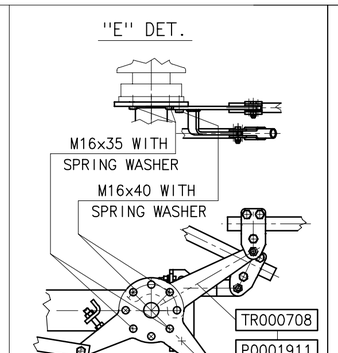

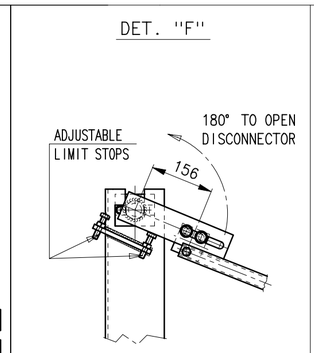

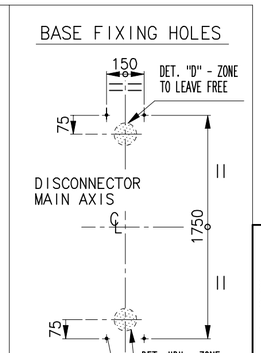

(*) VERTICAL SHAFT TO BE CUT TO SIZE AT SITE

DISCONNECTOR CBD 145-2000
(BIL650 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A2	KM003292	1:30	ENG
	Revision: A	Sheet/of: 1/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic


KM004246

Checked according ISO 9000 procedures

Rev	Description	Drawn	Checked	Date
A	First issue	LORENZIN	RAFFATO	30/07/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File: KM004246_00033346_K0_0
e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

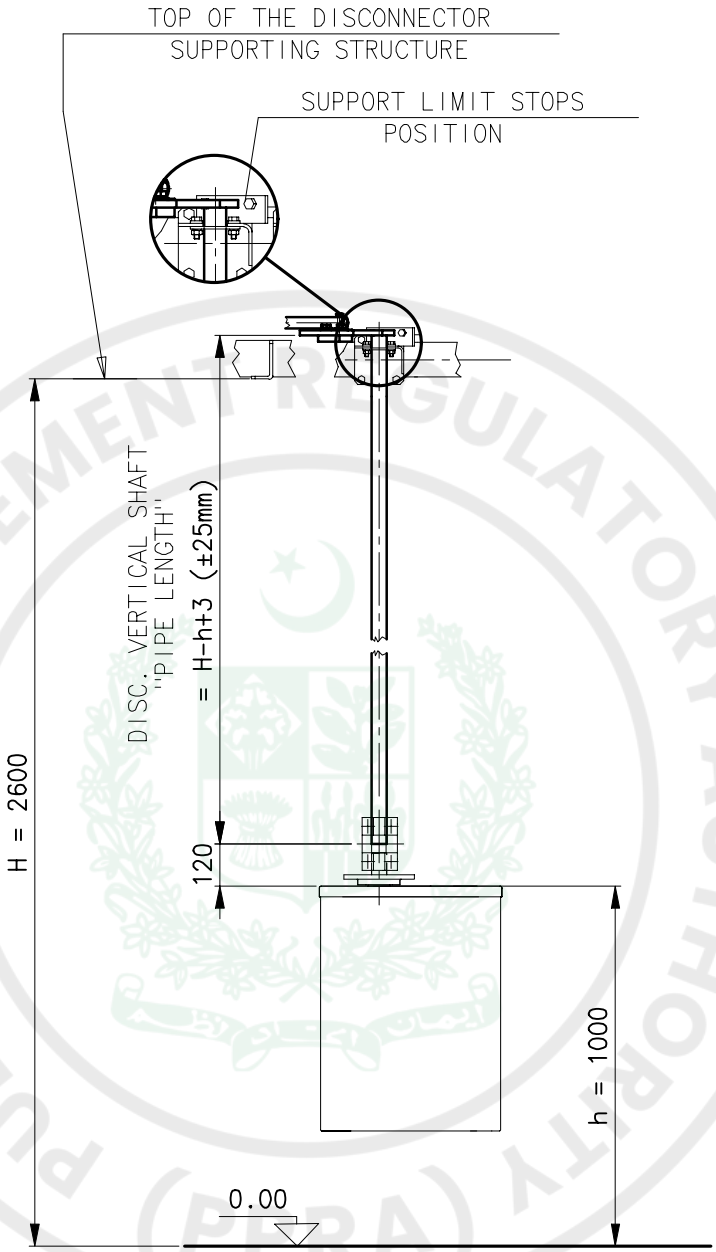

(*) "J" VIEW

DETAIL TO CUT
VERTICAL SHAFT(S) AT SITE

After cutting, protect the cut surface by spray zinc

Rev	Description	Drawn	Checked	Date
A	First issue	LORENZON	RUFFATO	30/07/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

DISCONNECTOR CBD 145-2000
(BIL650 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS


Format:	Standard:	Scale:	Language:
A4	KM003292	1:20	ENG
	Revision: A	Sheet/of: 2/2	


COELME COSTRUZIONI ELETTROMECCANICHE-SPA
egic


KM004246


File:KM004246_00033347_K0_0

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

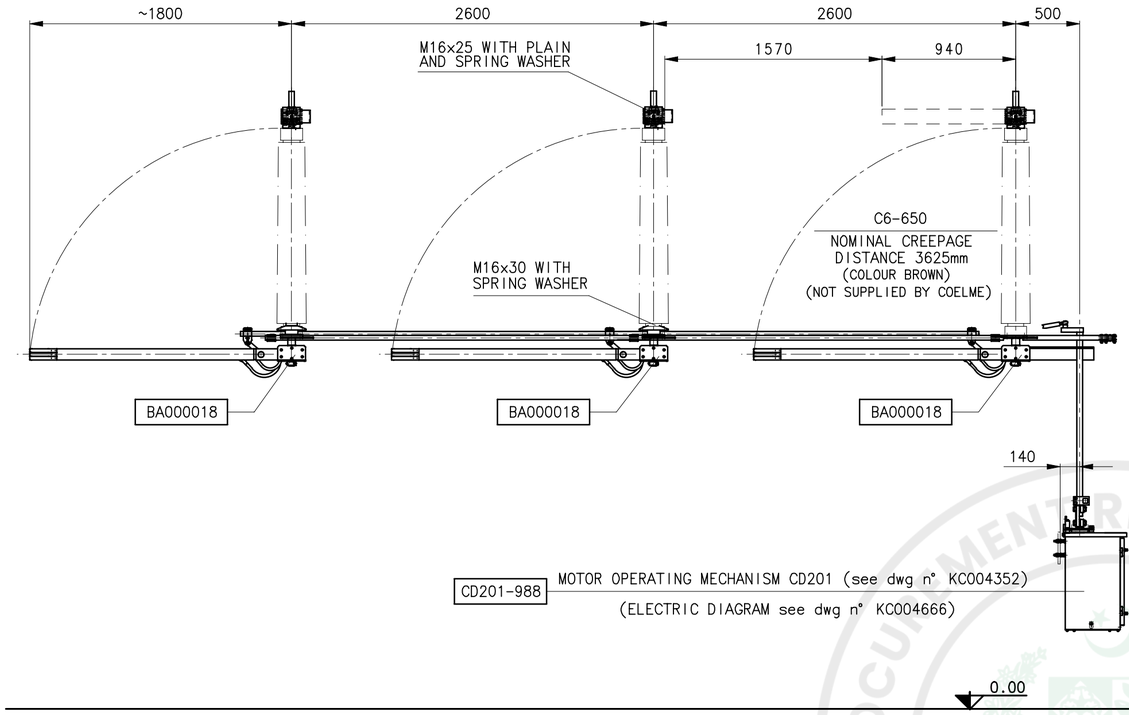

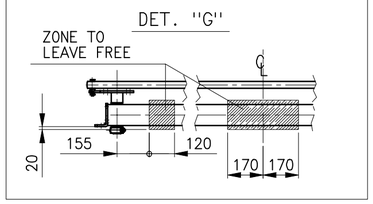

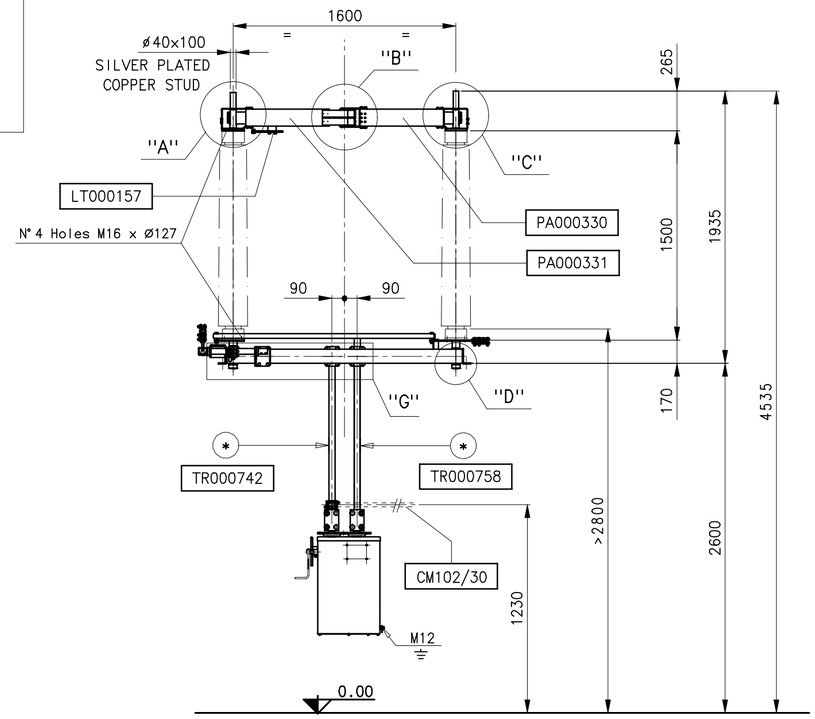

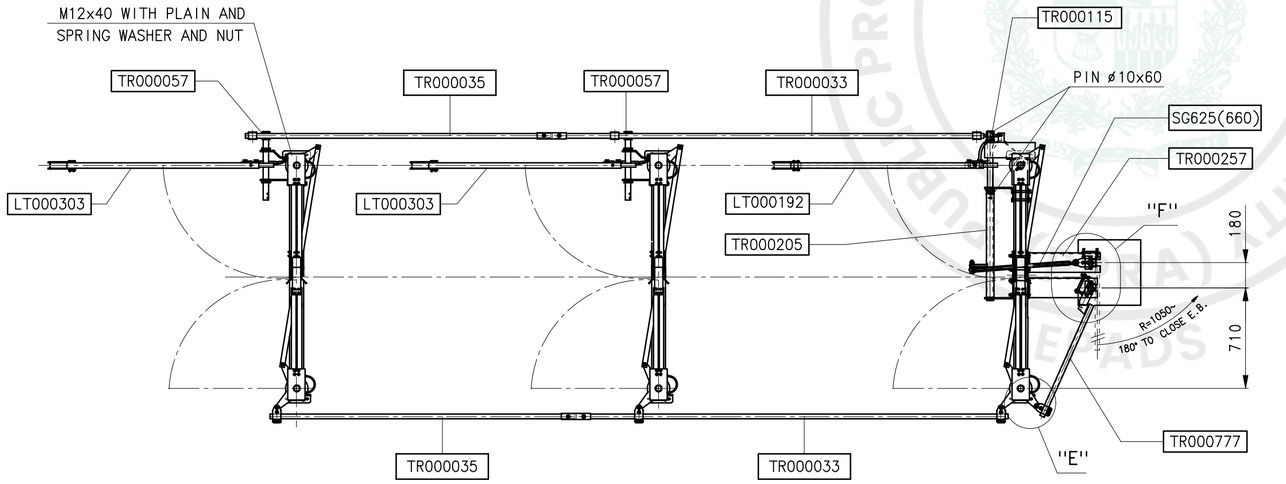



approximate weight for three pole isolator complete of operating rods,driving shaft and insulators : Kg 1200


approximate weight of motor operating mechanism : Kg 60


PA000330	ISOLATOR MALE ARM
PA000331	ISOLATOR FEMALE ARM
BA000018	BASE
LT000157	EARTHING BLADE FIX CONTACT
LT000192	DRIVING EARTHING BLADE
LT000303	EARTHING BLADE
P0001173	DRIVING BASE LEVER
SG625(660)	E.B. DRIVING ROD
TR000033	POLES CONNECTING ROD
TR000035	POLES CONNECTING ROD
TR000057	LEVER
TR000115	LEVER
TR000205	E.B. DRIVING LEVER
TR000257	SUPPORT
TR000777	ISOLATOR DRIVING ROD
TR000742	E.B. DRIVING SHAFT
TR000758	ISOLATOR DRIVING SHAFT
CD201-988	MOTOR OPERATING MECHANISM
CM102/30	LEVER


(*) VERTICAL SHAFTS TO BE CUT TO SIZE AT SITE

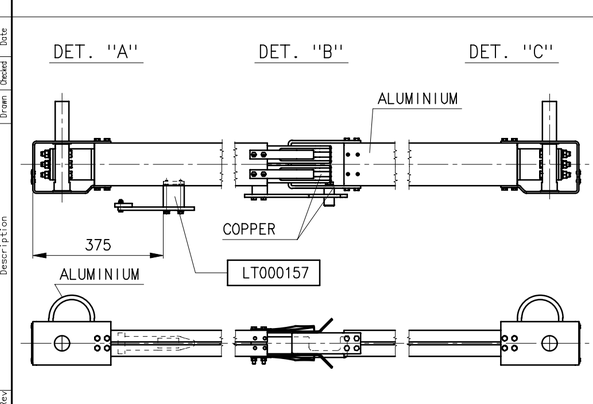

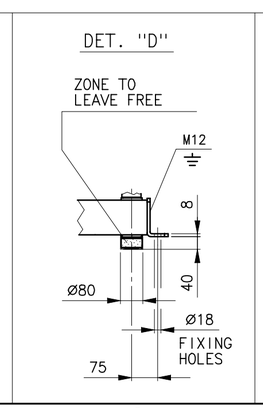

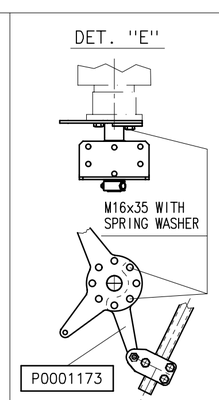

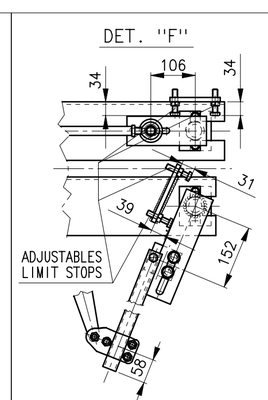

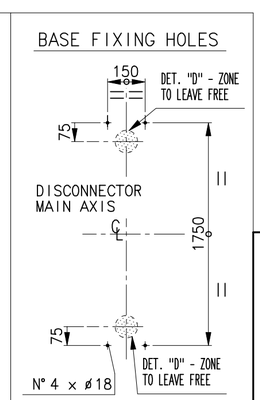

Checked according ISO 9000 procedures

DISCONNECTOR CBD-E 145-2000
(BIL650 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A2	KM003262	1:30	ENG
	Revision: A	Sheet/of: 1/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic


KM004244

Rev	Description	Drawn	Checked	Date
A	First issue	URBAN	BIFANTI	30/07/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File: KM004244_00033342_K0_0

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

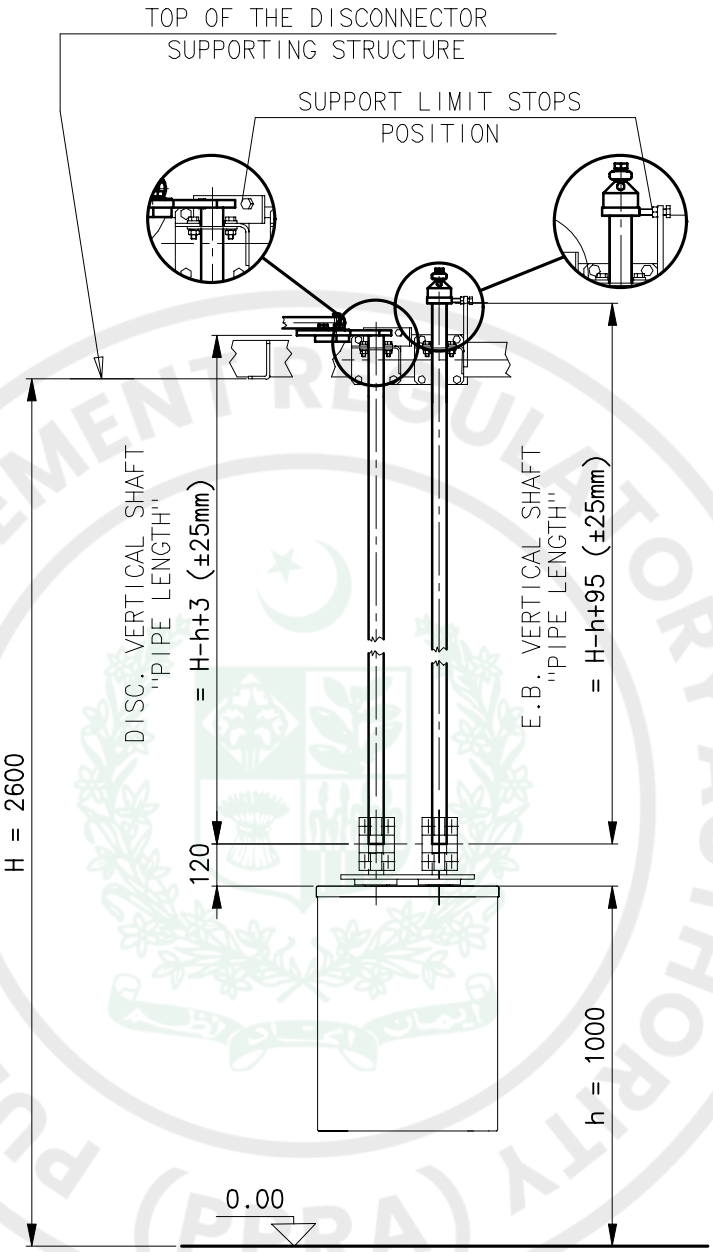

* "J" VIEW

DETAIL TO CUT
VERTICAL SHAFT(S) AT SITE

After cutting, protect the cut surface by spray zinc

Rev	Description	Drawn	Checked	Date
D	Added components list and sheet 2/2	SUPERVISORE	RUFFATO	30/07/2007

Checked according ISO 9000 procedures

DISCONNECTOR CBD-E 145-2000
(BIL650 KV, 40 KA X 3 SEC.)
OVERALL DIMENSIONS

Format:	Standard:	Scale:	Language:
A4	KM003262	1:20	ENG
	Revision: A	Sheet/of: 2/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA

egic

KM004244

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File:KM004244_00033343_K0_0

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

COELME
COSTRUZIONI ELETTROMECCANICHE-SPA
Coelme - Via G.Galilei, 1/2 - 30036 S.Maria di Sala (VE) - Italia
Egic - 60b, rue L. et R. Desgrand - 69625 Villeurbanne cedex - France
: +39 041 486 022
: +39 041 486 909
Southern States Group
egic
: +33 472 66 20 80
: +33 472 39 08 65

(1) N° (2)		U_r (3) kV	I_r (4) A	
(5)	I_k (6) kA	t_k (7) s	.	
(8)	U_p (9) kV	U_s (10) kV	f_r 50/60 Hz	
T (11) °C	Alt (12) m	I_r (13) A	U_r (14) V	
.				

65

165

MATERIAL: ALUMINIUM ALLOY

(1)	(2)	(3) Ur	(4) Ir	(5)	(6) Ik	(7) tk	(8)	(9) Up	(10) Us		(11) T	(12) Alt.	(13) Ir	(14) Ur
Type	Serial number	Rated Voltage [kV]	Rated current [A]	Year of manufacturing	Rated short-time withstand curr. [kA]	Rated short-time curr. duraction [s]	Mechanical endurance class	BIL to earth [kV]	SIL to earth [kV]	Frequency [Hz]	Temperature of use [°C]	Altitude of use [m a. s. l.]	Rated bus-transfer current (for DS's) [A]	Rated bus-transfer voltage (for DS's) [V]
CBD	C42386÷C42405	245	2000	2007	40	3	M0	1050	- *	50/60	-25° /+40°	⩽ 1000	- *	- *
CBD-E	C42406÷C42413	245	2000	2007	40	3	M0	1050	- *	50/60	-25° /+40°	⩽ 1000	- *	- *
CBD	C42414÷C42421	145	2000	2007	40	3	M0	650	- *	50/60	-25° /+40°	⩽ 1000	- *	- *
CBD-E	C42422÷C42441	145	2000	2007	40	3	M0	650	- *	50/60	-25° /+40°	⩽ 1000	- *	- *

* Not applicable

Rev	Description	Drawn	Checked	Date
B	Added serial number - Final issue	SIMONATO	RIFFATTO	19/05/2007
A	First issue	RIFFATTO	MAGGIORA	29/03/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

DISCONNECTOR
PLATE (NAMEPLATE)


Format:	Standard:	Scale:	Language:
A3		1:1	ENG
	Revision: B	Sheet/of: 1/1	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KP003988

File: KP003988_00030771_P0_1

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

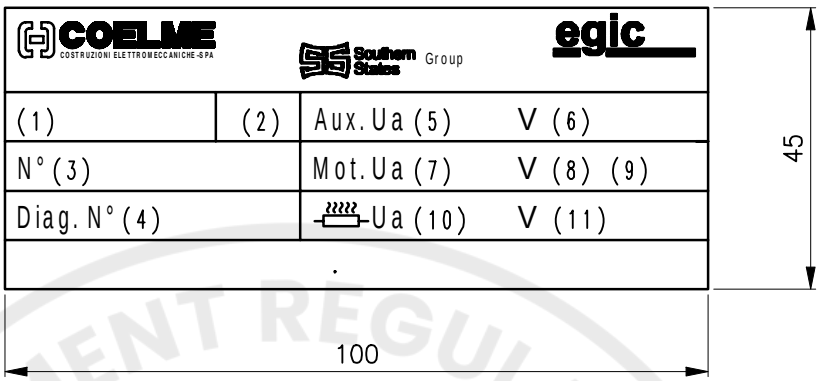

MATERIAL: METALIZED POLYESTER
fixed inside the case

(1) Type	(2) Year of Manufact.	(3) Serial number	(4) Electric Diagram	(5) Rated voltage of Auxiliaries	(6) Rated frequency of Auxiliaries	(7) Rated voltage of Motor(s)	(8) Rated frequency of Motor(s)	(9) Phases	(10) Rated voltage of Heater(s)	(11) Rated frequency Heater(s)
CD201	2007	30980÷30987	KCO00643	220	DC	400	AC	3~	230	50 Hz
CD101	2007	30940÷30959	KCO00644	220	DC	400	AC	3~	230	50 Hz
CD201	2007	30988÷30995	KCO04666	220	DC	400	AC	3~	230	50 Hz
CD101	2007	30960÷30979	KCO04667	220	DC	400	AC	3~	230	50 Hz

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Rev	Description	Drawn	Checked	Date
C	Modified 132 kV DS Mechanisms	LORENZONI	RUFFATO	30/07/2007
B	Added serial number - Final issue	SIMONATO	RUFFATO	18/05/2007
A	First issue	RUFFATO	MAGNOBA	28/03/2007

Checked according ISO 9000 procedures

MOTOR OPERATING MECHANISM TYPE PLATE (NAMEPLATE)

Format:	Standard:	Scale:	Language:
A4		1:1	ENG
	Revision: C	Sheet/of: 1/1	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KP003989

File:KP003989_00030772_P0_2

132 kV Subst. Disconnector Motor Circuit Diagram

VATECH

VA TECH HYDRO

REMARK FOR APPROVAL:

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :

HHC

HIGH HEAD HYDROPOWER CONSULTANT
JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT

ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

Index	Sheet	Revision	Date	Name	Check	Appr.
B1	All	As Manufactured	04.07.2008	Schn	Dastl	
B	1 - 5	Revision acc. to HHC letter and new type	7.9.2006	Holzapfel	Dastl	

PURCHASER	ALLGEMEIN/GENERAL	DRAWN	02.12.2004	HOLZAPFE	REV/DATE		FILE	AE06-VTH-DD-10-
PLANT	ALLGEMEIN/GENERAL	CHECK	02.12.2004	DASTL	B1	04.07.08	DATE	15.07.2008
PROJECT-No.	..	APPR.	. .	LH-DE			SHEET	1 OF 6

VA TECH HYDRO	HYDRO VIENNA	DOC No. VATECH No.	AE06-VTH-DD-10-AEA 33-000007002-B1

This document is the property of VA TECH HYDRO GmbH & Co and may neither be copied nor distributed and used without our written consent.Violations will be prosecuted by Law according to DIN 34 Standard.

132 kV Subst. Disconnector Motor Circuit Diagram

List of Content

Title	Manufacturer / Type	Drawing No:	Revision
Motor Mechanism Type CD 101 Circuit Diagram (without Earthing Switch)	Coelme/ CD 101	KCO 04667	C
Motor Mechanism Type CD 201 Circuit Diagram (with Earthing Switch)	Coelme/ CD 201)	KCO 04666	D

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

LEGEND

M	- DRIVING MOTOR 230/400 Va.c. 50 Hz (+10% -15%) ≤ 500W - (Wired 400 Va.c.)
IAM	- MAGNETOTHERMIC CIRCUIT BREAKER
CA	- OPENING CONTACTOR 220 Vd.c.
CC	- CLOSING CONTACTOR 220 Vd.c.
Fa	- OPENING LIMIT SWITCH
Fc	- CLOSING LIMIT SWITCH
PA	- OPENING PUSH BUTTON
PC	- CLOSING PUSH BUTTON
MLD	- LOCAL-REMOTE SELECTOR SWITCH
BM	- INTERLOCKING SWITCH
RA	- ANTICONDENSATE RESISTANCE 230 Va.c. - 50 Hz (18 W)
RR	- HEATER 230 Va.c. - 50 Hz (18 W)
T	- THERMOSTAT
ESS	- ELECTROMAGNETIC INTERLOCKING DEVICE 220 Vd.c.
PSS	- RELEASE PUSH BUTTON FOR "ESS"
A-B aa-bb	- AUXILIARY SWITCHES

INTERNAL WIRING - Cable 1.5 sqmm, colour Black, type NO7V-K

AUXILIARY CONTACTS TIMING DIAGRAM

type	Disconnector main contacts	OPEN (0°) / CLOSED (180°)
A (NO)	23-24 27-28 31-32 35-36 39-40 43-44	
B (NC)	21-22 25-26 29-30 33-34 37-38 41-42	
a-a (NO-EM)	47-48	
b-b (NC-LB)	45-46	

Contacts shown OPEN — Contacts shown CLOSED

Rev	Description	Drawn	Checked	Date
C	Final issue	PASTORELLO	RAFFATTO	05/09/2007
B	Revised as per Customer request	Oxro	RAFFATTO	06/08/2007
A	First issue	LORENZON	RAFFATTO	30/07/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

MOTOR OPERATING MECHANISM TYPE
CD 101- - ELECTRIC DIAGRAM


Format:	Standard:	Scale:	Language:
A3	KC000644	1:1	ENG
	Revision: C	Sheet/of: 1/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KC004667

File: KC004667_00033340_K0_2

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

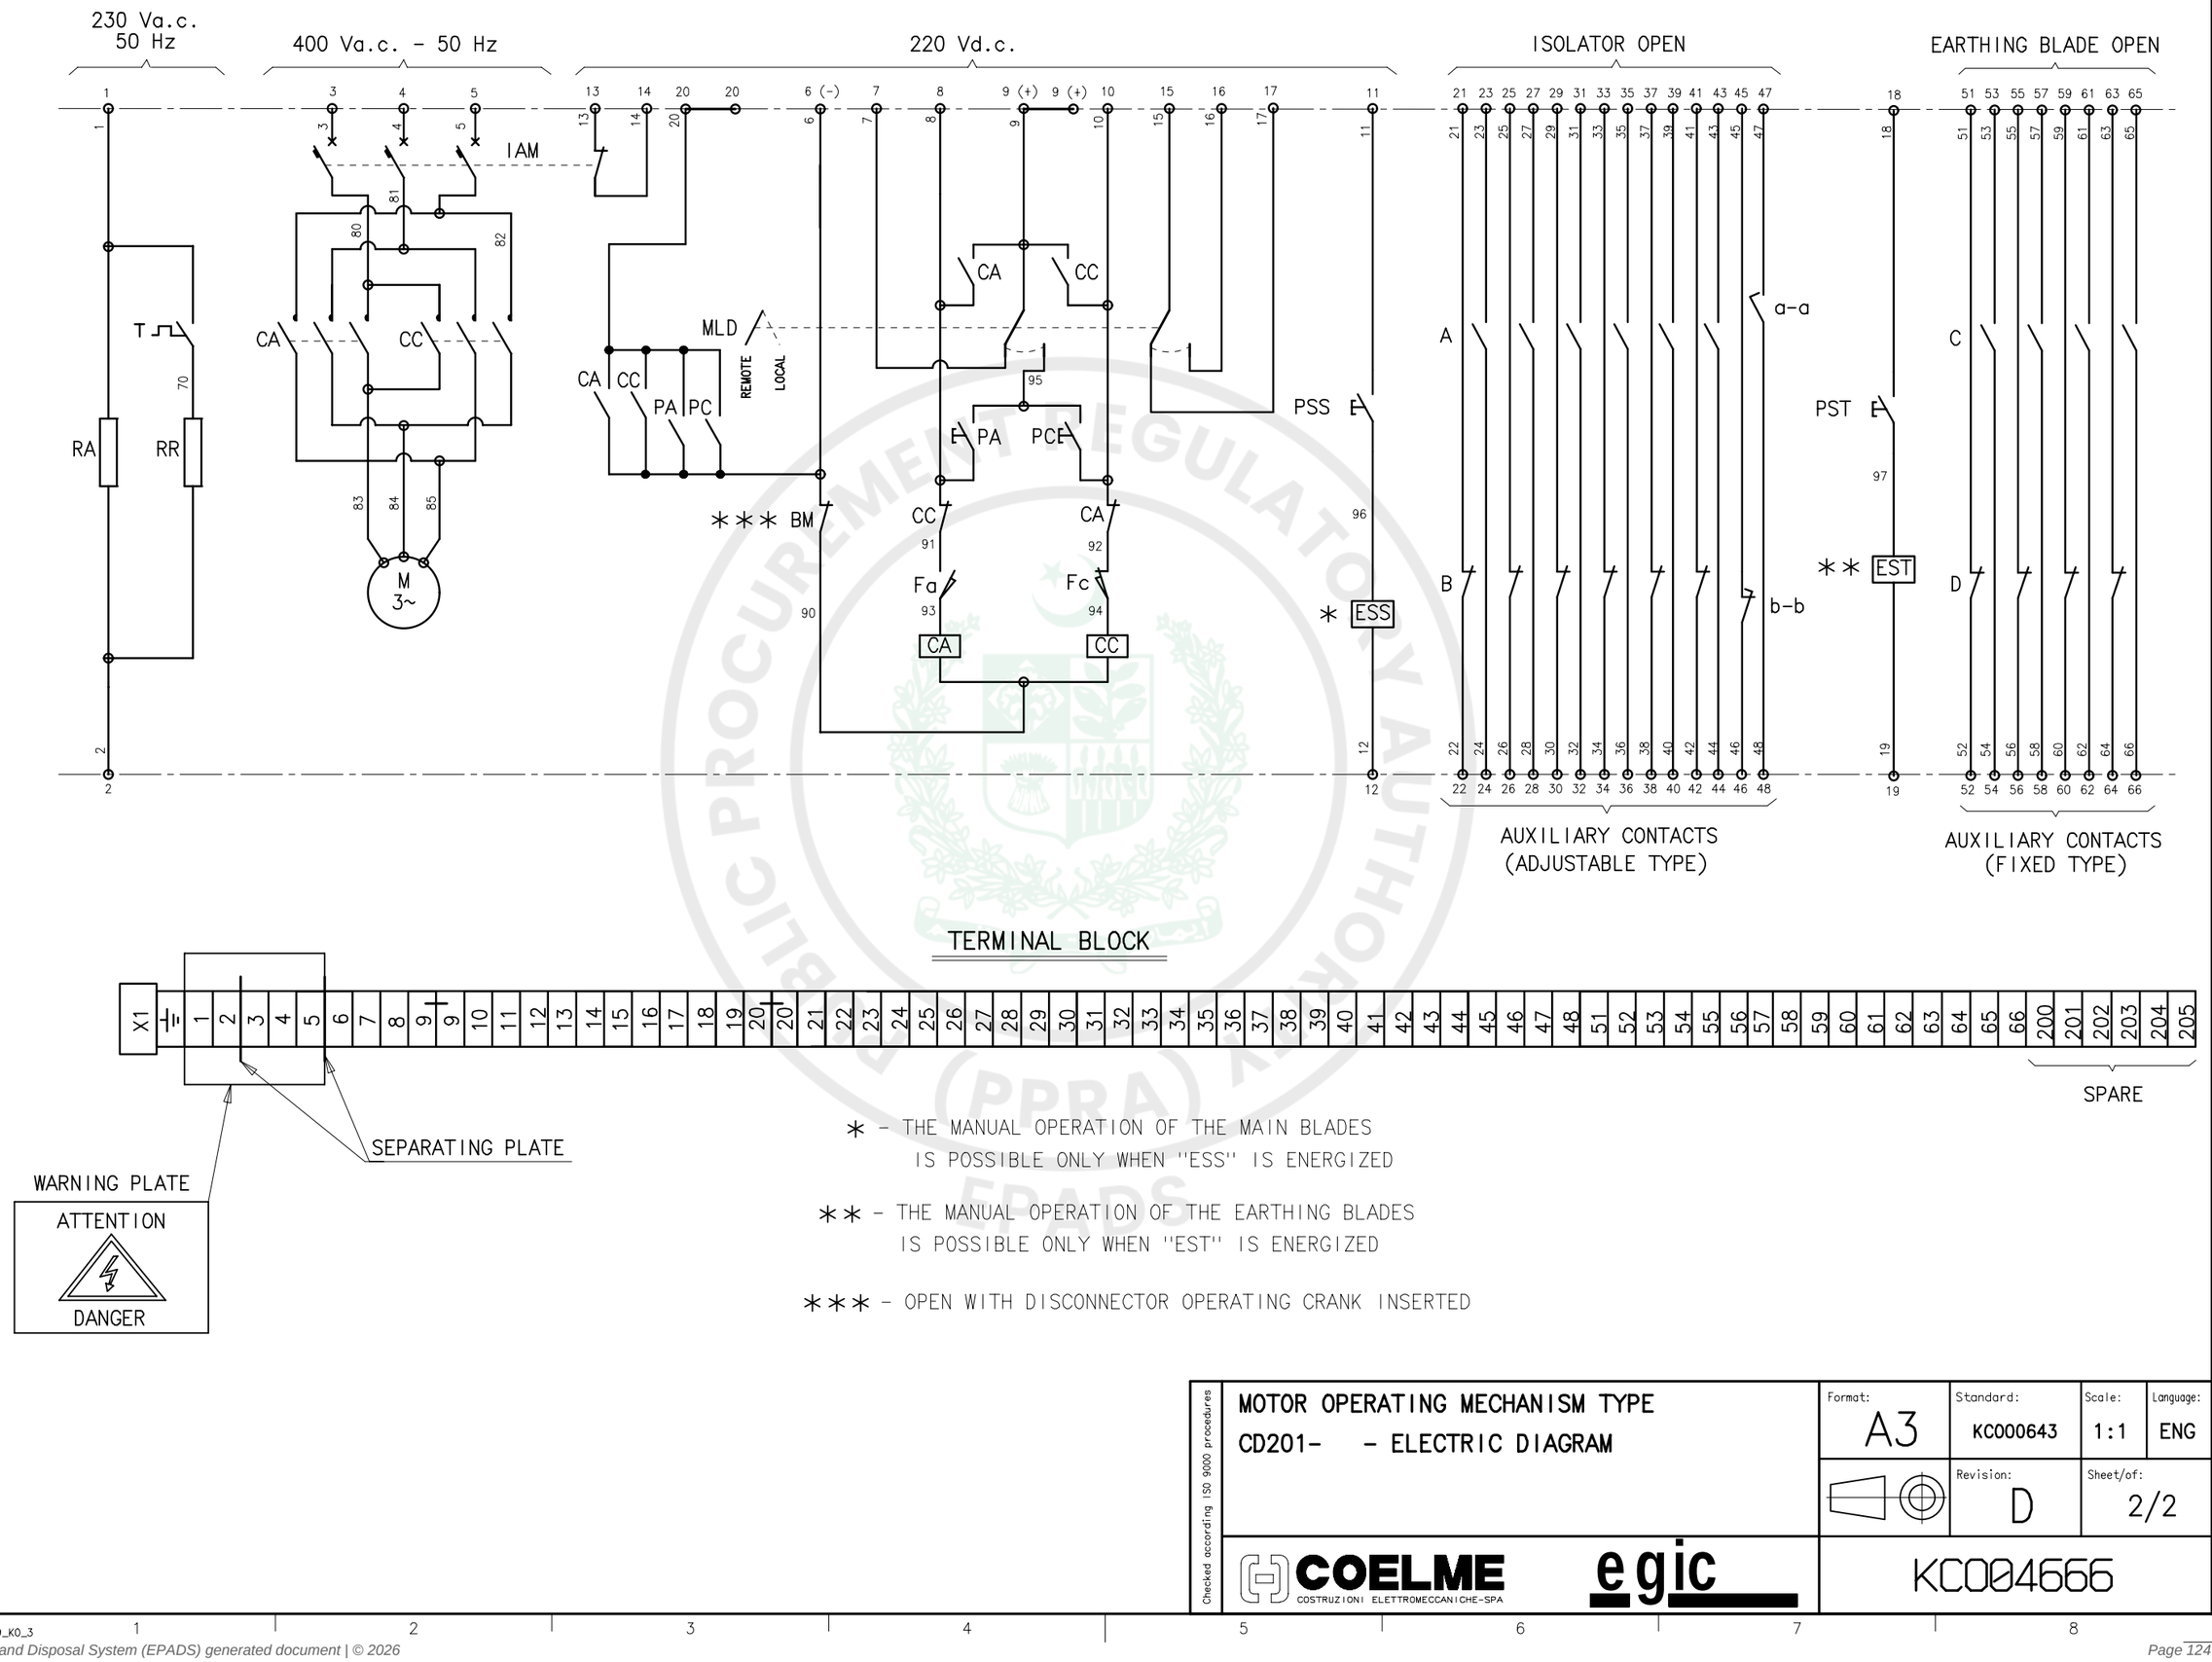

Rev	Description	Date	Drawn	Checked
D	Final issue	05/09/2007	PASTRELLO	RAFFATTO
C	Revised	06/08/2007	PASTRELLO	RAFFATTO
B	Revised as per Customer request	06/08/2007	Coro	RAFFATTO
A	First issue	30/07/2007	LOCKNOCK	RAFFATTO

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

MOTOR OPERATING MECHANISM TYPE
CD201- - ELECTRIC DIAGRAM

Format:	Standard:	Scale:	Language:
A3	KC000643	1:1	ENG
	Revision: D	Sheet/of: 2/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA egic

KC004666

File: KC004666_00033339_K0_3

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

LEGEND

M	- DRIVING MOTOR 230/400 Va.c. 50 Hz (+10% -15%) ≤ 500W - (Wired 400 Va.c.)
IAM	- MAGNETOTHERMIC CIRCUIT BREAKER
CA	- OPENING CONTACTOR 220 Vd.c.
CC	- CLOSING CONTACTOR 220 Vd.c.
Fa	- OPENING LIMIT SWITCH
Fc	- CLOSING LIMIT SWITCH
PA	- OPENING PUSH BUTTON
PC	- CLOSING PUSH BUTTON
MLD	- LOCAL-REMOTE SELECTOR SWITCH
BM	- INTERLOCKING SWITCH
RA	- ANTICONDENSATE RESISTANCE 230 Va.c. - 50 Hz (18 W)
RR	- HEATER 230 Va.c. - 50 Hz (18 W)
T	- THERMOSTAT
ESS	- ELECTROMAGNETIC INTERLOCKING DEVICE 220 Vd.c.
PSS	- RELEASE PUSH BUTTON FOR "ESS"
EST	- ELECTROMAGNETIC INTERLOCKING DEVICE 220 Vd.c.
PST	- RELEASE PUSH BUTTON FOR "EST"
A-B aa-bb	- AUXILIARY SWITCHES OF MAIN BLADES
C-D	- AUXILIARY SWITCHES OF EARTHING BLADES

INTERNAL WIRING - Cable 1.5 sqmm, colour Black, type N07V-K

AUXILIARY CONTACTS TIMING DIAGRAM (MAIN BLADES)

type	Main Blades main contacts	OPEN / CLOSED (0° – 180°)
A (NO)	23-24 27-28 31-32 35-36 39-40 43-44	
B (NC)	21-22 25-26 29-30 33-34 37-38 41-42	
a-a (NO-EM)	47-48	
b-b (NC-LB)	45-46	

Contacts shown OPEN — Contacts shown CLOSED

Rev	Description	Drawn	Checked	Date
D	Final issue	PASTORELLO	RUFFATTO	05/09/2007
C	Revised	PASTORELLO	RUFFATTO	08/08/2007
B	Revised as per Customer request	Oxro	RUFFATTO	06/08/2007
A	First issue	LORENZON	RUFFATTO	30/07/2007

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

Checked according ISO 9000 procedures

MOTOR OPERATING MECHANISM TYPE
CD201- - ELECTRIC DIAGRAM


Format:	Standard:	Scale:	Language:
A3	KC000643	1:1	ENG
	Revision: D	Sheet/of: 1/2	


COELME COSTRUZIONI ELETTROMECCANICHE-SPA — egic


KC004666

File: KC004666_00033338_K0_3

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

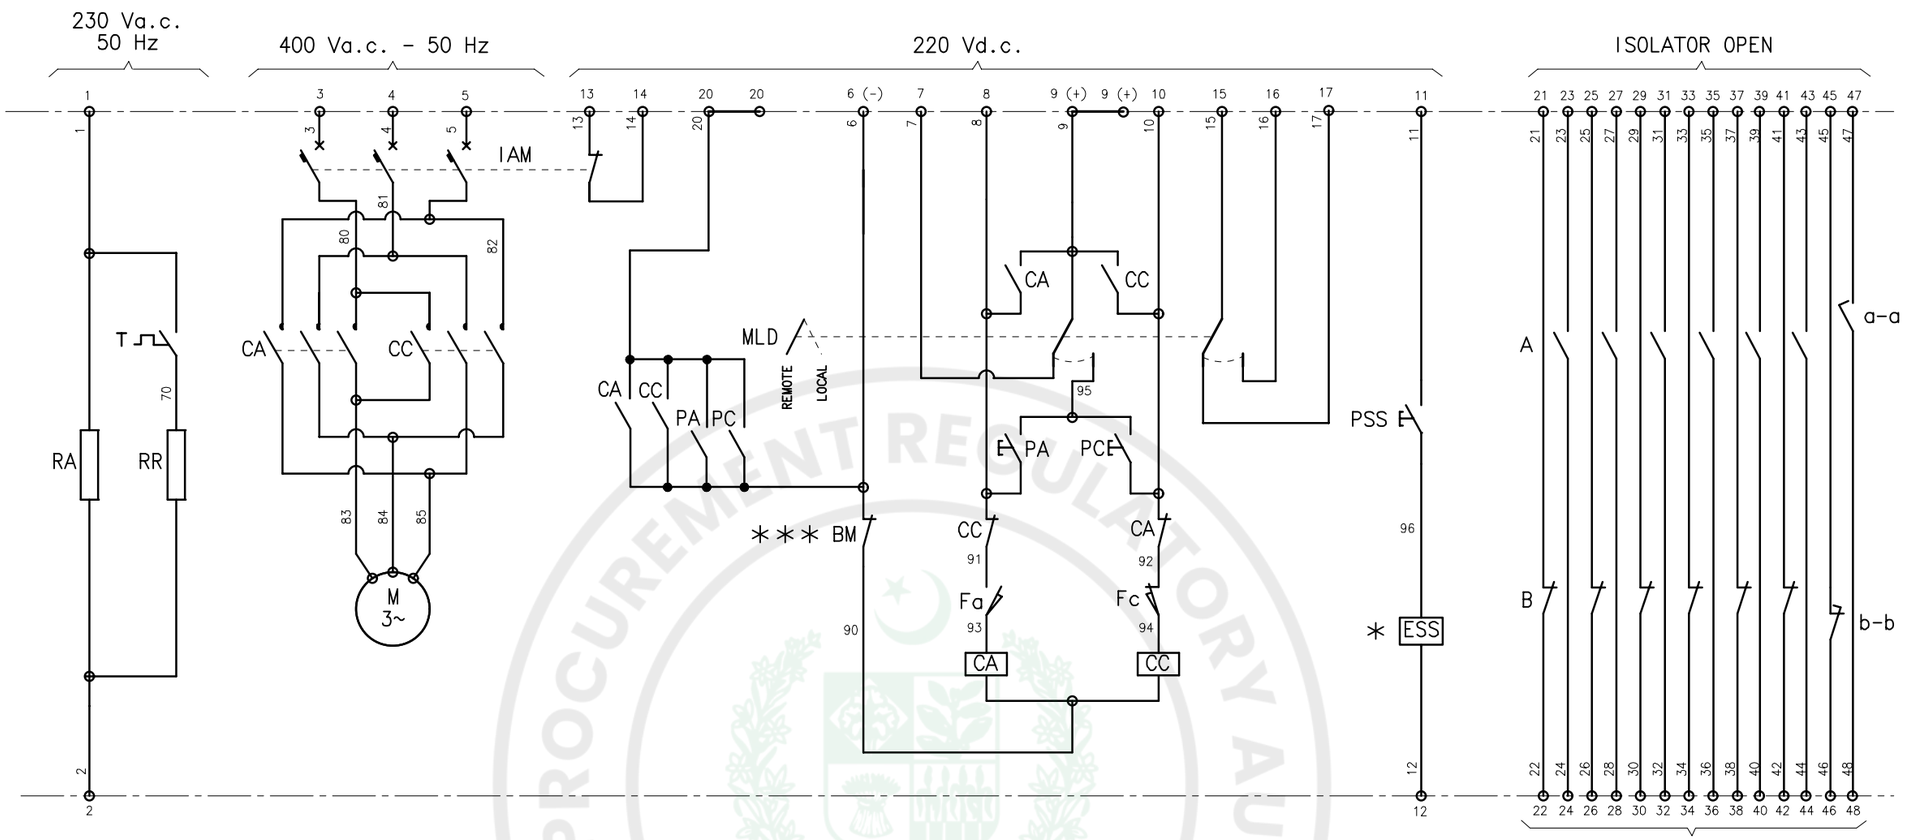

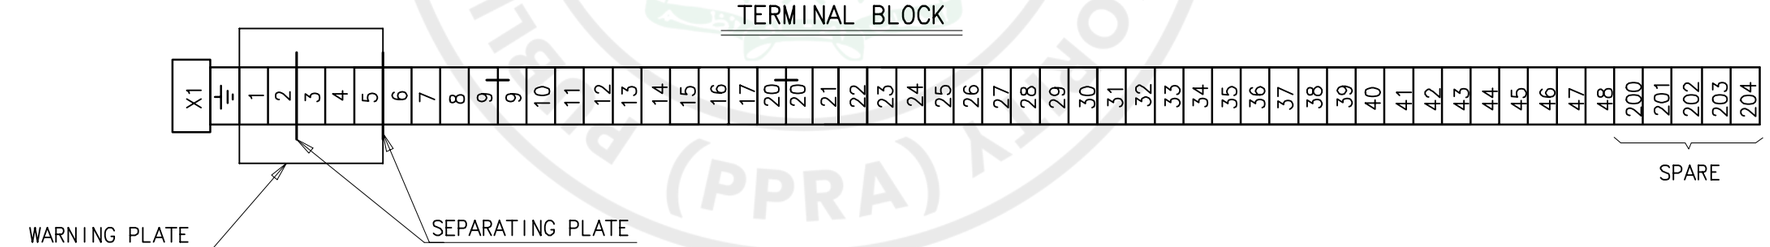



SEPARATING PLATE

* - THE MANUAL OPERATION OF THE DISCONNECTOR IS POSSIBLE ONLY WHEN "ESS" IS ENERGIZED

*** - OPEN WITH DISCONNECTOR OPERATING CRANK INSERTED

Rev	Description	Drawn	Checked	Date
C	Final issue	PASTRELLO	RUFFATTO	05/09/2007
B	Revised as per Customer request	Coro	RUFFATTO	06/08/2007
A	First issue	LORENZON	RUFFATTO	30/07/2007

Checked according ISO 9000 procedures

MOTOR OPERATING MECHANISM TYPE
CD 101- - ELECTRIC DIAGRAM

Format:	Standard:	Scale:	Language:
A3	KC000644	1:1	ENG
	Revision: C	Sheet/of: 2/2	

COELME COSTRUZIONI ELETTROMECCANICHE-SPA

egic

KC004667

THIS DOCUMENT IS THE PROPERTY OF COELME-EGIC
ALL RIGHTS ARE RESERVED ACCORDING TO LAW

File: KC004667_00033341_K0_2


e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

This drawing is the PROPERTY of
VA TECH T&D GmbH & Co
Penzingerstraße 76
A-1141 VIENNA AUSTRIA


Note protection DIN 34 !

F we	Dead weight Pole	3670 N
F wsu	Dead weight Support	2050 N
F sho	Short Circuit Load (Dyn. Load)	5452 N
F wi cond	Wind Load on Conductor	289 N
Fx wind	Wind Load on Equipment	1137 N
Fy wind	Wind Load on Equipment	1567 N
F wi supp	Wind Load on support	2625 N
h equip	Height of Equipment	4535 mm
h supp	Height of Support	2600 mm
h wi equip	Center of Equipment	3607 mm
h wsu	Center of Support Gravity	1300 mm

VIEW X

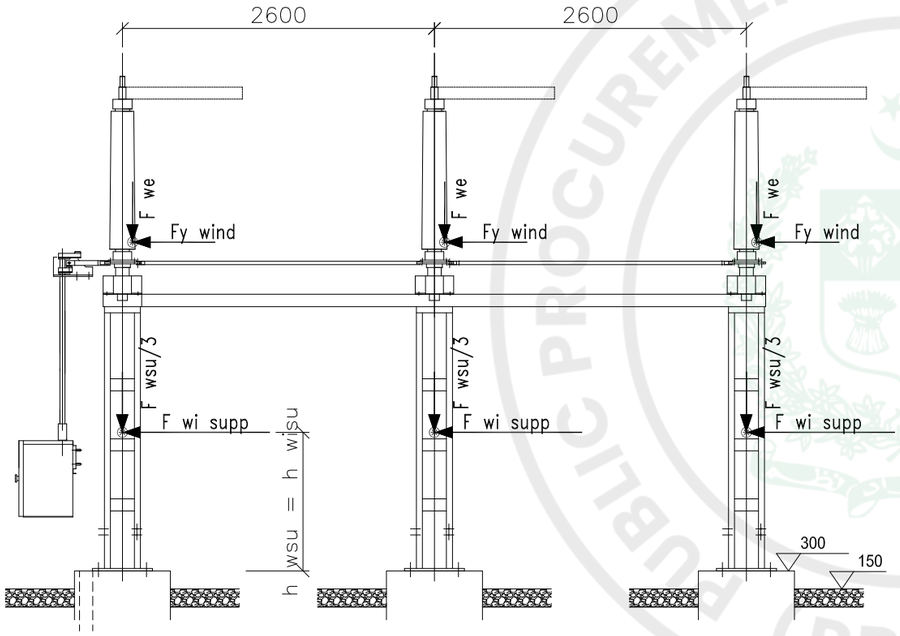


VIEW Y

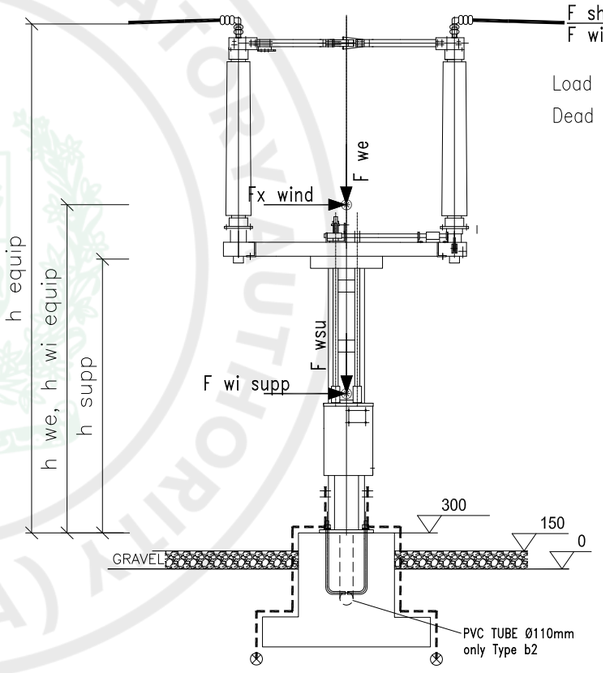

Load case:
Dead Weight + Wind + Short Circuit

Foundation

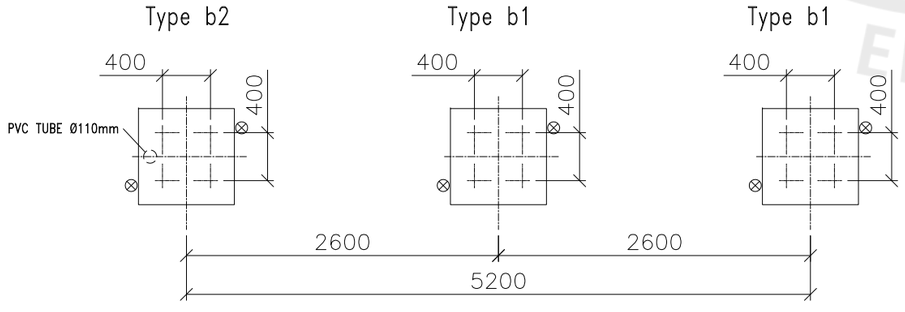

ANCHORBOLTS: M24
shall be in the scope
of CIVIL CONTRACTOR!



				Drawn	20.04.07	SCHN	Purchaser: Pakistan W&P Authority	VATECH Projects	132kV Switchyard Foundation Details & Loads Disconnector	b1, b2 AE06-VTH-DD-10 = / +
				Checked			Plant: Allai Khwar			
				Approved		PA4	Proj. N°: C243 38 014	ELIN VA TECH T&D GmbH & Co		AEA-01-000007002- A2 Sht 4 of 14 A3
M	Description of modification	Date	Drawn	Scale		1:50	Filedate: 13.11.07	Filename:		

A3eng


e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

This drawing is the PROPERTY of
VA TECH T&D GmbH & Co
Penzingerstraße 76
A-1141 VIENNA AUSTRIA


Note protection DIN 34 !

F we	Dead weight Pole	4000 N
F wsu	Dead weight Support	2050 N
F sho	Short Circuit Load (Dyn. Load)	3764 N
F wi cond	Wind Load on Conductor	128 N
Fx wind	Wind Load on Equipment	1294 N
Fy wind	Wind Load on Equipment	1566 N
F wi supp	Wind Load on support	2625 N
h equip	Height of Equipment	4535 mm
h supp	Height of Support	2600 mm
h wi equip	Center of Equipment	3507 mm
h wsu	Center of Support Gravity	1300 mm


VIEW X

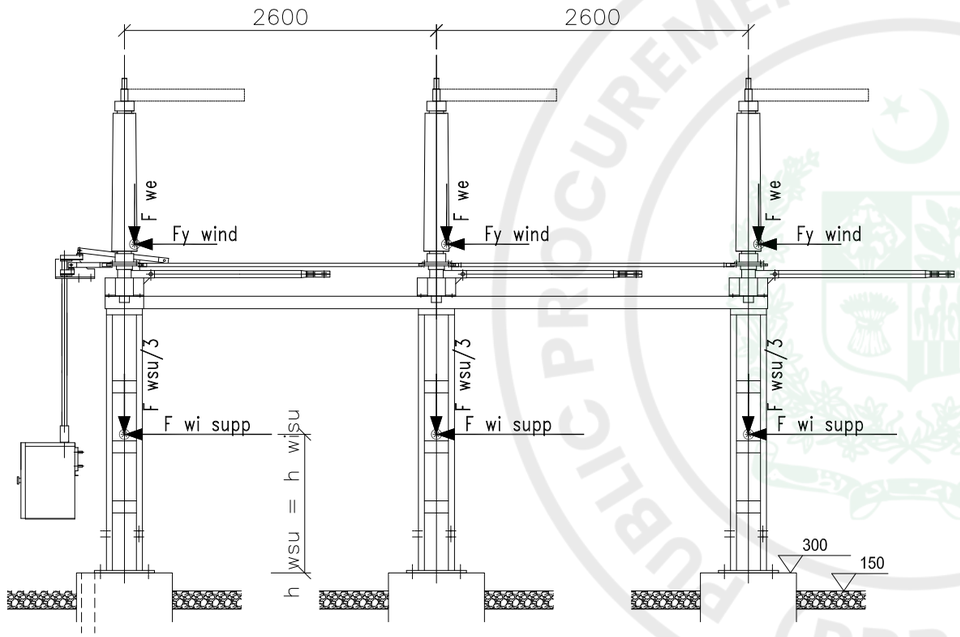

Foundation

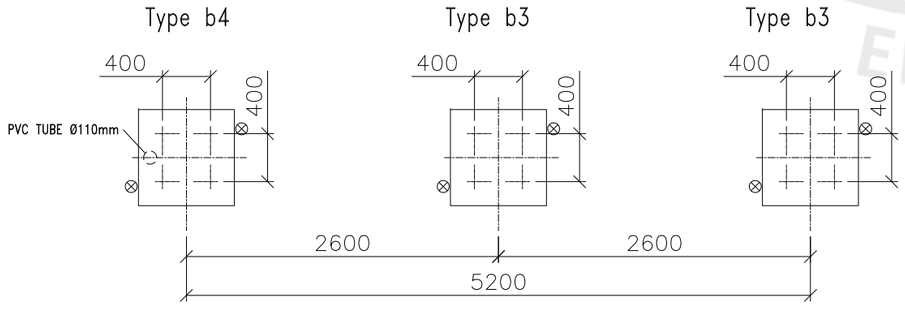

VIEW Y

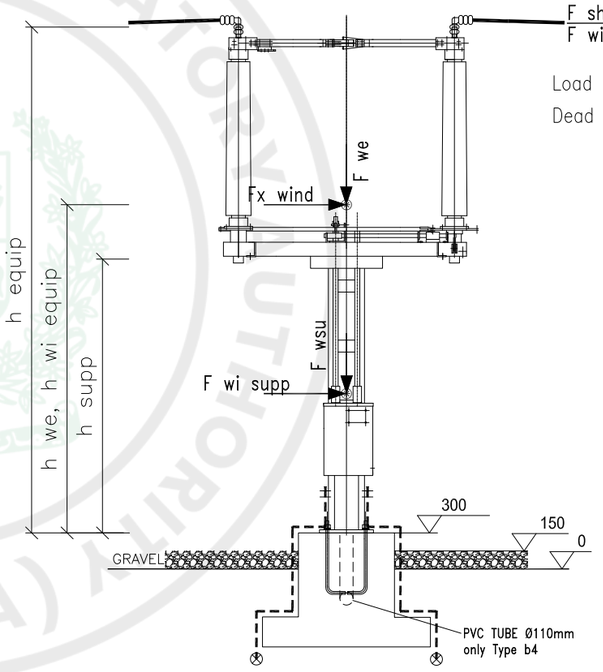


Load case:
Dead Weight + Wind + Short Circuit


ANCHORBOLTS: M24
shall be in the scope
of CIVIL CONTRACTOR!


				Drawn	20.04.07	SCHN	Purchaser: Pakistan W&P Authority	VATECH Projects	132kV Switchyard Foundation Details & Loads Disconnector w. ESW	b3, b4 AE06-VTH-DD-10 = / +
				Checked			Plant: Allai Khwar			
				Approved		PA4	Proj. N°: C243 38 014	ELIN VA TECH T&D GmbH & Co		AEA-01-000007002- A2 Sht 5 of 14 A3
M	Description of modification	Date	Drawn	Scale		1:50	Filedate: 13.11.07 Filename:			


A3eng


e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

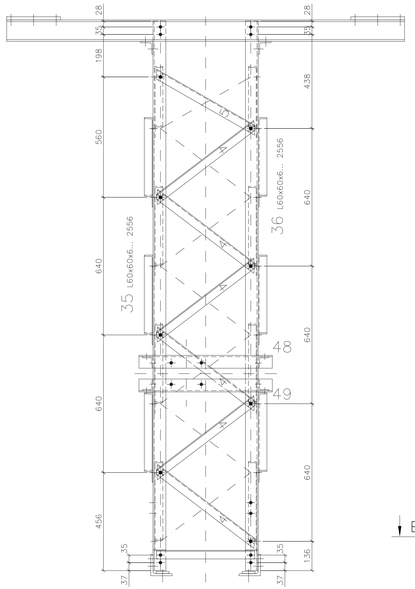


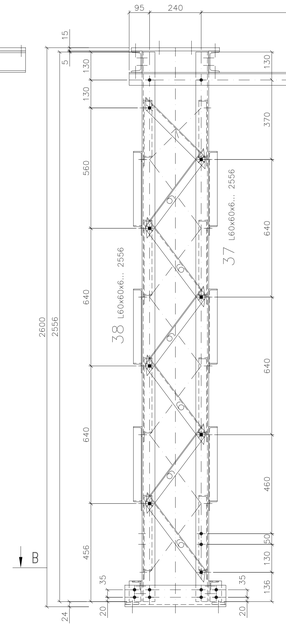


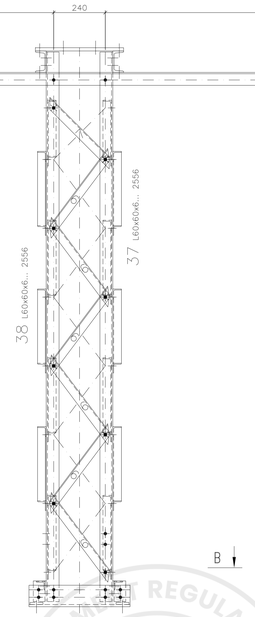


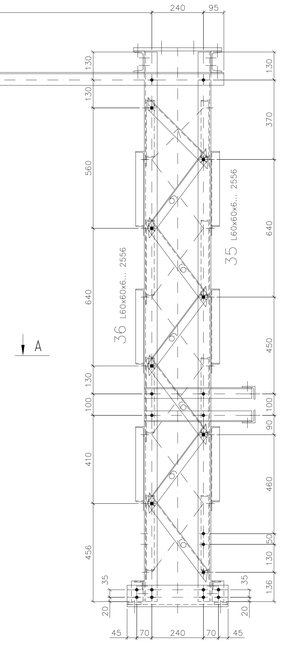

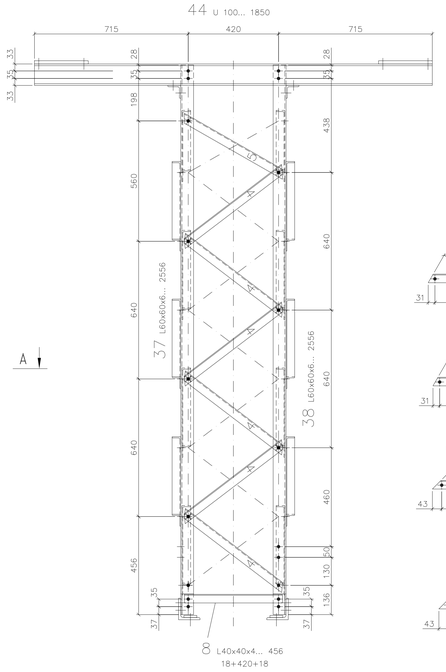


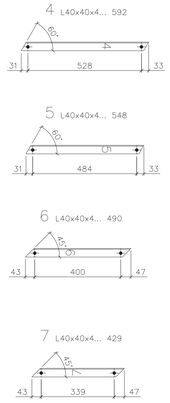





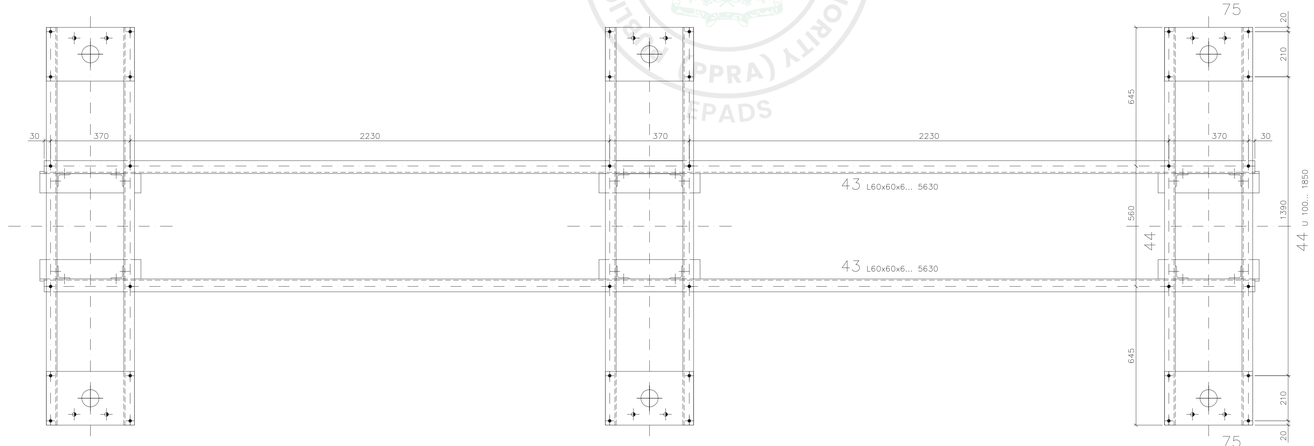


SECTION B-B







SECTION A-A



There are considered the following standards, if not in a different way given !

material:	S 235 JR
bolt quality:	5.8
HOT DIP GALVANIZED	

ø14	M12
ø18	M16
ø22	M20

L80x80	SM 45
L70x70	SM 40
L60x60	SM 35
L50x50	SM 30
L40x40	SM 25

Weight: 615 kg

INDEX	REV. N° (SHEET)	N° ALT.	MODIFICATION	DATE	NAME	DATE	APPROVED
A0			First Issue	23.10.07	SOHN	23.10.07	AE-PA4

REFERENCE DRAWINGS

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER : HHC
HIGH HEAD HYDROPOWER CONSULTANT JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT
ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

PURCHASER	PROJECT N° C24338014
PLANT Allai Khwar	CONTRACT N°
132kV Switchyard Disconnector parallel Steel Structure Drawing	= + CUSTOMER N° AE06-VTH-DD-10

	DATE	NAME
DRAWN	23.10.2007	SOHN
CHECK		
APPROVED		AE-PA4

SCALE 1:10

ISO / R 128 EUROPA

SP. DATUM | MODEL | WEIGHT | MATERIAL

VA TECH HYDRO


DRAWING N° AEA-28-000007008- IND. A0


SHEET 1 OF 2

This drawing is the PROPERTY of
VA TECH HYDRO GmbH & Co
Penzingerstrasse 76
A-1141 Wien AUSTRIA
Note protection DIN 34 !


CAD A4S101

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

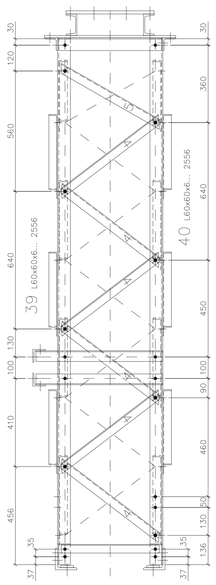


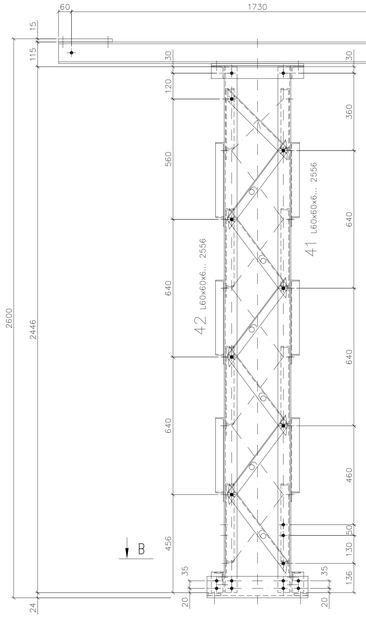


76 U100... 4222




75 pl.250x15... 410




84 L60x60x6... 430




85 L60x60x6... 430

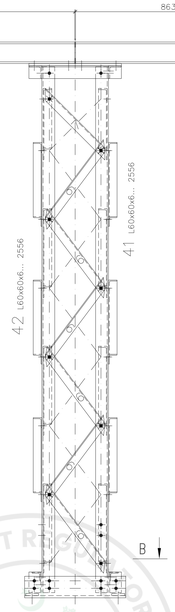


77 U100... 4222




4 L40x40x4... 592




5 L40x40x4... 548




6 L40x40x4... 490



7 L40x40x4... 429




70 L60x60x6... 110




71 L60x60x6... 110



52 pl.60x10... 60

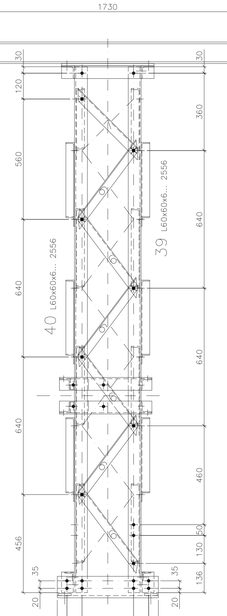



45 L100x100x10...620
mat. quality S355J0

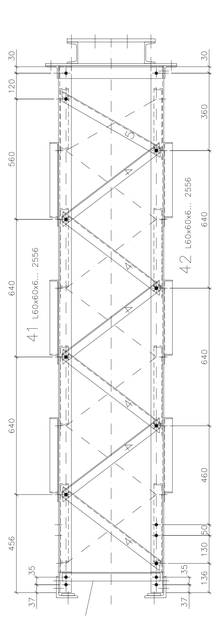


8 L40x40x4... 456
18+420+18

78 pl.430x10... 610




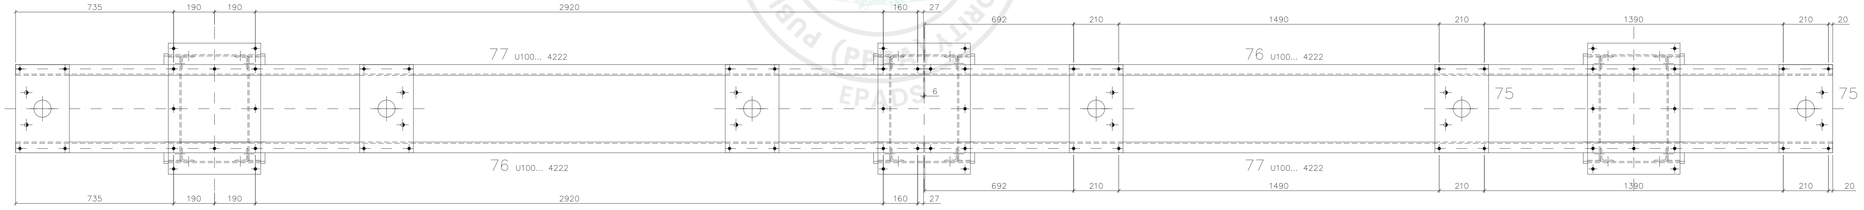


79 pl.430x10... 610




SECTION B-B




80 L60x60x6... 480




81 L60x60x6... 430




45 L100x100x10...620
mat. quality S355J0




82 L50x50x5... 590



83 L50x50x5... 590



SECTION A-A



There are considered the following standards,
if not in a different way given !

material:	S 235 JR
bolt quality:	5.8
HOT DIP GALVANIZED	

ø14	M12
ø18	M16
ø22	M20

L80x80	SM 45
L70x70	SM 40
L60x60	SM 35
L50x50	SM 30
L40x40	SM 25

SM

Weight: 639 kg

INDEX	REV. N° (SHEET)	N° ALT.	MODIFICATION	DATE	NAME	DATE	APPROVED
A0			First Issue	23.10.07	SOHN	23.10.07	AE-PA4

REFERENCE DRAWINGS

PAKISTAN
WATER AND POWER DEVELOPMENT AUTHORITY

ENGINEER :
HHC
HIGH HEAD HYDROPOWER CONSULTANT JOINT VENTURE

ALLAI KHWAR HYDROPOWER PROJECT
ELECTRICAL AND HYDRO-MECHANICAL EQUIPMENT
CONTRACT No. AE 06

PURCHASER	PROJECT N° C24338014
PLANT Allai Khwar	CONTRACT N°
132kV Switchyard Disconnector In-line Sreel Structure Drawing	= + CUSTOMER N° AE06-VTH-DD-10

	DATE	NAME	SCALE
DRAWN	23.10.2007	SOHN	1:10
CHECK			
APPROVED		AE-PA4	

ISO / R 128 EUROPA

SP. DATUM | MODEL | WEIGHT | MATERIAL

VA TECH HYDRO

DRAWING N° AEA-28-000007008- IND. A0

SHEET 2 OF 2

This drawing is the PROPERTY of
VA TECH HYDRO GmbH & Co
Penzingerstrasse 76
A-1141 Wien AUSTRIA
Note protection DIN 34 !

e-Pak Acquisition and Disposal System (EPADS) generated document | © 2026

Past Experience / Contracts

Contracts over *[insert amount]* during the last three years:				
Procuring Agency	Value	Year	Goods/Services Supplied	Country of Destination

PUBLIC PROCUREMENT REGULATORY AUTHORITY (PPRA) EPADS

Historical Contract Non-Performance, and Pending Litigation and Litigation History

[The following table shall be filled in for the Applicant and for each member of a Joint Venture]

Applicant's Name: *[insert full name]*
Date: *[insert day, month, year]*
Joint Venture Member Name: *[insert full name]*
IFP No. and title: *[insert IFP number and title]*
Page *[insert page number]* of *[insert total number]* pages

☐ Not debarred due to deviation from commitment of Bid Securing Declaration-☐ Not debarred due to non-performance			
Year	**Non-performed portion of contract**	**Contract Identification**	**Total Contract Amount (current value, currency, exchange rate and PKR equivalent)**
[insert year]	*[insert amount and percentage]*	Contract Identification: *[indicate complete contract name/ number, and any other identification]* Name of Procuring Agency: *[insert full name]* Address of Procuring Agency: *[insert street/city/country]* Reason(s) for nonperformance: *[indicate main reason(s)]*	*[insert amount]*
Pending Litigation, in accordance with Section III, Qualification Criteria and Requirements			
☐ Pending litigation in accordance with Section III, Qualification Criteria and Requirements, Sub-Factor 2.3 as indicated below.			

Year of dispute	**Amount in dispute (currency)**	**Contract Identification**	**Total Contract Amount (currency), ~~US$~~ PKR Equivalent (exchange rate)**

[insert year]	*[insert amount]*	Contract Identification: [indicate complete contract name, number, and any other identification] Name of Procuring Agency: *[insert full name]* Address of Procuring Agency: *[insert street/city/country]* Matter in dispute: *[indicate main issues in dispute]* Party who initiated the dispute: *[indicate "Procuring Agency" or "Supplier"]* Status of dispute: *[Indicate if it is being treated by the Adjudicator, under Arbitration or being dealt with by the Judiciary]*	*[insert amount]*

☐ No consistent history of court/arbitral award decisions in accordance with Section III, Qualification Criteria and Requirements, Sub-Factor 2.4.

☐ Consistent history of court/arbitral award decisions in accordance with Section III, Qualification Criteria and Requirements, Sub-Factor 2.4 as indicated below.

Year of award	**Outcome as percentage of Net Worth**	**Contract Identification**	**Total Contract Amount (currency), PKR Equivalent (exchange rate)**
[insert year]	*[insert percentage]*	Contract Identification: [indicate complete contract name, number, and any other identification] Name of Procuring Agency: *[insert full name]* Address of Procuring Agency: *[insert street/city/country]* Matter in dispute: *[indicate main issues in dispute]* Party who initiated the dispute: *[indicate "Procuring Agency" or "Supplier"]* Court/ arbitral award decision: *[Indicate if the award decision was against the Applicant or any member of a joint venture.]y]*	*[insert amount]*

Current Contract Commitments / Works in Progress

Bidders and each member to a JV should provide information on their current commitments on all contracts that have been awarded, or for which a letter of intent or acceptance has been received, or for contracts approaching completion, but for which an unqualified, full completion certificate has yet to be issued.

Current Contract Commitments					
No.	Name of Contract	**Employer's Contact Address, Tel, Fax**	**Value of Outstanding Work [Current Eq. PKR]**	**Estimated Completion Date**	**Average Monthly Invoicing Over Last Six Months [Eq. PKR/month)]**
1					
2					
3					
4					
5					

Financial Situation and Performance

[The following table shall be filled in for the Applicant and for each member of a Joint Venture]

Applicant's Name: *[insert full name]*
Date: *[insert day, month, year]*
Joint Venture Member Name: *[insert full name]*
IFP No. and title: *[insert IFP number and title]*
Page *[insert page number]* of *[insert total number]* pages

1. Financial data

Type of Financial information in (currency)	**Historic information for previous _[insert number] years, [insert in words] (amount in currency, currency, exchange rate*, PKR equivalent)**				
	Year 1	Year 2	Year 3		
Statement of Financial Position (Information from Balance Sheet)					
Total Assets (TA)					
Total Liabilities (TL)					
Total Equity/Net Worth (NW)					
Current Assets (CA)					
Current Liabilities (CL)					
Working Capital (WC)					
Information from Income Statement					
Total Revenue (TR)					
Profits Before Taxes (PBT)					
Cash Flow Information					
Cash Flow from Operating Activities					

* Refer ITA 14 for the exchange rate

3. Financial documents

The Applicant and in case of JV, members of JV shall provide copies of financial statements for *[number]* years pursuant Section III, Qualifications Criteria and Requirements. The financial statements shall:

(a) reflect the financial situation of the Applicant or in case of JV member, and not an affiliated entity (such as parent company or group member).

(b) be independently audited or certified in accordance with local legislation.

(c) be complete, including all notes to the financial statements.

(d) correspond to accounting periods already completed and audited.

☐ Attached are copies of financial statements[1] for the *[number]* years required above; and complying with the requirements.

[1] If the most recent set of financial statements is for a period earlier than 12 months from the date of Application, the reason for this should be justified.

Average Annual Turnover (Annual Sales Value)

[The following table shall be filled in for the Applicant and for each member of a Joint Venture]

Applicant's Name: *[insert full name]*
Date: *[insert day, month, year]*
Joint Venture Member Name: *[insert full name]*
IFP No. and title: *[insert IFP number and title]*
Page *[insert page number]* of *[insert total number]* pages

Annual Turnover Data			
Year	**Amount** **Currency**	**Exchange rate*** **(If applicable)**	**PKR equivalent**
[indicate calendar year]	*[insert amount and indicate currency]*		
		Average Annual Turnover **	

* Refer ITA for date and source of exchange rate.

** Total PKR equivalent for all years divided by the total number of years. See Section III, Qualification Criteria and Requirements, ITA.